

**MONTHLY PROGRESS REPORT #92
FOR NOVEMBER 2004**

EPA REGION I ADMINISTRATIVE ORDERS SDWA 1-97-1019 and 1-2000-0014

**MASSACHUSETTS MILITARY RESERVATION
TRAINING RANGE AND IMPACT AREA**

The following summary of progress is for the period from November 1 to November 30, 2004. Scheduled actions are for the six-week period ending January 7, 2004.

1. SUMMARY OF REMEDIATION ACTIONS

The following is a description of remediation actions taken as part of or in preparation for Rapid Response Action (RRA) Plans for various Areas of Concern at Camp Edwards through November 30, 2004. An RRA is an interim action that may be conducted prior to risk assessments or remedial investigations to address a known, ongoing threat of contamination to groundwater and/or soil.

Demo Area 1 Groundwater RRA

The Demo Area 1 Groundwater RRA consists of the removal and treatment of contaminated groundwater to control further migration of explosives and perchlorate. Extraction, treatment, and recharge systems (ETR) at Frank Perkins Road and Pew Road has been designed and include single extraction wells, ex-situ treatment processes to remove explosives and perchlorate from the groundwater, and injection wells to return treated water to the aquifer.

The Pew Road ETR continues operation at a flow rate of 100 gallons per minute (gpm). Available results for the first 17 sampling events did not show any detections of contaminations of concern (COCs) in effluent samples. Breakthrough of perchlorate was detected after the first GAC vessels in samples collected on November 23, 2004. The GAC media will be exchanged following the breakthrough of perchlorate at the second set of three sets of GAC vessels. As of November 26, 2004, approximately 10.5 million gallons of water have been treated and re-injected at the Pew Road ETR System.

The Frank Perkins Road ETR continues operation at a flow rate of 220 gpm. Available results for the first 15 sampling events did not show any detections of COCs in the effluent samples. Breakthrough of perchlorate was detected after the first GAC vessels in all three of the treatment containers in samples collected on November 16, 2004. This breakthrough of perchlorate does not require a media exchange because the first GAC vessels are followed by ion exchange (IX) vessels, which are designed for treatment of perchlorate. As of November 26, 2004, approximately 15.7 million gallons of water had been treated and re-injected at the Frank Perkins Road ETR System.

Demo Area 1 Soil RRA

The Demo Area 1 Soil RRA consists of the removal of all geophysical anomalies within the perimeter road (7.4 acres) and the removal and thermal treatment of contaminated soil from in and around the Demo 1 kettle hole.

As of November 26, 2004, the total amount of soil excavated at Demo Area 1 is 16,545 cubic yards, with an additional 150 cubic yards excavated at Demo Area 1 burn pits. Excavation of

burn pits and the north slope of the kettle hole continues. Anomaly removal based on the EM-61 survey continues at selected grids.

Demo Area 2 Soil RRA

The Demo Area 2 Soil RRA consists of the removal and treatment or disposal of contaminated soil that is a potential source of groundwater contamination. Soil excavation has been completed and resulted in removal of 789 cubic yards of soil from Demo Area 2 sites.

Impact Area Soil RRA

The Impact Area Soil RRA consists of the removal and treatment of contaminated soil and targets at Targets 23 and 42. Remaining target areas will be addressed in a supplemental plan. Soil will be removed from Targets 23 and 42, in area of approximately 15,700 square feet, to a depth of approximately 2 feet, for a total volume of removed soil of approximately 1,160 cubic yards of soil.

During November, anomaly removal and excavation was conducted at Target 23. Previously excavated soils were transported from Target 42 to Demo Area 1 for screening. To date, 590 cubic yards have been removed from Target 23 and 544 cubic yards have been removed from Target 42 and transferred to the Demo Area 1 staging area for treatment in the Thermal Treatment Unit (TTU).

J-2 Range Soil RRA

The J-2 Range Soil RRA consists of the removal and treatment of soil in six general areas within the J-2 Range that contain selected explosives and perchlorate. Soil will be removed from the Twin Berms Area, Berm 2, Berm 5, Fixed Firing Points 3 and 4 (FFP-3 and 4) and adjacent Range Road Burn Area (RRBA), Disposal Area 1, and Disposal Area 2. Based on modifications made during finalization of the RRA Workplan, the proposed removal and treatment scope increased to a total removal approximated at 93,835 square feet and 5,361 cubic yards to a maximum depth of 2.5 feet. Soil will be treated in the TTU.

UXO clearance was conducted at the former MSP3 Burial Pits in Polygon 2, Target Control Pits, and for the first additional (1 foot) cut at Berm 5. Excavation continued in Polygon 2 and the anomaly west of Polygon 1. Crews completed road repair at the north end of the J-2 Range Road. A total of 5,523 cubic yards of soil has been excavated and transported to Demo Area 1 staging area for treatment in the TTU.

J-3 Range Soil RRA

The J-3 Range Soil RRA consists of the removal and treatment of contaminated soil from two general areas, referred to as the Demolition Area and the Melt/Pour Facility Area. At the Demolition Area, located in the middle of the J-3 Range, soil will be removed from the Detonation Pit, the Burn Box, and the area in the vicinity of Target 2, with total soil removal approximated at 14,000 square feet and 1,300 cubic yards of soil to a maximum depth of 3 feet. At the Melt/Pour Facility, located in the southern portion of the range, approximately 1,000 cubic yards of soil will be removed from an area encompassing approximately 8,800 square feet, to a maximum depth of 6 feet. Soil will be treated in the TTU.

Excavation of stained soils resumed at the area south of the Detonation Pit. The vertical extent of staining was excavated. Additional excavation will be required to determine the horizontal extent of stained soil observed in the sidewall under the concrete flight line. Excavation for a third (one foot) lift in the western portion of the Detonation Pit was completed. A total of 2,568

cubic yards of soils has been excavated from J-3 Range RRA sites and transported to the Demo Area 1 soil stockpile area.

2. SUMMARY OF ACTIONS TAKEN

Drilling progress for the month of November is summarized in Table 1.

Table 1. Drilling progress as of November 2004				
Boring Number	Purpose of Boring/Well	Total Depth (ft bgs)	Depth to Water Table (ft bgs)	Completed Well Screens (ft bgs)
MW-355	J-2 Range (J2P-47)	335	93	93-103; 220-230
MW-356	J-3 Range (J3P-44)	296	103	
MW-357	J-2 Range (J2P-48)	332	101	
MW-358	J-2 Range (J2P-50)	349	101	178-188; 230-240
MW-359	J-3 Range (J3P-39)	307	95	
MW-360	J-1 Range (J1P-20)	210	97	
MW-361	J-3 Range (J3P-34)	105	14	

bgs = below ground surface
bwt = below water table

Completed well installation at MW-355 (J2P-47) and MW-358 (J2P-50). Commenced well installation at MW-359 (J3P-39). Completed drilling at MW-356 (J2P-48) and MW-357 (J2P-48). Commenced drilling at MW-360 (J1P-20) and MW-361 (J3P-34). Well development continued for recently installed wells.

Samples collected during the reporting period are summarized in Table 2. Groundwater profile samples were collected from MW-356, MW-357, MW-358, MW-360 and MW-361. Groundwater samples were collected from Bourne water supply and monitoring wells, recently installed wells, and Northwest Corner monthly monitoring wells. The August round of the Draft 2004 Long-Term Groundwater Monitoring (LTGM) Program was completed and the December round of the 2004 LTGM commenced. Process water samples were collected from the Pew Road and Frank Perkins Road extraction, treatment and recharge (ETR) systems. Investigation-derived waste (IDW) samples were collected from the Granular Activated Carbon (GAC) treatment system and of soil cuttings from recently installed wells. Soil samples were collected from the IBC Range, from the Former A Range, from a spoils pile at Demo Area 1, and from HUTA I as part of lysimeter installation. Pre- and post-BIP samples were collected from the Central Impact Area. Post-excavation soil samples were collected following excavations of BIP craters at the J-2 Range, J-3 Range, Mortar Target 9 and at Impact Area sites including along Turpentine Road, near well MW-235, the SCAR site, HUTA Transect 3 and Transect 4. Surface water samples were collected near a public beach, a private beach, and near the spit at Snake Pond.

The following are the notes from the November 18, 2004 Technical Team meeting of the Impact Area Groundwater Study Program office at Camp Edwards:

Punchlist Items

There were no Punchlist items open from the 10/28/04 Technical Team meeting.

Northwest Corner Age Dating Results

Bill Gallagher (IAGWSP) provided an update on the USGS effort to age date groundwater samples from the NW Corner.

- A map of the area showing well locations and plumes was projected. Mr. Gallagher handed out two tables, one showing ages predicted by the groundwater model and the other showing ages estimated by USGS' chlorofluorocarbon (CFC) sample results.
- Mr. Gallagher listed well screens which had similar ages predicted by the model vs. the CFC samples, and other screens whose ages were predicted to be quite different by the two methods. The term "modern" in the CFC table was described as being from the last five years. Mr. Gallagher described difficulties with employing the CFC method at this location, which include sampling from 10-ft long screens (which tend to blur different aged layers of groundwater) and possible complications from the steep gradient in the water table. In summary, the model and sample results were not too consistent, and the CFC age dating does not strongly support the conceptual or numeric models. USGS is expected to provide additional information on the results, and can attend a future technical meeting. Len Pinaud (MADEP) requested that the age dating results be depicted on cross sections.

Demo 1 Sentinel Well Installation and Supplemental Evaluation Status

Paul Nixon (IAGWSP) provided an update on the most recent detections, plume status, and next modeling steps. Maps of the latest RDX and perchlorate plumes were projected; IAGWSP will send these maps electronically within the next few days.

- Mr. Nixon discussed the perchlorate data from MW-352 and –353 and the new plume shape at the toe, which appears to move north from the vicinity of MW-258. IAGWSP would like Agency approval of the plume shell ASAP, after which modeling can proceed. The model can be used to locate downgradient wells along Canal View Road, and to predict what will happen to the plume under various remediation scenarios. A discussion of the types and order of modeling runs ensued between Mr. Nixon, Lynne Jennings (USEPA), and Bob Lim (USEPA). Ms. Jennings indicated that USEPA was interested in evaluating the time for remediation and the amount of mass capture, such that remedies could be selected to result in no migration and restoration within a reasonable period. Ben Gregson (IAGWSP) indicated IAGWSP would identify the types of scenarios and schedule for modeling before initiating the runs.
- Mr. Nixon discussed the RDX data from the vicinity of Pew Road, and the stagnation zone expected to form within 100 feet of Pew Road. In response to a question from Ms. Jennings about plume extent downgradient of MW-341, Mr. Nixon indicated that the initial hydraulic monitoring results corroborate what is in the SPEIM Workplan, that some relatively small amount of contamination downgradient of Pew is not captured. Mr. Lim asked whether the combined capture zones of both systems could be depicted; Mr. Nixon indicated this would be done. In response to a question from Len Pinaud (MADEP), Mr. Nixon indicated that the model would be used to locate D1P-27 on a particle track downgradient from the perchlorate plume toe, and D1P-25 and –26 could be placed on hold as long as MW-353 continued without detections.

J-2 Range East Groundwater Investigation Update

Dave Hill (IAGWSP) and Jay Ehret (USACE) provided an update, including table and map handouts, of the groundwater investigation east of J-2 Range. The map identifies primary and contingency drilling swath locations expected to be necessary to bound the contaminant plume.

- J2P-49 is on the Sandwich Selectman's agenda for 11/18, would be installed after J3P-34; at the latest, drilling would start around 1/3/05 when the drillers return from holiday. Eight residents in the F swath area have responded to the initial request for access, and several of these have sufficient property to locate a well. Jane Dolan (USEPA) suggested that the F

location should be done before J2P-49; Mr. Hill agreed, providing that access is available. There was a general discussion of which drilling swath locations are primary (A, C, D, E, F) and which are contingent (B, G) and the lines of evidence for these locations. In response to a question from Ms. Dolan, Mike Goydas (Jacobs) indicated that the G location is based on the expected flow path from J2P-49. Ms. Dolan requested that the basis for contingent wells be indicated on the map. In response to a question from Len Pinaud (MADEP), Mr. Goydas indicated that the E location is on a former range boundary that was once cleared. Mr. Ehret asked for Agency approval ASAP on the drilling swath locations depicted on the map.

J-2 Range North Groundwater RRA Update

Dave Hill (IAGWSP) provided an update on plans for a Rapid Response Action (RRA) on the J-2 Range north plume.

- Mr. Hill indicated that IAGWSP is proposing to conduct well field design first, and document concurrence in a Project Note. This approach is expected to address the most difficult issues at the start. The Project Note will include a schedule for the RRA plan. Mr. Hill indicated that IAGWSP is currently awaiting funding for plume shell development and model calibration. The draft Project Note should be complete by early January. IAGWSP is aware of EPA's concerns regarding the Army's position on policy constraints on addressing low levels of perchlorate. Two 100-gallon/minute (gpm) Extraction, Treatment, and Reinjection systems are currently budgeted, but an evaluation whether both would be needed remains to be developed by modeling. The treatment system(s) would be similar to what is in use at the Demo 1 Groundwater RRA. Goals of the J-2 North Groundwater RRA were discussed between Lynne Jennings (USEPA), Len Pinaud (MADEP), and Mr. Hill. USEPA would like to see both mass removal and containment; IAGWSP indicated that the modeling will show what the constraints are with a nominal 200 gpm treatment system.

Miscellaneous Issues

- Jane Dolan (USEPA) requested results for the following wells (not available from EDMS): MW-348, -331, -330, -327, -337, -296, and –318.
- In response to a question from Ms. Dolan, Frank Fedele (USACE) indicated that the extent of soil removal for the J-2 Range RRA was originally estimated at 100-200 cubic yards (CY), but now may range up to 900 CY. Mr. Fedele indicated that the Thermal Treatment Unit is scheduled for startup on 11/29/04. The Contained Detonation Chamber recently operated for three days.
- Ms. Dolan asked for the analytical parameters for which the used carbon at H Range has been tested.
- Ms. Dolan asked whether the J-2 Range Soil RRA will include an EM survey; Dave Hill (IAGWSP) replied that no survey is in the plan. Gina Kaso (USACE) indicated that the RRA objectives for the J-2 Range are different than for Demo 1, where a survey was performed. At Demo 1, the objectives included anomaly removal, but at J-2, the objective is based on chemistry results. Ms. Dolan indicated that USEPA may request an EM survey as part of the J-2 RRA. Lynne Jennings (USEPA) indicated that important discussions remain on defining closure, beyond the RRA logic of excavating soil while the treatment system is available. Ms. Jennings suggested that for the J Ranges and Impact Area, some of the closure determination belongs in the FS, but USEPA is interested in maximizing opportunities for mass removal in the short term. USEPA also wants to expedite long-term decisions.
- Ms. Dolan asked for information on the groundwater particle track for J2P-50 that was discussed on a recent screen selection call.

- Mark Begley (EMC) asked about alternatives for proposed wells northwest of J-1 Range; Natural Heritage had objections to some locations due to habitat destruction. A discussion of alternatives ensued with Dave Hill (IAGWSP), Len Pinaud (MADEP), Ms. Dolan, and Ms. Jennings. IAGWSP agreed to resubmit the ROA for a scenario where J1P-28 is slightly relocated and is the last well proposed for this area; future downgradient wells would be located along Wood Road.

3. SUMMARY OF DATA RECEIVED

Validated data were received during November for Sample Delivery Groups (SDGs): CE0356, CE0360, CE0368, CE0369, CE0370, CE0371, CE0372, CE0373, CE0374, CE0375, CE0376, CE0377, CE0378, CE0379, CE0380, CE0382, CE0383, CE0384, CE0385, CE0386, CE0387, CE0389, CE0390, CE0393, CE0394, CE0396, CE0397, CEM023, CEM024, CEM025, CEM026, CEM027, CEM028, CEM029, CEM030, CEM031, CEM032, CEM033, CEM034, CEM035, CEM039, CEM040, CEM041, EC_1101, EC_1109, EC_1119, GCE214, GCE215, GCE216, GCE217, GCE218, GCE219, GCE220, GCE221, GCE222, GCE223, GCE224, GCE225, GCE226, GCE227, GCE228.

These SDGs contain results for 342 groundwater samples from supply wells, sentry wells, monitoring wells, and residential wells; 86 process water samples from the Frank Perkins and Pew Road ETR systems and from the FS-12 treatment system; 18 profile samples from monitoring well MW-350; 128 soil grid samples from the L-3 Range, the area west of the Coast Guard Station, Training Area C-15, and the Bottom Pond Landing Zone; 12 crater grid samples; and 3 surface water samples from Snake Pond.

Validated Data

Table 3 summarizes the detections that exceeded an EPA Maximum Contaminant Level (MCL) or Health Advisory (HA) for drinking water, or exceeded a 4 ppb concentration for perchlorate, sorted by analyte, since 1997. Table 3 is updated on a monthly basis; discussions in the text are updated on the same schedule as Figures 1 through 8, which are discussed later in this section.

Table 4 summarizes first-time validated detections of explosives below the MCL/HA for drinking water or of perchlorate below a 4 ppb concentration received from October 31, 2004 through November 26, 2004. There were no first-time validated detections of explosives below the MCL/HA for drinking water or of perchlorate below a 4 ppb concentration received during the reporting period. First time validated detections of VOCs and SVOCs are included and discussed quarterly in the March, June, September, and December Monthly Progress Reports. Metals, chloroform, and BEHP are excluded from Table 4 for the following reasons: metals are a natural component of groundwater, particularly at levels below MCLs or HAs; detections of chloroform are pervasive throughout Cape Cod and are not likely the result of military training activities; and BEHP is believed to be largely an artifact of the investigation methods and introduced to the samples during collection or analysis.

Figures 1 through 8 depict the cumulative results of groundwater analyses for the period from the start of the Impact Area Groundwater Study (July 1997) to the present. Each figure depicts results for a different analyte class:

- Figure 1 shows the results of explosive analyses by EPA Method 8330. This figure is updated and included each month.

- Figure 2 shows the results of inorganic analyses (collectively referred to as "metals", though some analytes are not true metals) by methods E200.8, 300.0, 350.2M, 353M, 365.2, CYAN, IM40MB, and IM40HG. This figure is updated and included quarterly in the March, June, September, and December Monthly Progress Reports.
- Figure 3 shows the results of Volatile Organic Compound (VOC) analyses by methods OC21V, OC21VM, 504, and 8021W, exclusive of chloroform detections. This figure is updated and included quarterly in the March, June, September, and December Monthly Progress Reports.
- Figure 4 shows the chloroform results using the Volatile Organic Compound (VOC) analyses by method OC21V and OC21VM. This figure is updated and included semi-annually in the June and December Monthly Progress Reports.
- Figure 5 shows the results of Semi-Volatile Organic Compound (SVOC) analyses by methods OC21B and SW8270, exclusive of detections of bis (2-ethylhexyl) phthalate (BEHP). This figure is updated and included quarterly in the March, June, September, and December Monthly Progress Reports.
- Figure 6 shows the BEHP results using the Semi-Volatile Organic Compound (SVOC) analyses by methods OC21B and SW8270. This figure is updated and included semi-annually in the June and December Monthly Progress Reports.
- Figure 7 shows the results of Pesticide (method OL21P) and Herbicide (method 8151) analyses. This figure is updated and included quarterly in the March, June, September, and December Monthly Progress Reports.
- Figure 8 shows the results of Perchlorate analysis by method E314.0. This figure is updated and included each month.

The concentrations from these analyses are depicted in Figures 1 through 7 compared to Maximum Contaminant Levels (MCLs) or Health Advisories (HAs) published by EPA for drinking water. For Figures 1 through 7, a red circle is used to depict a well where the concentration of one or more analytes was greater than or equal to the lowest MCL or HA for the analyte(s). A yellow circle is used to depict a well where the concentration of all analytes was less than the lowest MCL or HA. A green circle is used to depict a well where the given analytes were not detected in groundwater samples. For Figure 8, a red circle is used to depict a well where the concentration of perchlorate was greater than or equal to 4 ppb. An orange circle is used to depict a well where the concentration of perchlorate is above 1 ppb and below 4 ppb. A yellow circle is used to depict a well where the concentration of perchlorate was less than 1 ppb. A green circle is used to depict a well where perchlorate was not detected in groundwater samples. For all figures, an open circle is used to depict a proposed well where the analytes in question for example, Explosives in Figure 1, have not yet been quantified. A black circle represents a well that has been sampled for analytes, but validated groundwater data is not yet available.

There are multiple labels listed for some wells in Figures 1 through 8, which indicate multiple well screens at different depths throughout the aquifer. The aquifer is approximately 200 to 300 feet thick in the study area. Well screens are positioned throughout this thickness based on various factors, including the results of groundwater profile samples, the geology, and projected locations of contaminants estimated by groundwater modeling. The screen labels are colored to indicate which of the depths had the chemical detected above MCLs/HAs/4 ppb concentration for perchlorate. Generally, groundwater entering the top of the aquifer will move deeper into the aquifer as it moves radially outward from the top of the water table mound. Light blue dashed lines in Figures 1 through 8 depict water table contours. Groundwater generally moves perpendicular to these contours, starting at the center of the 70 foot contour (the top of the

mound) and moving radially outward. The rate of vertical groundwater flow deeper into the aquifer slows as groundwater moves away from the mound.

The results presented in Figures 1 through 8 are cumulative, which provides a historical perspective on the data rather than a depiction of current conditions. Any detection at a well that equals or exceeds the MCL/HA/4 ppb concentration for perchlorate results in the well having a red symbol, regardless of later detections at lower concentrations, or later non-detects. The difference between historical and current conditions varies according to the type of analytes. There are little or no differences between historical and current exceedances of drinking water criteria for Explosives, Perchlorate, VOCs, Pesticides, and Herbicides; the minor differences are mentioned in the following paragraphs. There are significant differences between historical and current exceedances of drinking water criteria for Metals and SVOCs, as described further below.

Figure 1: Explosives in Groundwater Compared to MCLs/HAs

For data validated in November 2004, no wells had first-time validated detections of explosives above or below the MCL/HAs.

Exceedance of drinking water criteria for explosive compounds are indicated in six general areas:

- Demo Area 1 (wells 19, 31, 34, 73, 76, 77, 114, 129, 210);
- Demo Area 2 (wells 16, 160, and 262);
- The Impact Area and CS-19 (wells 58MW0001, 58MW0002, 58MW0009E, 58MW0011D, 58MW0016B, 58MW0016C, 58MW0018B; and wells 1, 2, 23, 25, 37, 38, 40, 43, 85, 86, 87, 88, 89, 90, 91, 93, 95, 98, 99, 100, 101, 105, 107, 111, 112, 113, 176, 178, 184, 201, 203, 204, 206, 207, 209, 223, 235, OW-1, OW-2, and OW-6);
- J Ranges and southeast of the J Ranges (wells 45, 58, 132, 147, 153, 163, 164, 165, 166, 171, 191, 196, 198, 215, 218, 227, 234, 247, 265, 289, 303, 306, 324, 326, and wells 90MW0022, 90MW0041, 90MW0054 and 90WT0013).
- Landfill Area 1 (wells 27MW0018A, 27MW0020A, and 27MW0020B); and
- Northwest Corner of Base Boundary (well 323)

Exceedances of drinking water criteria were measured for 2,4,6-trinitrotoluene (TNT) at Demo Area 1 (wells 19S, 31S, 31M, and 31D) and Southeast of the Ranges (196S), for 1,3-dinitrobenzene and nitroglycerin at Demo Area 1 (well 19S), and 1,3-dinitrobenzene at LF-1 (wells 27MW0018A, 27MW0020A, and 27MW0020B). Exceedances of the HA for hexahydro-1,3,5-trinitro-1,3,5-triazine (RDX) were noted at all of the locations listed above except at MW-45, MW-196, and the LF-1 wells. Exceedances of drinking water criteria were measured for 2,6-dinitrotoluene (2,6-DNT) at MW-45S.

A magenta concentration contour line is used in Figure 1 and Inset A to show the extent of RDX exceeding the HA in these areas. This extent is based on samples from monitoring wells and samples collected during the drilling process ("profile" samples). This extent also considers non-validated data, where the results have been confirmed using Photo Diode Array (PDA). Additional information regarding PDA is provided below under the heading "Rush (Non-Validated) Data". Concentration contours will be prepared for other areas, and refined for the above areas, when sufficient data are available.

Demo Area 1 has a single well-defined source area and extent of contamination. The estimated extent of RDX exceeding the HA at Demo Area 1 based on the most recent groundwater measurements is indicated by a magenta concentration contour line on Figure 1 and Inset A.

Demo Area 2 has three groundwater exceedances of the RDX HA at MW-16S, MW-160S, and MW-262M1. The extent of the contamination is currently under investigation.

The Impact Area has a plume defined by RDX concentrations above the HA of 2 ppb. The plume originates primarily along Turpentine Road and extends downgradient to the east, northeast. Another source of RDX in the Impact Area is CS-19. Portions of CS-19 are currently under investigation by the Air Force Center for Environmental Excellence (AFCEE) under the Superfund program. The extent of RDX has largely been defined in the Impact Area and the investigation phase of the project is nearing completion.

The J Ranges and downgradient areas have five groundwater plumes defined by concentrations of RDX above the HA of 2 ppb. The five plumes originate at the J-1 Range Interberm Area (northern plume in the vicinity of MW-58 and MW-265), the J-2 Range North plume (northern plume extending from MW-130), the J-2 Range East plume (eastern plume including MW-215), the J-3 Range Demolition Area (southern plume extending from MW-163 south to Snake Pond) and the L Range (in an area defined by MW-147 and MW-153 at Greenway Road). All the J ranges are currently under investigation and the plumes will be updated and refined as new validated data is received.

The Northwest Corner of the base boundary has one validated detection of RDX in groundwater above the HA of 2 ppb at MW-323M2. The M1 screen in this location has a validated detection of RDX in groundwater below 2 ppb.

Figure 2: Metals in Groundwater Compared to MCLs/HAs

Exceedances of drinking water criteria for metals are scattered throughout the study area. Where two or more rounds of sampling data are available, the exceedances generally have not been replicated in consecutive sampling rounds. The exceedances have been measured for antimony, arsenic, cadmium, chromium, lead, molybdenum, sodium, thallium and zinc. Arsenic (well 7M1), cadmium (52M3), and chromium (7M1) each had one exceedance in a single sampling round in August-September 1999. Two of four lead exceedances (ASP well and 45S) was repeated in another sampling round and the remaining two lead exceedances (wells 2S and 7M1) have not been repeated in previous or subsequent results. Two of the eight molybdenum exceedances were repeated in consecutive sampling rounds (wells 53M1 and 54S). All of the molybdenum exceedances were observed in year 1998 and 1999 results. Six of the 18 sodium exceedances were repeated in consecutive sampling rounds (wells 2S, 46S, 57M2, 57M1, 145S, and SDW261160). Four wells (57M3, 144S, 145S, and 187D) had sodium exceedances in year 2002 results. Zinc exceeded the HA in seven wells, all of which are constructed of galvanized (zinc-coated) steel.

There have been few exceedances of drinking water limits for antimony and thallium since the introduction of the ICP/GFAA and ICP/MS methods, discussed in the next paragraph. None of the 12 antimony exceedances were repeated in consecutive sampling rounds, and only one exceedance (well 187D) was measured in year 2002 results. Eight of the 74 thallium exceedances were repeated in consecutive sampling rounds (wells 7M1, 7M2, 47M2, 52S, 52D, 54S, 54M1, and 94M2). Only three wells (148S, 191M1 and 198M2) have had thallium

exceedances in the year 2002. There have been no detections of thallium in 2003 or thus far in 2004.

Groundwater samples sent for metals analysis are analyzed for most metals by Inductively Coupled Plasma (ICP) in accordance with U.S. EPA Contract Laboratory Program Statement of Work ILM04.0. All of the 13 detections of antimony and 88 detections of thallium that exceeded the MCL/HA were analyzed using this method. In May of 2001, the IAGWSP began analyzing for antimony and thallium using the GFAA (graphite furnace atomic adsorption) method in accordance with EPA Drinking Water Methods 204.2 (antimony) and 279.2 (thallium) in order to achieve lower detection limits for these metals. Both the ILM04.0 and GFAA methods are subject to false positive results at trace levels due to interferences. As a result, the IAGWSP changed to a new method to achieve lower detection limits for antimony and thallium in January of 2003. Groundwater samples are now analyzed for antimony and thallium by Inductively Coupled Plasma/Mass Spectroscopy (ICP/MS) in accordance with the EPA Method 6020. The ICP/MS Method 6020 has greater sensitivity and the added feature of selectivity for antimony and thallium. These additional methods achieve lower detection limits for these two metals and reduce the number of false positive results.

The distribution and lack of repeatability of the metals exceedances is not consistent with a contaminant source, nor do the detections appear to be correlated with the presence of explosives or other organic compounds. The IAGWSP has re-evaluated inorganic background concentrations using the expanded groundwater quality database of 1999, and has submitted a draft report describing background conditions. The population characteristics of the remaining eight metals were determined to be consistent with background.

This figure was last included and updated in the September 2004 Monthly Report.

Figure 3: VOCs in Groundwater Compared to MCLs/HAs

Exceedances of drinking water criteria for VOCs are indicated in six general areas: Northeast Corner (LRMW003), Monument Beach Field Well (02-12, 80M2), CS-10 (wells 03MW0007A, 03MW0014A, and 03MW0020), LF-1 (well 27MW0017B), FS-12 (wells MW-45S, 90MW0003, and ECMWSNP02D), and in the J-1 Range (187D). CS-10, LF-1, and FS-12 are sites located near the southern extent of the Training Ranges that are currently under investigation by AFCEE under the Superfund program. Exceedances of drinking water criteria were measured for tetrachloroethylene (PCE) at CS-10, for vinyl chloride at LF-1, and for toluene, 1,2-dichloroethane, and ethylene dibromide (EDB) at FS-12. These compounds are believed to be associated with the sites under investigation by AFCEE. Detections of benzene, tert-butyl methyl ether, and chloromethane at J-1 Range well 187D, and chloromethane at Western Boundary wells 02-12M1 and 80M2 and at chloromethane at Northeast corner well LRMW003 are currently under investigation. This figure was last included and updated in the September 2004 Monthly Report.

Figure 4: Chloroform in Groundwater Compared to MCLs

Chloroform has been widely detected in groundwater across the Upper Cape as stated in a joint press release from USEPA, MADEP, IRP, and the Joint Programs Office. The Cape Cod Commission (2001) in their review of public water supply wells for 1999 found greater than 75% contained chloroform with an average concentration of 4.7 ug/L. The IRP has concluded chloroform is not the result of Air Force activities. A detailed discussion of the presence of chloroform is provided in the Final Central Impact Area Groundwater Report (06/01). To date, the source of the chloroform in the Upper Cape groundwater has not been identified. This figure was last updated and included in the June 2004 Monthly Progress Report.

Figure 5: SVOCs in Groundwater Compared to MCLs/HAs

Exceedances of drinking water criteria for SVOCs are scattered throughout the study area. All exceedances of drinking water criteria for SVOCs were measured for bis (2-ethylhexyl) phthalate (BEHP), with the exception of one well, MW-264M1, which had a detection of benzo(a)pyrene at concentrations of more than twice the HA. Detections of BEHP are presented separately in Figure 6. This figure was last included and updated in the September 2004 Monthly Report.

Figure 6: BEHP in Groundwater Compared to MCLs

Exceedances of drinking water criteria for bis (2-ethylhexyl) phthalate (BEHP) are scattered throughout the study area. BEHP is believed to be largely an artifact of the investigation methods, introduced to the samples during collection or analysis. However, the potential that some of the detections of BEHP are the result of activities conducted at MMR has not been ruled out.

A detailed discussion of the presence of BEHP is provided in the Draft Completion of Work Report (7/98) and subsequent responses to comments. The theory that BEHP mostly occurs as an artifact, and is not really present in the aquifer, is supported by the results of subsequent sampling rounds that show much lower levels of the chemical after additional precautions were taken to prevent cross-contamination during sample collection and analysis. Only four locations (out of 82) showed BEHP exceedances in consecutive sampling rounds: 28MW0106 (located near SD-5, a site under investigation by AFCEE), 58MW0006E (located at CS-19), and 90WT0013 (located at FS-12), and 146M1 (located at L Range). Subsequent sampling rounds at all these locations have had results below the MCL. Five wells (27MW0705, 27MW2061, 164M1, 188M1 and 196M1) had BEHP exceedances in the year 2002 results. This figure was last updated and included in the June 2004 Monthly Progress Report.

Figure 7: Herbicides and Pesticides in Groundwater Compared to MCLs/HAs

There has been one exceedance of drinking water criteria for pesticides, at well PPAWSMW-1. A contractor to the United States Air Force installed this monitoring well at the PAVE PAWS radar station in accordance with the Massachusetts Contingency Plan (MCP), in order to evaluate contamination from a fuel spill. The exceedance was for the pesticide dieldrin in a sample collected in June 1999. This well was sampled again in November 1999. The results of the November sample indicate no detectable pesticides although hydrocarbon interference was noted. It appears from the November sample that pesticides identified in the June sample were false positives. However, the June sample results cannot be changed when following the EPA functional guidelines for data validation. The text of the validation report for the June sample

has been revised to include an explanation of the hydrocarbon interference and the potential for false positives.

There has been one exceedance of drinking water criteria for herbicides, at well 41M1. This response well was installed downgradient of the Impact Area, as indicated above (see discussion for Figure 5). The exceedance was for the herbicide pentachlorophenol in a sample collected in May 2000. There were no detections above the MCL of this compound in the three previous sampling rounds in 1999, nor in the subsequent sampling rounds in 2000, 2001, and 2002. This figure was last included and updated in the September 2004 Monthly Report.

Figure 8: Perchlorate in Groundwater Compared to a 4 ppb Concentration

For data validated in November 2004, three wells, 90MW0022 (J-3 Range), MW-321M1 and MW-348M2 (J-2 Range) had a first time validated detection of perchlorate above the concentration of 4 ppb.

Sampling and analysis of groundwater for perchlorate was initiated at the end of the year 2000 as part of the IAGWSP. Exceedances of the 4 ppb concentration of perchlorate are indicated in six general areas:

- Demo Area 1 (wells 19, 31, 32, 34, 35, 36, 73, 75, 76, 77, 78, 114, 129, 139, 162, 165, 172, 210, 211, and 341);
- Impact Area (well 91);
- J Ranges and southeast of the J Ranges (wells 127, 130, 132, 143, 163, 193, 197, 198, 232, 247, 250, 263, 265, 289, 293, 300, 302, 303, 305, 307, 310, 313, 321, 326, 339, 348 and wells 90PZ0211, 90MW0022 and 90MW0054);
- Landfill Area 1 (27MW0031B);
- CS-18 (well 16MW0001); and
- Northwest Corner of Base Boundary (wells 4036009DC, 270, 277, 278, and 279).

A magenta concentration contour line is used in Figure 8 and the inset to show the extent of perchlorate greater than a 4 ppb concentration of perchlorate. This extent is based on samples from monitoring wells and samples collected during the drilling process ("profile" samples).

Demo Area 1 has a single well-defined source area and extent of contamination. The downgradient extent of the perchlorate plume has been determined with the installation of monitoring wells along the power line right-of-way east of Fredrickson Road.

The Impact Area has a single exceedance of the 4 ppb concentration of perchlorate at MW-91S.

Plumes have been identified in four areas in the J Ranges as shown on Figure 8. The J-1 Interberm perchlorate plume has several detections of greater than 4 ppb in downgradient locations MW-265, MW-303, and MW-326. The J-3 Range Demolition perchlorate plume has concentrations greater than 4 ppb in several wells immediately downgradient of the source area, which is centered at MW-198, and further downgradient centered around location 90MW0054. The J-2 Range North perchlorate plume has detections greater than 4 ppb at source area locations MW-130 and MW-263, and downgradient locations MW-289, MW-293, MW-300, MW-302, MW-305, and MW-313. The J-2 East perchlorate plumes are in the process of delineation and include detections greater than 4 ppb at MW-307 and MW-310. Perchlorate detections at the L Range are below 4 ppb and a plume is not depicted on the figure.

The Northwest Corner has a perchlorate plume extending from Canal View Road at the base boundary to the Cape Cod Canal. This area is under investigation and the plume will be updated and refined as new data is received.

The LF-1 and CS-18 areas are under investigation by AFCEE in the Superfund Program.

Rush (Non-Validated) Data

Rush data are summarized in Table 5. These data are for analyses that are performed on a fast turnaround time, typically 1 to 10 days. Explosive analyses for monitoring wells, and explosive and VOC analyses for profile samples, are typically conducted in this timeframe. Other types of analyses may be rushed depending on the proposed use of the data. The rush data have not yet been validated, but are provided as an indication of the most recent preliminary results. Table 5 summarizes only detects, and does not show samples with non-detects.

The status of the detections with respect to confirmation using Photo Diode Array (PDA) spectra is indicated in Table 5. PDA is a procedure that has been implemented for the explosive analysis, to reduce the likelihood of false positive identifications. Where the PDA status is "YES" in Table 5, the detected compound is verified as properly identified. Where the status is "NO", the identification of an explosive has been determined to be a false positive. Where the status is blank, PDA has not yet been used to evaluate the detection, or PDA is not applicable because the analyte is a VOC. Most explosive detections verified by PDA are confirmed to be present upon completion of validation.

Table 5 includes the following detections:

J-2 Range

- Profile samples from MW-357 (J2P-48) had detections of various VOCs and explosives. Of the explosives detections, 3-nitrotoluene was confirmed by PDA spectra, but with interference, in one interval at 89 ft bwt. Well screens will be set at the depth (84 to 94 ft bwt) corresponding to the detection of 3-nitrotoluene, and at the depth (176 to 186 ft bwt) corresponding to MW-334M1.
- Profile samples from MW-358 (J2P-50) had detections of various VOCs. Tetrachloroethene (PCE) was detected in eleven intervals from 19 to 119 ft bwt. Well screens will be set at the depth (77 to 87 ft bwt) corresponding to the highest PCE detection, and at the depth (129 to 139 ft bwt) corresponding to the depth of a forward particle track from MW-319M2 and bounding the deepest PCE detection.

Demo Area 1

- Process water samples collected from the Frank Perkins Road ETR system influent (FPR-INF) had detections of RDX, HMX and perchlorate. The detections of RDX and HMX were confirmed by PDA spectra.
- Process water samples collected from the Frank Perkins Road ETR system mid-fluent (FPR-MID-1) had detections of perchlorate. These are the first detections of perchlorate in mid-fluent samples from the Frank Perkins Road ETR system.
- Process water samples collected from the Pew Road ETR system influent (PR-INF) had

detections of perchlorate and RDX. The detections of RDX were confirmed by PDA spectra.

- A process water sample collected from the Pew Road ETR system mid-fluent (PR-MID-1) had a detection of perchlorate. This is the first detection of perchlorate in mid-fluent samples from the Pew Road ETR system

4. DELIVERABLES SUBMITTED

Deliverables submitted during the reporting period include the following:

Monthly Progress Report # 91 for October 2004	11/09/2004
Final J-3 Range Supplemental Soil Work Plan	11/15/2004
Draft Central Impact Area Soil Focused Investigation Report Targets 23 & 42	11/16/2004
Interim Month Report for November 1 – November 12, 2004	11/19/2004
Final Demo Area 2 Interim Groundwater Data Summary Report	11/24/2004

5. SCHEDULED ACTIONS

Figure 9 provides a Gantt chart updated to reflect progress and proposed work. The following documents are scheduled to be submitted in December and early January:

- J-2 Range Soil Final Report
- J-1 Range Soil Final Report
- L Range Soil Final Report
- L Range Groundwater Draft Report
- Demo Area 2 RRA Draft Data Summary Report
- Central Impact Area Soil Final Feasibility Study Screening Report
- Central Impact Area Groundwater Draft Feasibility Study
- Demo Area 1 Groundwater Final Remedy Selection Plan

The following documents are being prepared or revised during December and early January:

- Demo Area 1 Soil Draft RRA Completion Report
- J-2 Range Groundwater Draft Report
- Former A Range Final Data Summary Report
- Former K Range Final Data Summary Report
- Demo Area 1 Soil Draft Final Feasibility Study Screening Report
- Central Impact Area Soil Draft Feasibility Study

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
HDA10270402AA	A10270402	11/05/2004	CRATER GRID	0	0.16		
4036000-01G-A	4036000-01G	11/01/2004	GROUNDWATER	38	69.8	6	12
4036000-01G-A	4036000-01G	11/08/2004	GROUNDWATER	38	69.8	6	12
4036000-01G-A	4036000-01G	11/15/2004	GROUNDWATER	38	69.8	6	12
4036000-01G-A	4036000-01G	11/22/2004	GROUNDWATER	38	69.8	6	12
4036000-01G-A	4036000-01G	11/29/2004	GROUNDWATER	38	69.8	6	12
4036000-04G-A	4036000-04G	11/08/2004	GROUNDWATER	54.6	64.6	6	12
4036000-04G-A	4036000-04G	11/29/2004	GROUNDWATER	54.6	64.6	6	12
4036000-04G-A	4036000-04G	11/15/2004	GROUNDWATER	54.6	64.6	6	12
4036000-04G-A	4036000-04G	11/01/2004	GROUNDWATER	54.6	64.6	6	12
4036000-04G-A	4036000-04G	11/22/2004	GROUNDWATER	54.6	64.6	6	12
4036000-06G-A	4036000-06G	11/01/2004	GROUNDWATER	108	128	6	12
4036000-06G-A	4036000-06G	11/08/2004	GROUNDWATER	108	128	6	12
4036000-06G-A	4036000-06G	11/15/2004	GROUNDWATER	108	128	6	12
4036000-06G-A	4036000-06G	11/22/2004	GROUNDWATER	108	128	6	12
4036000-06G-A	4036000-06G	11/29/2004	GROUNDWATER	108	128	6	12
58MW0001-A	58MW0001	11/04/2004	GROUNDWATER	121.8	126.8	0	5
58MW0002-A	58MW0002	11/04/2004	GROUNDWATER	121.2	126.2	0	5
58MW0003-A	58MW0003	11/08/2004	GROUNDWATER	119	124	0	5
58MW0015A-A	58MW0015	11/08/2004	GROUNDWATER	160.7	169.94	36	45
58MW0015B-A	58MW0015	11/08/2004	GROUNDWATER	131	140.22	12.7	22.7
58MW0016A-A	58MW0016	11/05/2004	GROUNDWATER	175.9	185.05	54.22	63.22
58MW0016B-A	58MW0016	11/05/2004	GROUNDWATER	151.1	160.74	28.5	38.5
58MW0016C-A	58MW0016	11/05/2004	GROUNDWATER	116.7	126.33	0	10
58MW0016C-D	58MW0016	11/05/2004	GROUNDWATER	116.7	126.33	0	10
90MW0022-A	90MW0022	11/30/2004	GROUNDWATER	112	117	72.79	77.79
90MW0034-A	90MW0034	11/30/2004	GROUNDWATER	93.71	98.59	28.75	33.63
90MW0039-A	90MW0039	11/30/2004	GROUNDWATER	83.74	88.6	19	23.86
97-2C-A	97-2C	11/11/2004	GROUNDWATER	132	132	68	68
97-2D-A	97-2D	11/11/2004	GROUNDWATER	115.4	115.4	82.9	82.9
97-2F-A	97-2F	11/11/2004	GROUNDWATER	120	120	76.7	76.7
MW-290M1-	MW-290	11/02/2004	GROUNDWATER	244.9	254.92	150.12	160.12
MW-290M1-	MW-290	11/02/2004	GROUNDWATER	245	255	150.2	160.2
MW-290M2-	MW-290	11/02/2004	GROUNDWATER	215	224.98	120.18	130.18
MW-290M2-	MW-290	11/02/2004	GROUNDWATER	215	224.98	120.18	130.18
MW-290M3-	MW-290	11/03/2004	GROUNDWATER	145	155	50.2	60.2
MW-290M3-	MW-290	11/03/2004	GROUNDWATER	144.5	155.17	49.67	60.37
MW-290S-	MW-290	11/02/2004	GROUNDWATER	100	110	5.2	15.2
MW-290S-	MW-290	11/02/2004	GROUNDWATER	100.1	110.15	5.3	15.35
MW-293M1-	MW-293	11/23/2004	GROUNDWATER	296.3	306.27	190.06	200.07
MW-296M2-	MW-296	11/23/2004	GROUNDWATER	215	224.98	95.48	105.48

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
MW-296M2-FD	MW-296	11/23/2004	GROUNDWATER	215	224.98	95.48	105.48
MW-300M1-	MW-300	11/04/2004	GROUNDWATER	293.0	303.02	190.18	200.17
MW-300M1-	MW-300	11/04/2004	GROUNDWATER	293.0	303.03	190.18	200.18
MW-300M2-	MW-300	11/04/2004	GROUNDWATER	197.2	207.23	94.38	104.38
MW-300M2-	MW-300	11/04/2004	GROUNDWATER	197.2	207.23	94.38	104.38
MW-300M2-FD	MW-300	11/04/2004	GROUNDWATER	197.2	207.23	94.38	104.38
MW-300M2-FD	MW-300	11/04/2004	GROUNDWATER	197.2	207.23	94.38	104.38
MW-300M3-	MW-300	11/04/2004	GROUNDWATER	135.3	145.31	32.46	42.46
MW-300M3-	MW-300	11/04/2004	GROUNDWATER	135.3	145.31	32.46	42.46
MW-305M1-	MW-305	11/03/2004	GROUNDWATER	202.8	212.82	99.82	109.82
MW-305M1-	MW-305	11/03/2004	GROUNDWATER	202.8	212.82	99.82	109.82
MW-329M1-	MW-329	11/22/2004	GROUNDWATER	180	189.96	124.75	134.75
MW-329M2-	MW-329	11/22/2004	GROUNDWATER	150.1	160.05	189.7	199.7
MW-331M1-	MW-331	11/04/2004	GROUNDWATER	235	245	121	131
MW-331M1-	MW-331	11/04/2004	GROUNDWATER	235	245	121	131
MW-331M2-	MW-331	11/04/2004	GROUNDWATER	195	205	81	91
MW-331M2-	MW-331	11/04/2004	GROUNDWATER	195	205	81	91
MW-334M2-	MW-334	11/23/2004	GROUNDWATER	165	175	55	65
MW-343M1-	MW-343	11/22/2004	GROUNDWATER	215	225	122	132
MW-343M2-	MW-343	11/22/2004	GROUNDWATER	167	172	74	79
MW-343M2-FD	MW-343	11/22/2004	GROUNDWATER	167	172	74	79
MW-343M3-	MW-343	11/22/2004	GROUNDWATER	110	120	17	27
MW-348M1-	MW-348	11/03/2004	GROUNDWATER	288.5	298.46	171.46	181.46
MW-348M1-	MW-348	11/03/2004	GROUNDWATER	288.5	298.46	171.46	181.46
MW-348M2-	MW-348	11/03/2004	GROUNDWATER	206.5	216.54	89.54	99.54
MW-348M2-	MW-348	11/03/2004	GROUNDWATER	206.5	216.54	89.54	99.54
SMR-2-A	SMR-2	11/13/2004	GROUNDWATER	121	131	19	29
TW00-1-A	00-1	11/29/2004	GROUNDWATER	64	70	52.1	58.1
TW01-2-A	01-2	11/29/2004	GROUNDWATER	50	56	24.5	30.5
TW01-2-D	01-2	11/29/2004	GROUNDWATER	50	56	24.5	30.5
W02-01M1A	02-01	11/29/2004	GROUNDWATER	95	105	42.9	52.9
W02-01M2A	02-01	11/29/2004	GROUNDWATER	83	93	30.9	40.9
W02-03M1A	02-03	11/11/2004	GROUNDWATER	130	140	86.1	96.1
W02-03M2A	02-03	11/11/2004	GROUNDWATER	92	102	48.15	58.15
W02-03M3A	02-03	11/11/2004	GROUNDWATER	75	85	31.05	41.05
W02-04M2A	02-04	11/24/2004	GROUNDWATER	98	108	48.93	58.93
W02-04M2D	02-04	11/24/2004	GROUNDWATER	98	108	48.93	58.93
W02-04M3A	02-04	11/24/2004	GROUNDWATER	83	93	34.01	44.01
W02-05M1A	02-05	11/24/2004	GROUNDWATER	110	120	81.44	91.44
W02-05M2A	02-05	11/24/2004	GROUNDWATER	92	102	63.41	73.41
W02-05M3A	02-05	11/24/2004	GROUNDWATER	70	80	41.37	51.37

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
W02-12M1A	02-12	11/11/2004	GROUNDWATER	109	119	58.35	68.35
W02-12M1A-QA	02-12	11/11/2004	GROUNDWATER	109	119	58.35	68.35
W02-12M2A	02-12	11/11/2004	GROUNDWATER	94	104	43.21	53.21
W02-12M2A-QA	02-12	11/11/2004	GROUNDWATER	94	104	43.21	53.21
W02-12M3A	02-12	11/11/2004	GROUNDWATER	79	89	28.22	38.22
W02-12M3A-QA	02-12	11/11/2004	GROUNDWATER	79	89	28.22	38.22
W02-13M1A	02-13	11/15/2004	GROUNDWATER	98	108	58.33	68.33
W02-13M2A	02-13	11/15/2004	GROUNDWATER	83	93	44.2	54.2
W02-13M2D	02-13	11/15/2004	GROUNDWATER	83	93	44.2	54.2
W02-13M3A	02-13	11/12/2004	GROUNDWATER	68	78	28.3	38.3
W02M2A	MW-2	11/09/2004	GROUNDWATER	170	175	33	38
W101M1A	MW-101	11/18/2004	GROUNDWATER	158	168	27	37
W101M1A-QA	MW-101	11/18/2004	GROUNDWATER	158	168	27	37
W102M1A	MW-102	11/16/2004	GROUNDWATER	267	277	123	133
W102M2A	MW-102	11/16/2004	GROUNDWATER	237	247	93	103
W106M1A	MW-106	11/08/2004	GROUNDWATER	170.5	180.5	38	48
W108DDA	MW-108	11/16/2004	GROUNDWATER	317	327	153	163
W108M1A	MW-108	11/16/2004	GROUNDWATER	297	307	133	143
W108M3A	MW-108	11/16/2004	GROUNDWATER	262	272	98	108
W108M4A	MW-108	11/16/2004	GROUNDWATER	240	250	76	86
W110M2A	MW-110	11/16/2004	GROUNDWATER	248.5	258.5	75	85
W112M1A	MW-112	11/09/2004	GROUNDWATER	195	205	56	66
W112M2A	MW-112	11/09/2004	GROUNDWATER	165	175	26	36
W113M1A	MW-113	11/05/2004	GROUNDWATER	240	250	98	108
W113M2A	MW-113	11/05/2004	GROUNDWATER	190	200	48	58
W123M1A	MW-123	11/15/2004	GROUNDWATER	291	301	153	163
W123M2A	MW-123	11/23/2004	GROUNDWATER	236	246	98	108
W124M1A	MW-124	11/23/2004	GROUNDWATER	234	244	98	108
W130DDA	MW-130	11/17/2004	GROUNDWATER	320	330	217	227
W130M1A	MW-130	11/17/2004	GROUNDWATER	160	170	57	67
W130SSA	MW-130	11/17/2004	GROUNDWATER	103	113	0	10
W135M1A	MW-135	11/23/2004	GROUNDWATER	319	329	133	143
W135M2A	MW-135	11/23/2004	GROUNDWATER	280	290	94	104
W141M1A	MW-141	11/10/2004	GROUNDWATER	190	200	62	72
W141M1A-QA	MW-141	11/10/2004	GROUNDWATER	190	200	62	72
W141M2A	MW-141	11/10/2004	GROUNDWATER	162	172	34	44
W141M2A-QA	MW-141	11/10/2004	GROUNDWATER	162	172	34	44
W141SSA	MW-141	11/10/2004	GROUNDWATER	128	138	0	10
W141SSA-QA	MW-141	11/10/2004	GROUNDWATER	128	138	0	10
W142M1A	MW-142	11/17/2004	GROUNDWATER	225	235	185	195
W142M2A	MW-142	11/17/2004	GROUNDWATER	140	150	100	110

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
W142SSA	MW-142	11/17/2004	GROUNDWATER	42	52	2	12
W144M2A	MW-144	11/17/2004	GROUNDWATER	130	140	109	119
W144SSA	MW-144	11/17/2004	GROUNDWATER	26	36	5	15
W147M1A	MW-147	11/30/2004	GROUNDWATER	167	177	94	104
W147M2A	MW-147	11/30/2004	GROUNDWATER	150	160	77	87
W147M3A	MW-147	11/30/2004	GROUNDWATER	82	92	9	19
W155M1A	MW-155	11/17/2004	GROUNDWATER	124	134	99	109
W155M2A	MW-155	11/17/2004	GROUNDWATER	45	55	20	30
W176M1A	MW-176	11/23/2004	GROUNDWATER	229	239	117.6	127.6
W179DDA	MW-179	11/09/2004	GROUNDWATER	329	339	188.1	198.1
W179M1A	MW-179	11/10/2004	GROUNDWATER	187	197	46.1	56.1
W179M1D	MW-179	11/10/2004	GROUNDWATER	187	197	46.1	56.1
W201M1A	MW-201	11/15/2004	GROUNDWATER	306	316	106.9	116.9
W201M2A	MW-201	11/15/2004	GROUNDWATER	286	296	86.9	96.9
W201M3A	MW-201	11/15/2004	GROUNDWATER	266	276	66.5	76.5
W205M1A	MW-205	11/17/2004	GROUNDWATER	167	177	67.6	77.6
W217M1A	MW-217	11/18/2004	GROUNDWATER	148	153	143	148
W217M2A	MW-217	11/18/2004	GROUNDWATER	138	143	133	138
W217M3A	MW-217	11/18/2004	GROUNDWATER	101	106	96	101
W222M2A	MW-222	11/17/2004	GROUNDWATER	185	195	68.58	78.58
W227M1A	MW-227	11/18/2004	GROUNDWATER	130	140	76.38	86.38
W227M2A	MW-227	11/18/2004	GROUNDWATER	110	120	56.38	66.38
W227M3A	MW-227	11/18/2004	GROUNDWATER	65	75	11.39	21.39
W239M1A	MW-239	11/18/2004	GROUNDWATER	180	190	159.8	169.8
W239M2A	MW-239	11/18/2004	GROUNDWATER	150	160	129.85	139.85
W242M1A	MW-242	11/18/2004	GROUNDWATER	235	245	141.68	151.68
W242M2A	MW-242	11/18/2004	GROUNDWATER	165	175	71.75	81.75
W249M3A	MW-249	11/09/2004	GROUNDWATER	154	164	12.9	22.9
W249M3D	MW-249	11/09/2004	GROUNDWATER	154	164	12.9	22.9
W277M1A	MW-277	11/02/2004	GROUNDWATER	130	140	26.3	36.3
W277SSA	MW-277	11/02/2004	GROUNDWATER	102	112	0	10
W278M1A	MW-278	11/03/2004	GROUNDWATER	113	123	25.76	35.76
W278M1D	MW-278	11/03/2004	GROUNDWATER	113	123	25.76	35.76
W278M2A	MW-278	11/03/2004	GROUNDWATER	97	102	9.79	14.79
W279M1A	MW-279	11/02/2004	GROUNDWATER	96	106	37.4	47.4
W279M2A	MW-279	11/02/2004	GROUNDWATER	83	88	26.8	31.8
W279SSA	MW-279	11/03/2004	GROUNDWATER	66	76	10	20
W316SSA	MW-316	11/23/2004	GROUNDWATER	185	195	0	10
W317M1A	MW-317	11/23/2004	GROUNDWATER	177	187	18.74	28.74
W317SSA	MW-317	11/23/2004	GROUNDWATER	157	167	0	10
W328M1A	MW-328	11/17/2004	GROUNDWATER	160	170	60.97	70.97

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
W328M2A	MW-328	11/17/2004	GROUNDWATER	105	115	5.97	15.97
W352M1A	MW-352	11/03/2004	GROUNDWATER	115	125	96.7	106.7
W352M2A	MW-352	11/03/2004	GROUNDWATER	65	75	46.63	56.63
W352M3A	MW-352	11/03/2004	GROUNDWATER	43	53	25.3	35.3
W352M3D	MW-352	11/03/2004	GROUNDWATER	43	53	25.3	35.3
W353M1A	MW-353	11/22/2004	GROUNDWATER	107	117	96.57	106.57
W353M2A	MW-353	11/22/2004	GROUNDWATER	57	67	46.65	56.65
W353M3A	MW-353	11/22/2004	GROUNDWATER	35	45	24.85	34.85
W38DDA	MW-38	11/08/2004	GROUNDWATER	242	252	124	134
W38M1A	MW-38	11/05/2004	GROUNDWATER	217	227	99	109
W38M2A	MW-38	11/05/2004	GROUNDWATER	187	197	69	79
W38M3A	MW-38	11/04/2004	GROUNDWATER	170	180	52	62
W38M4A	MW-38	11/05/2004	GROUNDWATER	132	142	14	24
W44M1A	MW-44	11/10/2004	GROUNDWATER	182	192	53	63
W44SSA	MW-44	11/10/2004	GROUNDWATER	123	133	0	10
W85M1A	MW-85	11/19/2004	GROUNDWATER	137.5	147.5	22	32
W85M1D	MW-85	11/19/2004	GROUNDWATER	137.5	147.5	22	32
W85SSA	MW-85	11/19/2004	GROUNDWATER	116	126	1	11
W89M1A	MW-89	11/22/2004	GROUNDWATER	234	244	92	102
W89M2A	MW-89	11/22/2004	GROUNDWATER	214	224	72	82
W89M3A	MW-89	11/22/2004	GROUNDWATER	174	184	32	42
W89M3D	MW-89	11/22/2004	GROUNDWATER	174	184	32	42
W90M1A	MW-90	11/19/2004	GROUNDWATER	145	155	27	37
W90M1D	MW-90	11/19/2004	GROUNDWATER	145	155	27	37
W90SSA	MW-90	11/19/2004	GROUNDWATER	118	128	0	10
W91M1A	MW-91	11/10/2004	GROUNDWATER	170	180	45	55
W91M1A-QA	MW-91	11/10/2004	GROUNDWATER	170	180	45	55
W91SSA	MW-91	11/12/2004	GROUNDWATER	124	134	0	10
W91SSA-QA	MW-91	11/12/2004	GROUNDWATER	124	134	0	10
W92SSA	MW-92	11/09/2004	GROUNDWATER	139	149	0	10
W93M1A	MW-93	11/12/2004	GROUNDWATER	185	195	56	66
W93M1A-QA	MW-93	11/12/2004	GROUNDWATER	185	195	56	66
W93M2A	MW-93	11/12/2004	GROUNDWATER	145	155	16	26
W93M2A-QA	MW-93	11/12/2004	GROUNDWATER	145	155	16	26
W98M1A	MW-98	11/09/2004	GROUNDWATER	164	174	26	36
W98M1D	MW-98	11/09/2004	GROUNDWATER	164	174	26	36
W98SSA	MW-98	11/09/2004	GROUNDWATER	137	147	0	10
W99M1A	MW-99	11/08/2004	GROUNDWATER	195	205	60	70
W99M1D	MW-99	11/08/2004	GROUNDWATER	195	205	60	70
W99SSA	MW-99	11/09/2004	GROUNDWATER	133	143	0	10
DW110304-NV	GAC WATER	11/03/2004	IDW	0	0		

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
DW110504-NV	GAC WATER	11/05/2004	IDW	0	0		
DW111604-NV	GAC WATER	11/16/2004	IDW	0	0		
SC33801	SOIL CUTTINGS	11/12/2004	IDW	0	0		
SC34101	SOIL CUTTINGS	11/12/2004	IDW	0	0		
FPR-EFF-12A	FPR-EFF	11/02/2004	PROCESS WATE	0	0		
FPR-EFF-13A	FPR-EFF	11/09/2004	PROCESS WATE	0	0		
FPR-EFF-14A	FPR-EFF	11/16/2004	PROCESS WATE	0	0		
FPR-EFF-15A	FPR-EFF	11/23/2004	PROCESS WATE	0	0		
FPR-EFF-A-12A	FPR-EFF	11/02/2004	PROCESS WATE	0	0		
FPR-EFF-A-12B	FPR-EFF	11/02/2004	PROCESS WATE	0	0		
FPR-EFF-A-13A	FPR-EFF	11/09/2004	PROCESS WATE	0	0		
FPR-EFF-A-13B	FPR-EFF	11/09/2004	PROCESS WATE	0	0		
FPR-EFF-A-14A	FPR-EFF	11/16/2004	PROCESS WATE	0	0		
FPR-EFF-A-14B	FPR-EFF	11/16/2004	PROCESS WATE	0	0		
FPR-EFF-A-15A	FPR-EFF	11/23/2004	PROCESS WATE	0	0		
FPR-EFF-A-15B	FPR-EFF	11/23/2004	PROCESS WATE	0	0		
FPR-EFF-B-12A	FPR-EFF	11/02/2004	PROCESS WATE	0	0		
FPR-EFF-B-12B	FPR-EFF	11/02/2004	PROCESS WATE	0	0		
FPR-EFF-B-13A	FPR-EFF	11/09/2004	PROCESS WATE	0	0		
FPR-EFF-B-13B	FPR-EFF	11/09/2004	PROCESS WATE	0	0		
FPR-EFF-B-14A	FPR-EFF	11/16/2004	PROCESS WATE	0	0		
FPR-EFF-B-14B	FPR-EFF	11/16/2004	PROCESS WATE	0	0		
FPR-EFF-B-15A	FPR-EFF	11/23/2004	PROCESS WATE	0	0		
FPR-EFF-B-15B	FPR-EFF	11/23/2004	PROCESS WATE	0	0		
FPR-EFF-C-12A	FPR-EFF	11/02/2004	PROCESS WATE	0	0		
FPR-EFF-C-12B	FPR-EFF	11/02/2004	PROCESS WATE	0	0		
FPR-EFF-C-13A	FPR-EFF	11/09/2004	PROCESS WATE	0	0		
FPR-EFF-C-13B	FPR-EFF	11/09/2004	PROCESS WATE	0	0		
FPR-EFF-C-14A	FPR-EFF	11/16/2004	PROCESS WATE	0	0		
FPR-EFF-C-14B	FPR-EFF	11/16/2004	PROCESS WATE	0	0		
FPR-EFF-C-15A	FPR-EFF	11/23/2004	PROCESS WATE	0	0		
FPR-EFF-C-15B	FPR-EFF	11/23/2004	PROCESS WATE	0	0		
FPR-INF-12A	FPR-INF	11/02/2004	PROCESS WATE	0	0		
FPR-INF-13A	FPR-INF	11/09/2004	PROCESS WATE	0	0		
FPR-INF-14A	FPR-INF	11/16/2004	PROCESS WATE	0	0		
FPR-INF-15A	FPR-INF	11/23/2004	PROCESS WATE	0	0		
FPR-INF-A-12B	FPR-INF	11/02/2004	PROCESS WATE	0	0		
FPR-INF-A-13B	FPR-INF	11/09/2004	PROCESS WATE	0	0		
FPR-INF-A-14B	FPR-INF	11/16/2004	PROCESS WATE	0	0		
FPR-INF-A-15B	FPR-INF	11/23/2004	PROCESS WATE	0	0		
FPR-INF-B-12B	FPR-INF	11/02/2004	PROCESS WATE	0	0		

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
FPR-INF-B-13B	FPR-INF	11/09/2004	PROCESS WATE	0	0		
FPR-INF-B-14B	FPR-INF	11/16/2004	PROCESS WATE	0	0		
FPR-INF-B-15B	FPR-INF	11/23/2004	PROCESS WATE	0	0		
FPR-INF-C-12B	FPR-INF	11/02/2004	PROCESS WATE	0	0		
FPR-INF-C-13B	FPR-INF	11/09/2004	PROCESS WATE	0	0		
FPR-INF-C-14B	FPR-INF	11/16/2004	PROCESS WATE	0	0		
FPR-INF-C-15B	FPR-INF	11/23/2004	PROCESS WATE	0	0		
FPR-MID-1A-12A	FPR-MID-1	11/02/2004	PROCESS WATE	0	0		
FPR-MID-1A-13A	FPR-MID-1	11/09/2004	PROCESS WATE	0	0		
FPR-MID-1A-14A	FPR-MID-1	11/16/2004	PROCESS WATE	0	0		
FPR-MID-1A-15A	FPR-MID-1	11/23/2004	PROCESS WATE	0	0		
FPR-MID-1B-12A	FPR-MID-1	11/02/2004	PROCESS WATE	0	0		
FPR-MID-1B-13A	FPR-MID-1	11/09/2004	PROCESS WATE	0	0		
FPR-MID-1B-14A	FPR-MID-1	11/16/2004	PROCESS WATE	0	0		
FPR-MID-1B-15A	FPR-MID-1	11/23/2004	PROCESS WATE	0	0		
FPR-MID-1C-12A	FPR-MID-1	11/02/2004	PROCESS WATE	0	0		
FPR-MID-1C-13A	FPR-MID-1	11/09/2004	PROCESS WATE	0	0		
FPR-MID-1C-14A	FPR-MID-1	11/16/2004	PROCESS WATE	0	0		
FPR-MID-1C-15A	FPR-MID-1	11/23/2004	PROCESS WATE	0	0		
FPR-MID-2A-12A	FPR-MID-2	11/02/2004	PROCESS WATE	0	0		
FPR-MID-2A-13A	FPR-MID-2	11/09/2004	PROCESS WATE	0	0		
FPR-MID-2A-14A	FPR-MID-2	11/16/2004	PROCESS WATE	0	0		
FPR-MID-2A-15A	FPR-MID-2	11/23/2004	PROCESS WATE	0	0		
FPR-MID-2B-12A	FPR-MID-2	11/02/2004	PROCESS WATE	0	0		
FPR-MID-2B-13A	FPR-MID-2	11/09/2004	PROCESS WATE	0	0		
FPR-MID-2B-14A	FPR-MID-2	11/16/2004	PROCESS WATE	0	0		
FPR-MID-2B-15A	FPR-MID-2	11/23/2004	PROCESS WATE	0	0		
FPR-MID-2C-12A	FPR-MID-2	11/02/2004	PROCESS WATE	0	0		
FPR-MID-2C-13A	FPR-MID-2	11/09/2004	PROCESS WATE	0	0		
FPR-MID-2C-14A	FPR-MID-2	11/16/2004	PROCESS WATE	0	0		
FPR-MID-2C-15A	FPR-MID-2	11/23/2004	PROCESS WATE	0	0		
PR-EFF-16A	PR-EFF	11/10/2004	PROCESS WATE	0	0		
PR-EFF-17A	PR-EFF	11/23/2004	PROCESS WATE	0	0		
PR-INF-16A	PR-INF	11/10/2004	PROCESS WATE	0	0		
PR-INF-17A	PR-INF	11/23/2004	PROCESS WATE	0	0		
PR-MID-1-16A	PR-MID-1	11/10/2004	PROCESS WATE	0	0		
PR-MID-1-17A	PR-MID-1	11/23/2004	PROCESS WATE	0	0		
PR-MID-2-16A	PR-MID-2	11/10/2004	PROCESS WATE	0	0		
PR-MID-2-17A	PR-MID-2	11/23/2004	PROCESS WATE	0	0		
MW-356-15	MW-356	11/22/2004	PROFILE	240	240	137.4	137.4
MW-356-16	MW-356	11/22/2004	PROFILE	250	250	147.4	147.4

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
MW-356-17	MW-356	11/22/2004	PROFILE	260	260	157.4	157.4
MW-356-19	MW-356	11/23/2004	PROFILE	270	270	167.4	167.4
MW-356-21	MW-356	11/24/2004	PROFILE	280	280	177.4	177.4
MW-356-22	MW-356	11/24/2004	PROFILE	290	290	187.4	187.4
MW-356-23	MW-356	11/24/2004	PROFILE	296	296	193.4	193.4
MW-357-07	MW-357	11/01/2004	PROFILE	160	160	59	59
MW-357-09	MW-357	11/02/2004	PROFILE	170	170	69	69
MW-357-10	MW-357	11/02/2004	PROFILE	180	180	79	79
MW-357-11	MW-357	11/03/2004	PROFILE	190	190	89	89
MW-357-12	MW-357	11/03/2004	PROFILE	200	200	99	99
MW-357-13	MW-357	11/03/2004	PROFILE	210	210	109	109
MW-357-13FD	MW-357	11/03/2004	PROFILE	210	210	109	109
MW-357-14	MW-357	11/03/2004	PROFILE	220	220	119	119
MW-357-15	MW-357	11/03/2004	PROFILE	230	230	129	129
MW-357-16	MW-357	11/03/2004	PROFILE	240	240	139	139
MW-357-17	MW-357	11/03/2004	PROFILE	250	250	149	149
MW-357-18	MW-357	11/03/2004	PROFILE	260	260	159	159
MW-357-19	MW-357	11/04/2004	PROFILE	270	270	169	169
MW-357-20	MW-357	11/04/2004	PROFILE	280	280	179	179
MW-357-21	MW-357	11/04/2004	PROFILE	290	290	189	189
MW-357-22	MW-357	11/04/2004	PROFILE	300	300	199	199
MW-357-23	MW-357	11/04/2004	PROFILE	310	310	209	209
MW-357-24	MW-357	11/04/2004	PROFILE	320	320	219	219
MW-357-25	MW-357	11/04/2004	PROFILE	330	330	229	229
MW-357-25FD	MW-357	11/04/2004	PROFILE	330	330	229	229
MW-358-01	MW-358	11/04/2004	PROFILE	110	115	15.5	20.5
MW-358-02	MW-358	11/04/2004	PROFILE	120	125	25.5	30.5
MW-358-03	MW-358	11/05/2004	PROFILE	130	135	35.5	40.5
MW-358-03FD	MW-358	11/05/2004	PROFILE	130	135	35.5	40.5
MW-358-04	MW-358	11/05/2004	PROFILE	140	145	45.5	50.5
MW-358-05	MW-358	11/05/2004	PROFILE	150	155	55.5	60.5
MW-358-06	MW-358	11/05/2004	PROFILE	160	165	65.5	70.5
MW-358-07	MW-358	11/08/2004	PROFILE	170	175	69	74
MW-358-08	MW-358	11/08/2004	PROFILE	180	185	79	84
MW-358-09	MW-358	11/08/2004	PROFILE	190	195	89	94
MW-358-10	MW-358	11/08/2004	PROFILE	200	205	99	104
MW-358-11	MW-358	11/08/2004	PROFILE	210	215	109	114
MW-358-12	MW-358	11/08/2004	PROFILE	220	225	119	124
MW-358-13	MW-358	11/09/2004	PROFILE	230	235	129	134
MW-358-14	MW-358	11/09/2004	PROFILE	240	245	139	144
MW-358-14FD	MW-358	11/09/2004	PROFILE	240	245	139	144

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
MW-358-15	MW-358	11/09/2004	PROFILE	250	255	149	154
MW-358-16	MW-358	11/09/2004	PROFILE	260	265	159	164
MW-358-17	MW-358	11/10/2004	PROFILE	270	275	169	174
MW-358-18	MW-358	11/10/2004	PROFILE	280	285	179	184
MW-358-19	MW-358	11/10/2004	PROFILE	290	295	189	194
MW-358-20	MW-358	11/10/2004	PROFILE	300	305	199	204
MW-358-21	MW-358	11/11/2004	PROFILE	310	315	209	214
MW-358-22	MW-358	11/11/2004	PROFILE	320	325	219	224
MW-360-01	MW-360	11/29/2004	PROFILE	110	110	13	13
MW-360-02	MW-360	11/29/2004	PROFILE	120	120	23	23
MW-360-03	MW-360	11/29/2004	PROFILE	130	130	33	33
MW-360-03FD	MW-360	11/29/2004	PROFILE	130	130	33	33
MW-360-04	MW-360	11/29/2004	PROFILE	140	140	43	43
MW-360-05	MW-360	11/29/2004	PROFILE	150	150	53	53
MW-360-07	MW-360	11/30/2004	PROFILE	170	170	73	73
MW-360-08	MW-360	11/30/2004	PROFILE	180	180	83	83
MW-360-09	MW-360	11/30/2004	PROFILE	190	190	93	93
MW-360-10	MW-360	11/30/2004	PROFILE	200	200	103	103
MW-361-01	MW-361	11/30/2004	PROFILE	30	35	15.7	20.7
MW-361-02	MW-361	11/30/2004	PROFILE	40	45	25.7	30.7
MW-361-03	MW-361	11/30/2004	PROFILE	50	55	35.7	40.7
MW-361-03FD	MW-361	11/30/2004	PROFILE	50	55	35.7	40.7
MW-361-04	MW-361	11/30/2004	PROFILE	60	65	45.7	50.7
MW-361-05	MW-361	11/30/2004	PROFILE	70	75	55.7	60.7
MW-361-06	MW-361	11/30/2004	PROFILE	80	85	65.7	70.7
MW-361-07	MW-361	11/30/2004	PROFILE	90	95	75.7	80.7
MW-361-08	MW-361	11/30/2004	PROFILE	100	105	85.7	90.7
HCA10270402BG	A10270402	11/01/2004	SOIL GRAB	0	0.16		
HD01280201PE1	J2.A.T16.007	11/01/2004	SOIL GRAB	0	0.25		
HD01280201PE1D	J2.A.T16.007	11/01/2004	SOIL GRAB	0	0.25		
HD01280201PE2	J2.A.T16.007	11/01/2004	SOIL GRAB	0	0.25		
HD01280201PE3	J2.A.T16.007	11/01/2004	SOIL GRAB	0	0.25		
HDA02200201PE1	A02200201	11/12/2004	SOIL GRAB	0	0.25		
HDA02200201PE1D	A02200201	11/12/2004	SOIL GRAB	0	0.25		
HDA02200201PE2	A02200201	11/12/2004	SOIL GRAB	0	0.25		
HDA02200201PE3	A02200201	11/12/2004	SOIL GRAB	0	0.25		
HDA08070101PE1	A08070101	11/03/2004	SOIL GRAB	0	0.25		
HDA08070101PE2	A08070101	11/03/2004	SOIL GRAB	0	0.25		
HDA08070101PE3	A08070101	11/03/2004	SOIL GRAB	0	0.25		
HDA08290202PE1	USA08290202	11/03/2004	SOIL GRAB	0	0.25		
HDA08290202PE1D	USA08290202	11/03/2004	SOIL GRAB	0	0.25		

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
HDA08290202PE2	USA08290202	11/03/2004	SOIL GRAB	0	0.25		
HDA08290202PE3	USA08290202	11/03/2004	SOIL GRAB	0	0.25		
HDJ281MM21PE4	J281MM21	11/01/2004	SOIL GRAB	0	0.25		
HDJ281MM21PE4D	J281MM21	11/01/2004	SOIL GRAB	0	0.25		
HDJ281MM21PE5	J281MM21	11/01/2004	SOIL GRAB	0	0.25		
HDJ281MM21PE6	J281MM21	11/01/2004	SOIL GRAB	0	0.25		
HDSR.C8.018.RPE4	SR.C8.018	11/02/2004	SOIL GRAB	0	0.25		
HDSR.C8.018.RPE5	SR.C8.018	11/02/2004	SOIL GRAB	0	0.25		
HDSR.C8.018.RPE6	SR.C8.018	11/02/2004	SOIL GRAB	0	0.25		
HDTR81MMPE1	81MM_TURP	11/10/2004	SOIL GRAB	0	0.25		
HDTR81MMPE2	81MM_TURP	11/10/2004	SOIL GRAB	0	0.25		
HDTR81MMPE3	81MM_TURP	11/10/2004	SOIL GRAB	0	0.25		
HDTT01230201PE1	J2.A.T14A.001	11/01/2004	SOIL GRAB	0	0.25		
HDTT01230201PE2	J2.A.T14A.001	11/01/2004	SOIL GRAB	0	0.25		
HDTT01230201PE3	J2.A.T14A.001	11/01/2004	SOIL GRAB	0	0.25		
HDTT01230202PE1	J2.A.T14A.002	11/22/2004	SOIL GRAB	0	0.25		
HDTT01230202PE1D	J2.A.T14A.002	11/22/2004	SOIL GRAB	0	0.25		
HDTT01230202PE2	J2.A.T14A.002	11/22/2004	SOIL GRAB	0	0.25		
HDTT01230202PE3	J2.A.T14A.002	11/22/2004	SOIL GRAB	0	0.25		
HDTT01230204PE1	J2.A.T14A.004	11/01/2004	SOIL GRAB	0	0.25		
HDTT01230204PE1D	J2.A.T14A.004	11/01/2004	SOIL GRAB	0	0.25		
HDTT01230204PE2	J2.A.T14A.004	11/01/2004	SOIL GRAB	0	0.25		
HDTT01230204PE3	J2.A.T14A.004	11/01/2004	SOIL GRAB	0	0.25		
HDTT01230302PE1	J2.A.T14A.003	11/22/2004	SOIL GRAB	0	0.25		
HDTT01230302PE2	J2.A.T14A.003	11/22/2004	SOIL GRAB	0	0.25		
HDTT01230302PE3	J2.A.T14A.003	11/22/2004	SOIL GRAB	0	0.25		
HDTT01250201PE1	J2.A.T16.001	11/01/2004	SOIL GRAB	0	0.25		
HDTT01250201PE2	J2.A.T16.001	11/01/2004	SOIL GRAB	0	0.25		
HDTT01250201PE3	J2.A.T16.001	11/01/2004	SOIL GRAB	0	0.25		
HDTT01250202PE1	J2.A.T14A.004	11/01/2004	SOIL GRAB	0	0.25		
HDTT01250202PE2	J2.A.T14A.004	11/01/2004	SOIL GRAB	0	0.25		
HDTT01250202PE3	J2.A.T14A.004	11/01/2004	SOIL GRAB	0	0.25		
HDTT01250203PE1	J2.A.T16.003	11/02/2004	SOIL GRAB	0	0.25		
HDTT01250203PE2	J2.A.T16.003	11/02/2004	SOIL GRAB	0	0.25		
HDTT01250203PE3	J2.A.T16.003	11/02/2004	SOIL GRAB	0	0.25		
HDTT01250204PE1	J2.A.T16.004	11/22/2004	SOIL GRAB	0	0.25		
HDTT01250204PE2	J2.A.T16.004	11/22/2004	SOIL GRAB	0	0.25		
HDTT01250204PE3	J2.A.T16.004	11/22/2004	SOIL GRAB	0	0.25		
HDTT01250205PE1	J2.A.T16.005	11/22/2004	SOIL GRAB	0	0.25		
HDTT01250205PE2	J2.A.T16.005	11/22/2004	SOIL GRAB	0	0.25		
HDTT01250205PE3	J2.A.T16.005	11/22/2004	SOIL GRAB	0	0.25		

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
HDTT01290201PE1	T4.A.0F.001	11/12/2004	SOIL GRAB	0	0.25		
HDTT01290201PE2	T4.A.0F.001	11/12/2004	SOIL GRAB	0	0.25		
HDTT01290201PE3	T4.A.0F.001	11/12/2004	SOIL GRAB	0	0.25		
HDTT02060204PE1	T3.A.0B.001	11/02/2004	SOIL GRAB	0	0.25		
HDTT02060204PE2	T3.A.0B.001	11/02/2004	SOIL GRAB	0	0.25		
HDTT02060204PE3	T3.A.0B.001	11/02/2004	SOIL GRAB	0	0.25		
HDTT02190201PE1	T4.A.0U.005	11/12/2004	SOIL GRAB	0	0.25		
HDTT02190201PE2	T4.A.0U.005	11/12/2004	SOIL GRAB	0	0.25		
HDTT02190201PE3	T4.A.0U.005	11/12/2004	SOIL GRAB	0	0.25		
HDTT0318201PE1	T4.A.0O.012	11/12/2004	SOIL GRAB	0	0.25		
HDTT0318201PE1D	T4.A.0O.012	11/12/2004	SOIL GRAB	0	0.25		
HDTT0318201PE2	T4.A.0O.012	11/12/2004	SOIL GRAB	0	0.25		
HDTT0318201PE3	T4.A.0O.012	11/12/2004	SOIL GRAB	0	0.25		
HDTT07080203PE1	TT07080203	11/02/2004	SOIL GRAB	0	0.25		
HDTT07080203PE2	TT07080203	11/02/2004	SOIL GRAB	0	0.25		
HDTT07080203PE3	TT07080203	11/02/2004	SOIL GRAB	0	0.25		
HDTT07080205PE1	TT07080205	11/02/2004	SOIL GRAB	0	0.25		
HDTT07080205PE1D	TT07080205	11/02/2004	SOIL GRAB	0	0.25		
HDTT07080205PE2	TT07080205	11/02/2004	SOIL GRAB	0	0.25		
HDTT07080205PE3	TT07080205	11/02/2004	SOIL GRAB	0	0.25		
HDTT07080207PE1	TT07080207	11/02/2004	SOIL GRAB	0	0.25		
HDTT07080207PE2	TT07080207	11/02/2004	SOIL GRAB	0	0.25		
HDTT07080207PE3	TT07080207	11/02/2004	SOIL GRAB	0	0.25		
HDTT07290210PE1	SR.A.G12.005	11/12/2004	SOIL GRAB	0	0.25		
HDTT07290210PE1D	SR.A.G12.005	11/12/2004	SOIL GRAB	0	0.25		
HDTT07290210PE2	SR.A.G12.005	11/12/2004	SOIL GRAB	0	0.25		
HDTT07290210PE3	SR.A.G12.005	11/12/2004	SOIL GRAB	0	0.25		
HDTT08150204PE1	TT08150204	11/15/2004	SOIL GRAB	0	0.25		
HDTT08150204PE1D	TT08150204	11/15/2004	SOIL GRAB	0	0.25		
HDTT08150204PE2	TT08150204	11/15/2004	SOIL GRAB	0	0.25		
HDTT08150204PE3	TT08150204	11/15/2004	SOIL GRAB	0	0.25		
HDTT08270201PE1	TT082702-01	11/12/2004	SOIL GRAB	0	0.25		
HDTT08270201PE2	TT082702-01	11/12/2004	SOIL GRAB	0	0.25		
HDTT08270201PE3	TT082702-01	11/12/2004	SOIL GRAB	0	0.25		
HDTT10020201APE1	TT10020201	11/01/2004	SOIL GRAB	0	0.25		
HDTT10020201APE2	TT10020201	11/01/2004	SOIL GRAB	0	0.25		
HDTT10020201APE3	TT10020201	11/01/2004	SOIL GRAB	0	0.25		
HDTT10020201PE1	TT10020201	11/03/2004	SOIL GRAB	0	0.25		
HDTT10020201PE1D	TT10020201	11/03/2004	SOIL GRAB	0	0.25		
HDTT10020201PE2	TT10020201	11/03/2004	SOIL GRAB	0	0.25		
HDTT10020201PE3	TT10020201	11/03/2004	SOIL GRAB	0	0.25		

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
HDTT1203104PE1	T3.A.AR.006	11/03/2004	SOIL GRAB	0	0.25		
HDTT1203104PE2	T3.A.AR.006	11/03/2004	SOIL GRAB	0	0.25		
HDTT1203104PE3	T3.A.AR.006	11/03/2004	SOIL GRAB	0	0.25		
HDTT1204103PE1	T3.A.AR.003	11/02/2004	SOIL GRAB	0	0.25		
HDTT1204103PE2	T3.A.AR.003	11/02/2004	SOIL GRAB	0	0.25		
HDTT1204103PE3	T3.A.AR.003	11/02/2004	SOIL GRAB	0	0.25		
HDTT12046102PE1	T3.A.AR.002	11/03/2004	SOIL GRAB	0	0.25		
HDTT12046102PE1D	T3.A.AR.002	11/03/2004	SOIL GRAB	0	0.25		
HDTT12046102PE2	T3.A.AR.002	11/03/2004	SOIL GRAB	0	0.25		
HDTT12046102PE3	T3.A.AR.002	11/03/2004	SOIL GRAB	0	0.25		
SPOIL1004BIP10A	SPOIL1004BIP10	11/04/2004	SOIL GRAB	0	0.25		
SPOIL1004BIP11A	SPOIL1004BIP11	11/04/2004	SOIL GRAB	0.5	1		
SPOIL1004BIP1A	SPOIL1004BIP1	11/04/2004	SOIL GRAB	0	0.25		
SPOIL1004BIP1D	SPOIL1004BIP1	11/04/2004	SOIL GRAB	0	0.25		
SPOIL1004BIP2A	SPOIL1004BIP2	11/04/2004	SOIL GRAB	0.5	1		
SPOIL1004BIP3A	SPOIL1004BIP3	11/04/2004	SOIL GRAB	2.5	3		
SPOIL1004BIP4A	SPOIL1004BIP4	11/04/2004	SOIL GRAB	0	0.25		
SPOIL1004BIP5A	SPOIL1004BIP5	11/04/2004	SOIL GRAB	0.5	1		
SPOIL1004BIP6A	SPOIL1004BIP6	11/04/2004	SOIL GRAB	2.5	3		
SPOIL1004BIP7A	SPOIL1004BIP7	11/04/2004	SOIL GRAB	0	0.25		
SPOIL1004BIP8A	SPOIL1004BIP8	11/04/2004	SOIL GRAB	0.5	1		
SPOIL1004BIP9A	SPOIL1004BIP9	11/04/2004	SOIL GRAB	2.5	3		
HC132AA1AAA	132AA	11/16/2004	SOIL GRID	0	0.25		
HC132AA1BAA	132AA	11/16/2004	SOIL GRID	0.25	0.5		
HC132AA1CAA	132AA	11/16/2004	SOIL GRID	0.5	1		
HC132AB1AAA	132AB	11/16/2004	SOIL GRID	0	0.25		
HC132AB1AAD	132AB	11/16/2004	SOIL GRID	0	0.25		
HC132AB1BAA	132AB	11/16/2004	SOIL GRID	0.25	0.5		
HC132AB1CAA	132AB	11/16/2004	SOIL GRID	0.5	1		
HC132AC1AAA	132AC	11/16/2004	SOIL GRID	0	0.25		
HC132AC1BAA	132AC	11/16/2004	SOIL GRID	0.25	0.5		
HC132AC1CAA	132AC	11/16/2004	SOIL GRID	0.5	1		
HC132AD1AAA	132AD	11/15/2004	SOIL GRID	0	0.25		
HC132AD1BAA	132AD	11/15/2004	SOIL GRID	0.25	0.5		
HC132AD1CAA	132AD	11/15/2004	SOIL GRID	0.5	1		
HC132AE1AAA	132AE	11/16/2004	SOIL GRID	0	0.25		
HC132AE1BAA	132AE	11/16/2004	SOIL GRID	0.25	0.5		
HC132AE1CAA	132AE	11/16/2004	SOIL GRID	0.5	1		
HC132AF1AAA	132AF	11/19/2004	SOIL GRID	0	0.25		
HC132AF1AAD	132AF	11/19/2004	SOIL GRID	0	0.25		
HC132AF1BAA	132AF	11/19/2004	SOIL GRID	0.25	0.5		

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
HC132AF1CAA	132AF	11/19/2004	SOIL GRID	0.5	1		
HC132AG1AAA	132AG	11/19/2004	SOIL GRID	0	0.25		
HC132AG1BAA	132AG	11/19/2004	SOIL GRID	0.25	0.5		
HC132AG1CAA	132AG	11/19/2004	SOIL GRID	0.5	1		
HC132AH1AAA	132AH	11/16/2004	SOIL GRID	0	0.25		
HC132AH1BAA	132AH	11/16/2004	SOIL GRID	0.25	0.5		
HC132AH1CAA	132AH	11/16/2004	SOIL GRID	0.5	1		
HC132AI1AAA	132AI	11/15/2004	SOIL GRID	0	0.25		
HC132AI1AAD	132AI	11/15/2004	SOIL GRID	0	0.25		
HC132AI1BAA	132AI	11/15/2004	SOIL GRID	0.25	0.5		
HC132AI1CAA	132AI	11/15/2004	SOIL GRID	0.5	1		
HC132AJ1AAA	132AJ	11/15/2004	SOIL GRID	0	0.25		
HC132AJ1BAA	132AJ	11/15/2004	SOIL GRID	0.25	0.5		
HC132AJ1CAA	132AJ	11/15/2004	SOIL GRID	0.5	1		
HC132AK1AAA	132AK	11/15/2004	SOIL GRID	0	0.25		
HC132AK1AAD	132AK	11/15/2004	SOIL GRID	0	0.25		
HC132AK1BAA	132AK	11/15/2004	SOIL GRID	0.25	0.5		
HC132AK1CAA	132AK	11/15/2004	SOIL GRID	0.5	1		
HC132Z1AAA	132Z	11/16/2004	SOIL GRID	0	0.25		
HC132Z1BAA	132Z	11/16/2004	SOIL GRID	0.25	0.5		
HC132Z1CAA	132Z	11/16/2004	SOIL GRID	0.5	1		
HC212J1AAA	212J	11/01/2004	SOIL GRID	0	0.25		
HC212J1BAA	212J	11/01/2004	SOIL GRID	0.25	0.5		
HD132AO1AAA	132AO	11/23/2004	SOIL GRID	0	0.5		
HD132AO1BAA	132AO	11/23/2004	SOIL GRID	1.5	2		
HD132AP1AAA	132AP	11/23/2004	SOIL GRID	0	0.5		
HD132AP1BAA	132AP	11/23/2004	SOIL GRID	1.5	2		
HD132AQ1AAA	132AQ	11/23/2004	SOIL GRID	0	0.5		
HD132AQ1BAA	132AQ	11/23/2004	SOIL GRID	1.5	2		
HD132AR1AAA	132AR	11/23/2004	SOIL GRID	0	0.5		
HD132AR1AAD	132AR	11/23/2004	SOIL GRID	0	0.5		
HD132AR1BAA	132AR	11/23/2004	SOIL GRID	1.5	2		
HD132AS1AAA	132AS	11/23/2004	SOIL GRID	0	0.5		
HD132AS1BAA	132AS	11/23/2004	SOIL GRID	1.5	2		
HD132AT1AAA	132AT	11/23/2004	SOIL GRID	0	0.5		
HD132AT1BAA	132AT	11/23/2004	SOIL GRID	1.5	2		
HD132AU1AAA	132AU	11/23/2004	SOIL GRID	0	0.5		
HD132AU1BAA	132AU	11/23/2004	SOIL GRID	1.5	2		
HD132AV1AAA	132AV	11/22/2004	SOIL GRID	0	0.5		
HD132AV1BAA	132AV	11/22/2004	SOIL GRID	1.5	2		
HD132AW1AAA	132AW	11/22/2004	SOIL GRID	0	0.5		

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives,

Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 2
SAMPLING PROGRESS
11/01/2004 - 11/30/2004

SAMPLE_ID	GIS_LOCID	LOGDATE	SAMP_TYPE	SBD	SED	BWTS	BWTE
HD132AW1BAA	132AW	11/22/2004	SOIL GRID	1.5	2		
HD132AX1AAA	132AX	11/22/2004	SOIL GRID	0	0.5		
HD132AX1AAD	132AX	11/22/2004	SOIL GRID	0	0.5		
HD132AX1BAA	132AX	11/22/2004	SOIL GRID	1.5	2		
HD132AY1AAA	132AY	11/19/2004	SOIL GRID	0	0.5		
HD132AY1BAA	132AY	11/19/2004	SOIL GRID	1.5	2		
HD132AZ1AAA	132AZ	11/19/2004	SOIL GRID	0	0.5		
HD132AZ1BAA	132AZ	11/19/2004	SOIL GRID	1.5	2		
HD209LA1AAA	209LA1	11/09/2004	SOIL GRID	5	5		
HD209LA1AAD	209LA1	11/09/2004	SOIL GRID	5	5		
HD209LA2AAA	209LA2	11/09/2004	SOIL GRID	10	10		
HD209LB1AAA	209LB1	11/09/2004	SOIL GRID	5	5		
HD209LB2AAA	209LB2	11/09/2004	SOIL GRID	14	14		
HD210LA1AAA	210LA1	11/09/2004	SOIL GRID	5	5		
HD210LA2AAA	210LA2	11/09/2004	SOIL GRID	14	14		
HD210LB1AAA	210LB1	11/09/2004	SOIL GRID	5	5		
HD210LB2AAA	210LB2	11/09/2004	SOIL GRID	10	10		
HD211LA2AAA	211LA2	11/08/2004	SOIL GRID	1.66	1.83		
HD211LA3AAA	211LA3	11/08/2004	SOIL GRID	7	9		
HD211LB2AAA	211LB2	11/09/2004	SOIL GRID	5	5		
HD211LB3AAA	211LB3	11/09/2004	SOIL GRID	5	5		
HD211LB3AAD	211LB3	11/09/2004	SOIL GRID	5	5		
LKSNK0005AAA	LKSNK0005	11/11/2004	SURFACE WATER	0	0		
LKSNK0006AAA	LKSNK0006	11/11/2004	SURFACE WATER	0	0		
LKSNK0007AAA	LKSNK0007	11/11/2004	SURFACE WATER	0	0		

Profiling methods may include: Volatiles, Explosives, and Perchlorate

Groundwater methods include: Volatiles, Semivolatiles, Explosives, Pesticides, Herbicides, Metals, Perchlorate, and Wet Chemistry

Other Sample Types methods are variable

SBD = Sample Begin Depth, measured in feet bgs

SED = Sample End Depth, measured in feet bgs

BWTS = Depth below water table, start depth, measured in feet

BWTE = Depth below water table, end depth, measured in feet

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE_ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
ECMWSNP02	ECMWSNP02D	09/13/1999	504	1,2-DIBROMOETHANE (ETHYLENE DI)	0.11		UG/L	75.08	80.08	0.05	X
90MW0003	WF03MA	10/07/1999	OC21V	1,2-DICHLOROETHANE	5		UG/L	52.11	57.11	5	X
MW-19	W19SSA	03/05/1998	8330N	2,4,6-TRINITROTOLUENE	10	J	UG/L	0	10	2	X
MW-19	W19S2A	07/20/1998	8330N	2,4,6-TRINITROTOLUENE	16		UG/L	0	10	2	X
MW-19	W19S2D	07/20/1998	8330N	2,4,6-TRINITROTOLUENE	16		UG/L	0	10	2	X
MW-19	W19SSA	02/12/1999	8330N	2,4,6-TRINITROTOLUENE	7.2	J	UG/L	0	10	2	X
MW-19	W19SSA	09/10/1999	8330N	2,4,6-TRINITROTOLUENE	2.6	J	UG/L	0	10	2	X
MW-19	W19SSA	05/12/2000	8330N	2,4,6-TRINITROTOLUENE	3.7	J	UG/L	0	10	2	X
MW-19	W19SSA	05/23/2000	8330N	2,4,6-TRINITROTOLUENE	3.9	J	UG/L	0	10	2	X
MW-19	W19SSA	08/08/2000	8330N	2,4,6-TRINITROTOLUENE	2	J	UG/L	0	10	2	X
MW-19	W19SSA	12/08/2000	8330N	2,4,6-TRINITROTOLUENE	2.3	J	UG/L	0	10	2	X
MW-19	W19SSA	08/24/2001	8330NX	2,4,6-TRINITROTOLUENE	2.4		UG/L	0	10	2	X
MW-19	W19SSA	12/27/2001	8330NX	2,4,6-TRINITROTOLUENE	2.2	J	UG/L	0	10	2	X
MW-196	W196SSA	02/07/2002	8330N	2,4,6-TRINITROTOLUENE	12		UG/L	0	5	2	X
MW-196	W196SSA	07/12/2002	8330N	2,4,6-TRINITROTOLUENE	10		UG/L	0	5	2	X
MW-196	W196SSA	10/24/2002	8330N	2,4,6-TRINITROTOLUENE	9.3		UG/L	0	5	2	X
MW-196	W196SSA	08/12/2003	8330N	2,4,6-TRINITROTOLUENE	5.5		UG/L	0	5	2	X
MW-196	W196SSA	11/07/2003	8330NX	2,4,6-TRINITROTOLUENE	12		UG/L	0	5	2	X
MW-196	W196SSA	02/10/2004	8330N	2,4,6-TRINITROTOLUENE	14		UG/L	0	5	2	X
MW-31	W31SSA	05/15/2000	8330N	2,4,6-TRINITROTOLUENE	3.3		UG/L	13	18	2	X
MW-31	W31SSA	08/09/2000	8330N	2,4,6-TRINITROTOLUENE	3.9	J	UG/L	13	18	2	X
MW-31	W31SSA	12/08/2000	8330N	2,4,6-TRINITROTOLUENE	5.2	J	UG/L	13	18	2	X
MW-31	W31SSA	05/02/2001	8330N	2,4,6-TRINITROTOLUENE	5.2		UG/L	13	18	2	X
MW-31	W31SSA	08/24/2001	8330NX	2,4,6-TRINITROTOLUENE	5.4		UG/L	13	18	2	X
MW-31	W31SSA	01/04/2002	8330NX	2,4,6-TRINITROTOLUENE	5.9		UG/L	13	18	2	X
MW-31	W31SSA	05/29/2002	8330NX	2,4,6-TRINITROTOLUENE	5.5		UG/L	13	18	2	X
MW-31	W31SSA	08/07/2002	8330N	2,4,6-TRINITROTOLUENE	5.9		UG/L	13	18	2	X
MW-31	W31SSA	11/15/2002	8330N	2,4,6-TRINITROTOLUENE	5.5		UG/L	13	18	2	X
MW-31	W31SSA	03/28/2003	8330NX	2,4,6-TRINITROTOLUENE	5.2		UG/L	13	18	2	X
MW-31	W31SSA	09/27/2003	8330N	2,4,6-TRINITROTOLUENE	5.2	J	UG/L	13	18	2	X
MW-31	W31SSD	09/27/2003	8330N	2,4,6-TRINITROTOLUENE	5.2	J	UG/L	13	18	2	X
MW-31	W31SSA	02/28/2004	8330N	2,4,6-TRINITROTOLUENE	5.7		UG/L	13	18	2	X
MW-31	W31SSA	05/11/2004	8330N	2,4,6-TRINITROTOLUENE	6.2		UG/L	13	18	2	X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-31	W31MMA	05/23/2001	8330N	2,4,6-TRINITROTOLUENE	5.2		UG/L	28	38		2>X
MW-31	W31DDA	08/09/2000	8330N	2,4,6-TRINITROTOLUENE	3.9	J	UG/L	48	53		2>X
MW-45	W45SSA	08/23/2001	8330N	2,6-DINITROTOLUENE	8.3	J	UG/L	0	10		5>X
MW-1	W01SSA	09/07/1999	IM40MB	ANTIMONY	6.7	J	UG/L	0	10		6>X
MW-187	W187DDX	01/23/2002	IM40MB	ANTIMONY	6	J	UG/L	199.5	209.5		6>X
MW-3	W03DDL	03/06/1998	IM40MB	ANTIMONY	13.8	J	UG/L	219	224		6>X
MW-34	W34M2A	08/16/1999	IM40MB	ANTIMONY	6.6	J	UG/L	53	63		6>X
MW-35	W35SSA	08/19/1999	IM40MB	ANTIMONY	6.9	J	UG/L	0	10		6>X
MW-35	W35SSD	08/19/1999	IM40MB	ANTIMONY	13.8	J	UG/L	0	10		6>X
MW-36	W36SSA	08/17/1999	IM40MB	ANTIMONY	6.7	J	UG/L	0	10		6>X
MW-38	W38SSA	08/18/1999	IM40MB	ANTIMONY	7.4		UG/L	0	10		6>X
MW-38	W38M3A	08/18/1999	IM40MB	ANTIMONY	6.6	J	UG/L	52	62		6>X
MW-38	W38DDA	08/17/1999	IM40MB	ANTIMONY	6.9	J	UG/L	124	134		6>X
MW-39	W39M1A	08/18/1999	IM40MB	ANTIMONY	7.5		UG/L	84	94		6>X
MW-50	W50M1A	05/15/2000	IM40MB	ANTIMONY	9.5		UG/L	89	99		6>X
PPAWSMW-3	PPAWSMW-3	08/12/1999	IM40MB	ANTIMONY	6	J	UG/L	0	10		6>X
MW-7	W07M1A	09/07/1999	IM40MB	ARSENIC	52.8		UG/L	135	140		50>X
MW-187	W187DDA	01/23/2002	OC21V	BENZENE	1000		UG/L	199.5	209.5		5>X
MW-187	W187DDA	01/23/2002	VPHMA	BENZENE	760	J	UG/L	199.5	209.5		5>X
MW-187	W187DDA	02/11/2002	VPHMA	BENZENE	1300		UG/L	199.5	209.5		5>X
MW-187	W187DDA	02/11/2002	OC21V	BENZENE	1300		UG/L	199.5	209.5		5>X
MW-187	W187DDA	07/11/2002	OC21V	BENZENE	530	J	UG/L	199.5	209.5		5>X
MW-187	W187DDA	10/17/2002	OC21V	BENZENE	340		UG/L	199.5	209.5		5>X
MW-187	W187DDA	07/07/2003	OC21V	BENZENE	150		UG/L	199.5	209.5		5>X
MW-187	W187DDA	11/21/2003	OC21V	BENZENE	140		UG/L	199.5	209.5		5>X
MW-187	W187DDA	03/05/2004	OC21VM	BENZENE	120		UG/L	199.5	209.5		5>X
MW-187	W187DDA	07/13/2004	OC21VM	BENZENE	120		UG/L	199.5	209.5		5>X
MW-187	W187DDA	09/01/2004	OC21VM	BENZENE	110		UG/L	199.5	209.5		5>X
MW-264	W264M1A	12/09/2003	SW8270	BENZO(A)PYRENE	0.5	J	UG/L	160.94	170.94		0.2>X
03MW0122A	WS122A	09/30/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	12		UG/L	1	11		6>X
11MW0003	WF143A	02/25/1998	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	9		UG/L				6>X
11MW0003	WF143A	09/30/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	24		UG/L				6>X
15MW0004	15MW0004	04/09/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	6		UG/L	0	10		6>X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
15MW0008	15MW0008D	04/12/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	25	J	UG/L	0	10	6	X
27MW0705	27MW0705	01/08/2002	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	7.5	J	UG/L	0	10	6	X
27MW2061	27MW2061	01/09/2002	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	12	J	UG/L	0	10	6	X
28MW0106	WL28XA	02/19/1998	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	18	J	UG/L	0	10	6	X
28MW0106	WL28XA	03/23/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	26		UG/L	0	10	6	X
58MW0002	WC2XXA	02/26/1998	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	36		UG/L	0	5	6	X
58MW0005E	WC5EXA	09/27/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	8		UG/L	0	10	6	X
58MW0006E	WC6EXA	10/03/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	59		UG/L	0	10	6	X
58MW0006E	WC6EXD	10/03/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	57		UG/L	0	10	6	X
58MW0006E	WC6EXA	01/29/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	6		UG/L	0	10	6	X
58MW0007C	WC7CXA	09/28/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	13		UG/L	24	29	6	X
90MW0054	WF12XA	10/04/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	13	J	UG/L	91.83	96.83	6	X
90WT0003	WF03XA	09/30/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	58		UG/L	0	10	6	X
90WT0005	WF05XA	01/13/1998	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	47		UG/L	0	10	6	X
90WT0013	WF13XA	01/16/1998	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	34		UG/L	0	10	6	X
90WT0013	WF13XA	01/14/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	16		UG/L	0	10	6	X
97-1	W9701A	11/19/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	54	J	UG/L	62	72	6	X
97-1	W9701D	11/19/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	28	J	UG/L	62	72	6	X
97-2	W9702A	11/20/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	7		UG/L	53	63	6	X
97-3	W9703A	11/21/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	73	J	UG/L	36	46	6	X
97-5	W9705A	11/20/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	15		UG/L	76	86	6	X
BHW215083	WG083A	11/26/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	13		UG/L	16.95	26.95	6	X
C2-B	C-2I	03/07/2002	SVOC_FW	BIS(2-ETHYLHEXYL) PHTHALATE	10		UG/L	39.31	79.31	6	X
C6-C	C-6D	03/12/2002	SVOC_FW	BIS(2-ETHYLHEXYL) PHTHALATE	7.1		UG/L	100.04	140.04	6	X
C7-B	C-7I	03/08/2002	SVOC_FW	BIS(2-ETHYLHEXYL) PHTHALATE	14		UG/L	93.89	133.89	6	X
C7-B	C-7ID	03/08/2002	SVOC_FW	BIS(2-ETHYLHEXYL) PHTHALATE	17		UG/L	93.89	133.89	6	X
LRWS1-4	WL14XA	10/06/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	78	J	UG/L	107	117	6	X
LRWS2-3	WL23XA	11/21/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	20	J	UG/L	68	83	6	X
LRWS2-6	WL26XA	10/20/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	21		UG/L	75	90	6	X
LRWS2-6	WL26XA	10/04/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	9	J	UG/L	75	90	6	X
LRWS4-1	WL41XA	11/24/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	100		UG/L	66	91	6	X
LRWS5-1	WL51XA	11/25/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	7		UG/L	66	91	6	X
MW-10	W10SSA	09/16/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	39		UG/L	0	10	6	X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-11	W11SSA	11/06/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	33	J	UG/L	0	10	6	X
MW-11	W11SSD	11/06/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	23	J	UG/L	0	10	6	X
MW-12	W12SSA	11/06/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	28		UG/L	0	10	6	X
MW-14	W14SSA	11/04/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	14		UG/L	0	10	6	X
MW-142	W142M2A	01/29/2001	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	11		UG/L	100	110	6	X
MW-142	W142M1A	01/29/2001	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	20		UG/L	185	195	6	X
MW-146	W146M1A	02/23/2001	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	8.4		UG/L	75	80	6	X
MW-146	W146M1A	06/19/2001	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	8.2		UG/L	75	80	6	X
MW-157	W157DDA	05/03/2001	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	8.1		UG/L	199	209	6	X
MW-158	W158M2A	10/15/2001	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	34	J	UG/L	37	47	6	X
MW-16	W16SSA	11/17/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	28		UG/L	0	10	6	X
MW-16	W16DDA	11/17/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	43		UG/L	223	228	6	X
MW-164	W164M1A	09/05/2002	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	8.6		UG/L	119	129	6	X
MW-168	W168M2A	06/05/2001	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	9		UG/L	116	126	6	X
MW-168	W168M1A	06/04/2001	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	6.7		UG/L	174	184	6	X
MW-168	W168M1A	06/06/2003	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	6.8	J	UG/L	174	184	6	X
MW-17	W17SSD	11/10/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	120	J	UG/L	0	10	6	X
MW-17	W17DDA	11/11/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	42		UG/L	196	206	6	X
MW-18	W18SSA	10/10/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	36		UG/L	0	10	6	X
MW-18	W18DDA	09/10/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	11		UG/L	222	232	6	X
MW-188	W188M1A	01/30/2002	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	9.4		UG/L	41.1	51.1	6	X
MW-19	W19DDA	03/04/1998	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	7		UG/L	254	259	6	X
MW-196	W196M1A	02/06/2002	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	10	J	UG/L	12	17	6	X
MW-198	W198M1A	10/31/2002	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	14		UG/L	127.8	132.8	6	X
MW-2	W02M2A	01/20/1998	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	24		UG/L	33	38	6	X
MW-2	W02M1A	01/21/1998	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	10	J	UG/L	75	80	6	X
MW-2	W02DDA	02/02/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	9		UG/L	218	223	6	X
MW-20	W20SSA	11/07/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	280		UG/L	0	10	6	X
MW-21	W21M2A	04/01/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	8		UG/L	58	68	6	X
MW-22	W22SSA	11/24/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	96		UG/L	0	10	6	X
MW-22	W22SSA	09/20/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	18		UG/L	0	10	6	X
MW-23	W23SSA	10/27/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	24		UG/L	0	10	6	X
MW-23	W23M3A	11/13/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	10		UG/L	34	39	6	X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-23	W23M3D	11/13/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	13		UG/L	34	39		6>X
MW-24	W24SSA	11/14/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	8		UG/L	0	10		6>X
MW-27	W27SSA	09/17/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	9		UG/L	0	10		6>X
MW-28	W28SSA	11/03/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	11		UG/L	0	10		6>X
MW-28	W28SSA	09/17/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	150	J	UG/L	0	10		6>X
MW-28	W28M1A	01/12/2001	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	9.7		UG/L	173	183		6>X
MW-29	W29SSA	11/03/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	16		UG/L	0	10		6>X
MW-29	W29SSA	09/17/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	20		UG/L	0	10		6>X
MW-36	W36M2A	08/17/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	8		UG/L	54	64		6>X
MW-38	W38M3A	05/06/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	15		UG/L	52	62		6>X
MW-4	W04SSA	11/04/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	30		UG/L	0	10		6>X
MW-41	W41M2A	11/12/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	7		UG/L	67	77		6>X
MW-43	W43M1A	05/26/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	6		UG/L	90	100		6>X
MW-44	W44M1A	09/20/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	14		UG/L	53	63		6>X
MW-45	W45M1A	05/24/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	37		UG/L	98	108		6>X
MW-46	W46M1A	11/01/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	6	J	UG/L	103	113		6>X
MW-46	W46DDA	11/02/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	14	J	UG/L	136	146		6>X
MW-47	W47M2D	02/05/2003	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	9.6	J	UG/L	38	48		6>X
MW-47	W47M1A	08/24/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	14		UG/L	75	85		6>X
MW-47	W47DDA	08/24/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	16		UG/L	100	110		6>X
MW-49	W49SSA	03/01/2000	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	290		UG/L	0	10		6>X
MW-5	W05DDA	02/13/1998	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	9	J	UG/L	223	228		6>X
MW-52	W52M3A	08/27/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	7	J	UG/L	59	64		6>X
MW-53	W53M1A	08/30/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	31		UG/L	99	109		6>X
MW-53	W53DDA	02/18/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	18		UG/L	158	168		6>X
MW-55	W55DDA	05/13/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	8		UG/L	119	129		6>X
MW-55	W55DDA	07/31/2001	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	6.4		UG/L	119	129		6>X
MW-57	W57SSA	12/21/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	3300	J	UG/L	0	10		6>X
MW-57	W57M2A	06/30/2000	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	7		UG/L	62	72		6>X
MW-57	W57DDA	12/13/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	95		UG/L	127	137		6>X
MW-7	W07SSA	10/31/1997	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	10		UG/L	0	10		6>X
MW-70	W70M1A	10/27/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	10		UG/L	129	139		6>X
MW-82	W82DDA	08/22/2001	SW8270	BIS(2-ETHYLHEXYL) PHTHALATE	24		UG/L	97	107		6>X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-84	W84DDA	03/03/2000	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	30		UG/L	153	163		6X
RW-1	WRW1XA	02/18/1998	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	59		UG/L	0	9		6X
RW-1	WRW1XD	10/06/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	11	J	UG/L	0	9		6X
XX95-14	W9514A	09/28/1999	OC21B	BIS(2-ETHYLHEXYL) PHTHALATE	22		UG/L	90	100		6X
MW-52	W52M3L	08/27/1999	IM40MB	CADMIUM	12.2		UG/L	59	64		5X
02-12	W02-12M1A	06/12/2002	OC21V	CHLOROMETHANE	4		UG/L	58.35	68.35		3X
LRMW0003	LRMW0003-A	05/17/2004	OC21VM	CHLOROMETHANE	33	J	UG/L	69.68	94.68		3X
MW-187	W187DDA	01/23/2002	OC21V	CHLOROMETHANE	75	J	UG/L	199.5	209.5		3X
MW-187	W187DDA	02/11/2002	OC21V	CHLOROMETHANE	47	J	UG/L	199.5	209.5		3X
MW-187	W187DDA	07/13/2004	OC21VM	CHLOROMETHANE	11		UG/L	199.5	209.5		3X
MW-80	W80M2A	04/08/2004	OC21VM	CHLOROMETHANE	7		UG/L	56	66		3X
MW-7	W07M1A	09/07/1999	IM40MB	CHROMIUM, TOTAL	114		UG/L	135	140		100X
PPAWSMW-1	PPAWSMW-1	06/22/1999	OL21P	DIELDRIN	3		UG/L	0	10		0.5X
58MW0001	58MW0001	05/29/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.8		UG/L	0	5		2X
58MW0001	58MW0001	08/29/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	0	5		2X
58MW0001	58MW0001-D	08/29/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	0	5		2X
58MW0001	58MW0001	01/11/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6		UG/L	0	5		2X
58MW0001	58MW0001	05/31/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4		UG/L	0	5		2X
58MW0001	58MW0001-A	09/13/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4		UG/L	0	5		2X
58MW0001	58MW0001-A	12/06/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.2		UG/L	0	5		2X
58MW0001	58MW0001-A	08/08/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	0	5		2X
58MW0001	58MW0001-A	11/18/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.9		UG/L	0	5		2X
58MW0001	58MW0001-A	06/22/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.7		UG/L	0	5		2X
58MW0002	WC2XXA	02/26/1998	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	19		UG/L	0	5		2X
58MW0002	WC2XXA	01/14/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	20		UG/L	0	5		2X
58MW0002	WC2XXA	10/08/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.8		UG/L	0	5		2X
58MW0002	58MW0002	05/23/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	0	5		2X
58MW0002	58MW0002	09/19/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	15		UG/L	0	5		2X
58MW0002	58MW0002	12/14/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	15		UG/L	0	5		2X
58MW0002	58MW0002	05/31/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	16		UG/L	0	5		2X
58MW0002	58MW0002-A	09/11/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	0	5		2X
58MW0002	58MW0002-A	12/05/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	0	5		2X
58MW0002	58MW0002-A	10/10/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	20		UG/L	0	5		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
58MW0002	58MW0002-A	03/02/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	21		UG/L	0	5		2X
58MW0002	58MW0002-A	04/28/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	18		UG/L	0	5		2X
58MW0009E	WC9EXA	10/02/1997	8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.7		UG/L	6.5	11.5		2X
58MW0009E	WC9EXA	01/26/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	17		UG/L	6.5	11.5		2X
58MW0009E	WC9EXA	09/28/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	18		UG/L	6.5	11.5		2X
58MW0009E	WC9EXD	09/28/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	18		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E	05/23/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.4		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E	08/29/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E	12/11/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E	06/03/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E-A	08/26/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E-A	12/09/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	10		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E-A	07/03/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E-D	07/03/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E-A	11/18/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E-A	03/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.6		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E-D	03/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.8		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E-A	05/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.1		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E-A	08/24/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.5		UG/L	6.5	11.5		2X
58MW0009E	58MW0009E-D	08/24/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.6		UG/L	6.5	11.5		2X
58MW0011D	58MW0011D	05/24/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.3		UG/L	49.5	54.5		2X
58MW0011D	58MW0011D	09/26/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.5		UG/L	49.5	54.5		2X
58MW0011D	58MW0011D	12/11/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.1		UG/L	49.5	54.5		2X
58MW0011D	58MW0011D	06/03/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.5		UG/L	49.5	54.5		2X
58MW0011D	58MW0011D-A	08/27/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6		UG/L	49.5	54.5		2X
58MW0011D	58MW0011D-A	12/09/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.4		UG/L	49.5	54.5		2X
58MW0011D	58MW0011D-A	06/09/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	49.5	54.5		2X
58MW0016	58MW0016C	08/30/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.8		UG/L	0	10		2X
58MW0016	58MW0016C	12/11/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4		UG/L	0	10		2X
58MW0016	58MW0016C	06/04/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	0	10		2X
58MW0016	58MW0016C-A	11/24/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	0	10		2X
58MW0016	58MW0016C-D	11/24/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.4		UG/L	0	10		2X
58MW0016	58MW0016C-A	04/30/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4		UG/L	0	10		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
58MW0016	58MW0016B	08/30/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3		UG/L	28.5	38.5		2X
58MW0018	58MW0018B	12/13/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	34.55	44.55		2X
90MW0022	WF22XA	01/26/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.8		UG/L	72.79	77.79		2X
90MW0022	WF22XA	02/16/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.4		UG/L	72.79	77.79		2X
90MW0022	WF22XA	09/30/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.2		UG/L	72.79	77.79		2X
90MW0041	90MW0041-D	01/13/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.4		UG/L	31.5	36.5		2X
90MW0054	90MW0054	12/08/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	91.83	96.83		2X
90MW0054	90MW0054	04/20/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.7		UG/L	91.83	96.83		2X
90MW0054	90MW0054-A	09/12/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.9		UG/L	91.83	96.83		2X
90MW0054	90MW0054-A	12/30/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.5		UG/L	91.83	96.83		2X
90MW0054	90MW0054-A	05/01/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	91.83	96.83		2X
90MW0054	90MW0054-A	10/04/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.2		UG/L	91.83	96.83		2X
90MW0054	90MW0054-D	10/04/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.2		UG/L	91.83	96.83		2X
90MW0054	90MW0054-A	02/18/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	91.83	96.83		2X
90MW0054	90MW0054-A	05/17/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	91.83	96.83		2X
90WT0013	WF13XA	01/16/1998	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.2	J	UG/L	0	10		2X
MW-1	W01SSA	09/30/1997	8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	0	10		2X
MW-1	W01SSD	09/30/1997	8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	0	10		2X
MW-1	W01SSA	02/22/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.8		UG/L	0	10		2X
MW-1	W01SSA	09/07/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	0	10		2X
MW-1	W01SSA	05/31/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1	J	UG/L	0	10		2X
MW-1	W01SSA	07/31/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.8	J	UG/L	0	10		2X
MW-1	W01SSA	11/18/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.2		UG/L	0	10		2X
MW-1	W01SSA	12/12/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.1	J	UG/L	0	10		2X
MW-1	W01SSD	12/12/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.4		UG/L	0	10		2X
MW-1	W01SSA	08/16/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.3		UG/L	0	10		2X
MW-1	W01SSA	01/10/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.2	J	UG/L	0	10		2X
MW-1	W01SSA	05/14/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	0	10		2X
MW-1	W01SSA	11/14/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	0	10		2X
MW-1	W01SSA	02/25/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	0	10		2X
MW-1	W01MMA	09/29/1997	8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6		UG/L	44	49		2X
MW-1	W01M2A	03/01/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	44	49		2X
MW-1	W01M2A	05/10/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.9		UG/L	44	49		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-1	W01M2A	07/31/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.4	J	UG/L	44	49		2X
MW-1	W01M2A	11/18/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.1		UG/L	44	49		2X
MW-1	W01M2D	11/18/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8		UG/L	44	49		2X
MW-1	W01M2A	05/01/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.8		UG/L	44	49		2X
MW-1	W01M2A	08/15/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	44	49		2X
MW-1	W01M2A	11/30/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.9		UG/L	44	49		2X
MW-1	W01M2A	05/22/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	44	49		2X
MW-1	W01M2A	01/15/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.2		UG/L	44	49		2X
MW-1	W01M2A	05/13/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.7		UG/L	44	49		2X
MW-1	W01M2A	11/17/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.4		UG/L	44	49		2X
MW-1	W01M2A	02/25/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.8		UG/L	44	49		2X
MW-100	W100M1A	06/06/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.3		UG/L	45	55		2X
MW-100	W100M1D	06/06/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.3		UG/L	45	55		2X
MW-100	W100M1A	10/02/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.9		UG/L	45	55		2X
MW-100	W100M1A	01/27/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.9		UG/L	45	55		2X
MW-100	W100M1A	10/23/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.9		UG/L	45	55		2X
MW-100	W100M1D	10/23/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.9		UG/L	45	55		2X
MW-100	W100M1A	11/27/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3		UG/L	45	55		2X
MW-100	W100M1A	05/21/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	45	55		2X
MW-100	W100M1A	09/24/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	45	55		2X
MW-101	W101M1A	06/06/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	27	37		2X
MW-101	W101M1A	10/23/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	27	37		2X
MW-101	W101M1A	11/27/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4		UG/L	27	37		2X
MW-101	W101M1A	05/21/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	27	37		2X
MW-101	W101M1A	09/19/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.8		UG/L	27	37		2X
MW-101	W101M1A	11/21/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	27	37		2X
MW-101	W101M1A	02/26/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	27	37		2X
MW-101	W101M1D	02/26/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	27	37		2X
MW-101	W101M1A	05/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.9		UG/L	27	37		2X
MW-101	W101M1A	09/24/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	27	37		2X
MW-105	W105M1A	06/21/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.9		UG/L	78	88		2X
MW-105	W105M1A	11/07/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.9		UG/L	78	88		2X
MW-105	W105M1A	01/27/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	78	88		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-105	W105M1A	10/22/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1	J	UG/L	78	88		2X
MW-105	W105M1A	11/26/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	78	88		2X
MW-105	W105M1A	05/21/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3		UG/L	78	88		2X
MW-107	W107M2A	06/21/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4		UG/L	5	15		2X
MW-107	W107M2A	11/07/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	5	15		2X
MW-107	W107M2A	10/22/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.4		UG/L	5	15		2X
MW-107	W107M2A	11/29/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2	J	UG/L	5	15		2X
MW-107	W107M2D	11/29/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2	J	UG/L	5	15		2X
MW-107	W107M2A	09/12/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	5	15		2X
MW-107	W107M2A	11/22/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.8		UG/L	5	15		2X
MW-107	W107M2A	04/09/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2	J	UG/L	5	15		2X
MW-107	W107M2A	03/02/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.4		UG/L	5	15		2X
MW-107	W107M2A	04/26/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	5	15		2X
MW-111	W111M3A	10/10/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	33	43		2X
MW-112	W112M2A	04/25/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	26	36		2X
MW-112	W112M2A	10/30/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	26	36		2X
MW-112	W112M2A	02/19/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	26	36		2X
MW-113	W113M2A	09/26/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.2		UG/L	48	58		2X
MW-113	W113M2A	01/15/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	48	58		2X
MW-113	W113M2A	04/30/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	15		UG/L	48	58		2X
MW-113	W113M2A	12/03/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	48	58		2X
MW-113	W113M2A	05/09/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7		UG/L	48	58		2X
MW-113	W113M2A	09/17/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.5		UG/L	48	58		2X
MW-113	W113M2A	11/26/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.2		UG/L	48	58		2X
MW-113	W113M2A	04/30/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.9		UG/L	48	58		2X
MW-113	W113M2D	04/30/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5		UG/L	48	58		2X
MW-113	W113M2A	11/18/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.6		UG/L	48	58		2X
MW-113	W113M2A	02/19/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.6		UG/L	48	58		2X
MW-113	W113M2D	02/19/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.3		UG/L	48	58		2X
MW-113	W113M2A	04/27/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.5		UG/L	48	58		2X
MW-113	W113M2A	08/10/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.4		UG/L	48	58		2X
MW-114	W114M2A	10/24/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	140		UG/L	39	49		2X
MW-114	W114M2D	10/24/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	140		UG/L	39	49		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-114	W114M2A	03/14/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	120	J	UG/L	39	49		2X
MW-114	W114M2A	06/19/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	140		UG/L	39	49		2X
MW-114	W114M2A	01/07/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	170		UG/L	39	49		2X
MW-114	W114M2A	05/29/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	190		UG/L	39	49		2X
MW-114	W114M2A	08/09/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	210		UG/L	39	49		2X
MW-114	W114M2A	11/13/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	220		UG/L	39	49		2X
MW-114	W114M2A	05/27/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	200		UG/L	39	49		2X
MW-114	W114M2A	10/01/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	220		UG/L	39	49		2X
MW-114	W114M2A	02/09/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	210		UG/L	39	49		2X
MW-114	W114M2A	04/19/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	180		UG/L	39	49		2X
MW-114	W114M2A	07/30/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	160		UG/L	39	49		2X
MW-114	W114M1A	03/14/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2J		UG/L	96	106		2X
MW-114	W114M1A	12/21/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	96	106		2X
MW-114	W114M1A	06/21/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	96	106		2X
MW-114	W114M1A	08/09/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	96	106		2X
MW-129	W129M2A	12/21/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	10		UG/L	46	56		2X
MW-129	W129M2A	06/27/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.6		UG/L	46	56		2X
MW-129	W129M2D	06/27/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.9		UG/L	46	56		2X
MW-129	W129M2A	07/10/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.9		UG/L	46	56		2X
MW-129	W129M2A	08/19/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.4		UG/L	46	56		2X
MW-129	W129M2A	11/13/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13J		UG/L	46	56		2X
MW-129	W129M2D	11/13/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	46	56		2X
MW-129	W129M2A	03/24/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	46	56		2X
MW-129	W129M2A	10/02/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.8		UG/L	46	56		2X
MW-129	W129M2A	02/10/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.8		UG/L	46	56		2X
MW-129	W129M2A	04/07/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	46	56		2X
MW-129	W129M2A	08/06/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.8		UG/L	46	56		2X
MW-129	W129M1A	02/10/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	66	76		2X
MW-129	W129M1A	04/07/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	66	76		2X
MW-132	W132SSA	11/09/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5J		UG/L	0	10		2X
MW-132	W132SSA	02/16/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.4J		UG/L	0	10		2X
MW-132	W132SSA	12/12/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.8		UG/L	0	10		2X
MW-147	W147M2A	02/23/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3		UG/L	77	87		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-147	W147M2A	10/24/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.9		UG/L	77	87		2X
MW-147	W147M2A	04/29/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3		UG/L	77	87		2X
MW-147	W147M2D	04/29/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3		UG/L	77	87		2X
MW-147	W147M1A	02/23/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	94	104		2X
MW-147	W147M1A	06/19/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	94	104		2X
MW-147	W147M1A	04/29/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	94	104		2X
MW-147	W147M1A	09/05/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	94	104		2X
MW-153	W153M1A	03/23/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.2		UG/L	108	118		2X
MW-153	W153M1A	07/24/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.8		UG/L	108	118		2X
MW-153	W153M1A	10/24/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.8		UG/L	108	118		2X
MW-153	W153M1A	04/26/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.7	J	UG/L	108	118		2X
MW-153	W153M1A	09/30/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.5		UG/L	108	118		2X
MW-153	W153M1A	12/02/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.8		UG/L	108	118		2X
MW-153	W153M1A	06/24/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3		UG/L	108	118		2X
MW-153	W153M1A	10/30/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.4		UG/L	108	118		2X
MW-153	W153M1A	12/19/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.3		UG/L	108	118		2X
MW-153	W153M1A	06/14/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	108	118		2X
MW-153	W153M1A	09/23/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.5		UG/L	108	118		2X
MW-16	W16SSA	10/03/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.8		UG/L	0	10		2X
MW-160	W160SSA	01/23/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2	J	UG/L	5	15		2X
MW-163	W163SSA	06/14/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.7		UG/L	0	10		2X
MW-163	W163SSA	10/10/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.8		UG/L	0	10		2X
MW-163	W163SSA	02/05/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.1		UG/L	0	10		2X
MW-163	W163SSA	03/07/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.2		UG/L	0	10		2X
MW-163	W163SSA	07/02/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	0	10		2X
MW-163	W163SSA	01/08/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	0	10		2X
MW-163	W163SSA	03/27/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6	J	UG/L	0	10		2X
MW-163	W163SSA	11/04/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.1		UG/L	0	10		2X
MW-163	W163SSA	02/13/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	0	10		2X
MW-164	W164M2A	05/25/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	49	59		2X
MW-164	W164M2A	08/21/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8		UG/L	49	59		2X
MW-164	W164M2A	01/17/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6		UG/L	49	59		2X
MW-164	W164M2A	06/20/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.1		UG/L	49	59		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-164	W164M2A	09/05/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.9		UG/L	49	59		2 X
MW-164	W164M2D	09/05/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7		UG/L	49	59		2 X
MW-164	W164M2A	01/08/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.8	J	UG/L	49	59		2 X
MW-164	W164M2A	06/06/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.9		UG/L	49	59		2 X
MW-165	W165M2A	05/08/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	60		UG/L	46	56		2 X
MW-165	W165M2A	08/16/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	50		UG/L	46	56		2 X
MW-165	W165M2A	01/07/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	27	J	UG/L	46	56		2 X
MW-165	W165M2A	04/18/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	26		UG/L	46	56		2 X
MW-165	W165M2A	08/10/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	23		UG/L	46	56		2 X
MW-165	W165M2A	11/26/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	19		UG/L	46	56		2 X
MW-165	W165M2A	03/27/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	35		UG/L	46	56		2 X
MW-165	W165M2A	09/11/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	46	56		2 X
MW-165	W165M2D	09/11/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	46	56		2 X
MW-165	W165M2A	03/01/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	46	56		2 X
MW-165	W165M2D	03/01/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	46	56		2 X
MW-165	W165M2A	04/09/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	10		UG/L	46	56		2 X
MW-165	W165M2A	08/06/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	10		UG/L	46	56		2 X
MW-166	W166M3A	06/01/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	19	29		2 X
MW-166	W166M3A	10/04/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.9		UG/L	19	29		2 X
MW-166	W166M3A	01/17/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	19	29		2 X
MW-166	W166M3A	07/02/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	19	29		2 X
MW-166	W166M1A	05/31/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.7		UG/L	112	117		2 X
MW-166	W166M1A	10/04/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.4		UG/L	112	117		2 X
MW-166	W166M1A	01/16/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	112	117		2 X
MW-166	W166M1A	07/01/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	112	117		2 X
MW-166	W166M1A	11/11/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.8		UG/L	112	117		2 X
MW-166	W166M1A	02/20/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6		UG/L	112	117		2 X
MW-166	W166M1A	06/29/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.2		UG/L	112	117		2 X
MW-171	W171M2A	05/31/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	83	88		2 X
MW-171	W171M2A	12/21/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	83	88		2 X
MW-176	W176M1A	10/08/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	158.55	168.55		2 X
MW-176	W176M1A	01/09/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3		UG/L	158.55	168.55		2 X
MW-176	W176M1A	07/12/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5		UG/L	158.55	168.55		2 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-176	W176M1A	08/10/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.3		UG/L	158.55	168.55	2X	
MW-176	W176M1D	08/10/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.4		UG/L	158.55	168.55	2X	
MW-178	W178M1A	10/31/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.8		UG/L	117	127	2X	
MW-178	W178M1A	03/08/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6	J	UG/L	117	127	2X	
MW-178	W178M1A	07/26/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.3		UG/L	117	127	2X	
MW-178	W178M1A	01/13/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	117	127	2X	
MW-178	W178M1A	06/10/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	117	127	2X	
MW-178	W178M1A	11/17/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	117	127	2X	
MW-178	W178M1A	12/24/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.8		UG/L	117	127	2X	
MW-178	W178M1A	05/19/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	117	127	2X	
MW-178	W178M1D	05/19/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.5		UG/L	117	127	2X	
MW-178	W178M1A	08/12/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4		UG/L	117	127	2X	
MW-184	W184M1A	01/24/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	23		UG/L	58.2	68.2	2X	
MW-184	W184M1A	06/21/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	24		UG/L	58.2	68.2	2X	
MW-184	W184M1A	09/18/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	24		UG/L	58.2	68.2	2X	
MW-184	W184M1D	09/18/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	24		UG/L	58.2	68.2	2X	
MW-184	W184M1A	05/21/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	24		UG/L	58.2	68.2	2X	
MW-184	W184M1D	05/21/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	24		UG/L	58.2	68.2	2X	
MW-184	W184M1A	10/30/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	22		UG/L	58.2	68.2	2X	
MW-184	W184M1A	02/09/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	21		UG/L	58.2	68.2	2X	
MW-184	W184M1A	05/18/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	19		UG/L	58.2	68.2	2X	
MW-184	W184M1A	08/10/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	19		UG/L	58.2	68.2	2X	
MW-19	W19SSA	03/05/1998	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	190		UG/L	0	10	2X	
MW-19	W19S2A	07/20/1998	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	260		UG/L	0	10	2X	
MW-19	W19S2D	07/20/1998	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	260		UG/L	0	10	2X	
MW-19	W19SSA	02/12/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	250		UG/L	0	10	2X	
MW-19	W19SSA	09/10/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	240		UG/L	0	10	2X	
MW-19	W19SSA	05/12/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	150	J	UG/L	0	10	2X	
MW-19	W19SSA	05/23/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	160		UG/L	0	10	2X	
MW-19	W19SSA	08/08/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	290		UG/L	0	10	2X	
MW-19	W19SSA	12/08/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	200		UG/L	0	10	2X	
MW-19	W19SSA	06/18/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	200		UG/L	0	10	2X	
MW-19	W19SSD	06/18/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	210		UG/L	0	10	2X	

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-19	W19SSA	08/24/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	120		UG/L	0	10		2X
MW-19	W19SSA	12/27/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	120		UG/L	0	10		2X
MW-19	W19SSA	05/29/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	120		UG/L	0	10		2X
MW-19	W19SSA	08/07/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	99		UG/L	0	10		2X
MW-19	W19SSA	09/27/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	80		UG/L	0	10		2X
MW-19	W19SSA	02/28/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	65		UG/L	0	10		2X
MW-19	W19SSA	06/01/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	73		UG/L	0	10		2X
MW-191	W191M2A	01/25/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1	J	UG/L	8.4	18.4		2X
MW-196	W196SSA	07/12/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.6	J	UG/L	0	5		2X
MW-196	W196SSA	10/24/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4	J	UG/L	0	5		2X
MW-196	W196SSA	08/12/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6	J	UG/L	0	5		2X
MW-198	W198M4A	02/21/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	48.4	53.4		2X
MW-198	W198M4A	07/19/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7		UG/L	48.4	53.4		2X
MW-198	W198M4A	11/01/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.9		UG/L	48.4	53.4		2X
MW-198	W198M4A	12/05/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.9		UG/L	48.4	53.4		2X
MW-198	W198M4A	11/05/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	48.4	53.4		2X
MW-198	W198M4A	02/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.9		UG/L	48.4	53.4		2X
MW-198	W198M4A	05/26/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.7		UG/L	48.4	53.4		2X
MW-198	W198M3A	02/15/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	15		UG/L	78.5	83.5		2X
MW-198	W198M3A	07/22/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	10		UG/L	78.5	83.5		2X
MW-198	W198M3A	11/06/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.8		UG/L	78.5	83.5		2X
MW-198	W198M3A	12/05/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.8		UG/L	78.5	83.5		2X
MW-198	W198M3A	06/04/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	15		UG/L	78.5	83.5		2X
MW-198	W198M3A	11/05/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	20		UG/L	78.5	83.5		2X
MW-198	W198M3D	11/05/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	20		UG/L	78.5	83.5		2X
MW-198	W198M3A	02/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	78.5	83.5		2X
MW-198	W198M3A	05/27/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	78.5	83.5		2X
MW-198	W198M2A	02/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	98.4	103.4		2X
MW-198	W198M2A	05/27/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	98.4	103.4		2X
MW-2	W02M2A	01/20/1998	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	33	38		2X
MW-2	W02M2A	02/03/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.8		UG/L	33	38		2X
MW-2	W02M2A	09/03/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.8		UG/L	33	38		2X
MW-2	W02M2A	05/11/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3	J	UG/L	33	38		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-2	W02M2A	08/02/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	33	38		2X
MW-2	W02M2A	11/27/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	33	38		2X
MW-2	W02M2A	05/03/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	33	38		2X
MW-2	W02M2A	08/21/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.5		UG/L	33	38		2X
MW-2	W02M2A	11/19/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6		UG/L	33	38		2X
MW-2	W02M2A	05/01/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4J		UG/L	33	38		2X
MW-2	W02M2A	09/16/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	33	38		2X
MW-2	W02M2A	01/16/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	33	38		2X
MW-2	W02M2D	01/16/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	33	38		2X
MW-2	W02M2A	07/18/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	33	38		2X
MW-2	W02M2A	11/19/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	33	38		2X
MW-2	W02M2A	02/27/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.5J		UG/L	33	38		2X
MW-2	W02M2A	04/26/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.7		UG/L	33	38		2X
MW-2	W02M1A	08/02/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	75	80		2X
MW-201	W201M2A	03/13/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1J		UG/L	86.9	96.9		2X
MW-201	W201M2A	07/18/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.4		UG/L	86.9	96.9		2X
MW-201	W201M2A	11/08/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.7		UG/L	86.9	96.9		2X
MW-201	W201M2D	11/08/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.8		UG/L	86.9	96.9		2X
MW-201	W201M2A	06/03/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.4		UG/L	86.9	96.9		2X
MW-201	W201M2D	06/03/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.4		UG/L	86.9	96.9		2X
MW-201	W201M2A	09/02/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	86.9	96.9		2X
MW-201	W201M2A	01/20/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3		UG/L	86.9	96.9		2X
MW-201	W201M2A	07/23/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.5		UG/L	86.9	96.9		2X
MW-201	W201M2A	08/10/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	86.9	96.9		2X
MW-203	W203M2A	02/26/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	32.58	42.58		2X
MW-204	W204M2A	07/29/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.6		UG/L	17.2	27.2		2X
MW-204	W204M2A	10/31/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.4		UG/L	17.2	27.2		2X
MW-204	W204M1A	04/10/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.6		UG/L	81	91		2X
MW-204	W204M1A	07/29/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.3		UG/L	81	91		2X
MW-204	W204M1D	07/29/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6		UG/L	81	91		2X
MW-204	W204M1A	10/31/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8		UG/L	81	91		2X
MW-204	W204M1A	06/26/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.1		UG/L	81	91		2X
MW-204	W204M1A	09/02/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.5		UG/L	81	91		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-204	W204M1A	01/21/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.7		UG/L	81	91		2 X
MW-204	W204M1A	04/27/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.7		UG/L	81	91		2 X
MW-204	W204M1A	09/07/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.8		UG/L	81	91		2 X
MW-206	W206M1A	07/18/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	19.57	29.57		2 X
MW-206	W206M1A	10/15/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	19.57	29.57		2 X
MW-206	W206M1A	02/05/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.3		UG/L	19.57	29.57		2 X
MW-206	W206M1A	02/03/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.4		UG/L	19.57	29.57		2 X
MW-206	W206M1A	03/09/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5		UG/L	19.57	29.57		2 X
MW-206	W206M1A	05/19/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.2		UG/L	19.57	29.57		2 X
MW-206	W206M1D	05/19/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	19.57	29.57		2 X
MW-207	W207M1A	04/16/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	18		UG/L	100.52	110.52		2 X
MW-207	W207M1A	07/26/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	18		UG/L	100.52	110.52		2 X
MW-207	W207M1D	07/26/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	18		UG/L	100.52	110.52		2 X
MW-207	W207M1A	10/18/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	18		UG/L	100.52	110.52		2 X
MW-207	W207M1A	06/05/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	100.52	110.52		2 X
MW-207	W207M1A	10/15/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	10		UG/L	100.52	110.52		2 X
MW-207	W207M1A	02/12/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	100.52	110.52		2 X
MW-207	W207M1A	05/03/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	100.52	110.52		2 X
MW-207	W207M1A	08/13/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	100.52	110.52		2 X
MW-209	W209M1A	04/30/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	121	131		2 X
MW-209	W209M1A	07/26/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	121	131		2 X
MW-209	W209M1A	10/17/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.9		UG/L	121	131		2 X
MW-209	W209M1A	06/12/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.8		UG/L	121	131		2 X
MW-209	W209M1A	10/29/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.5		UG/L	121	131		2 X
MW-209	W209M1A	02/13/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.1		UG/L	121	131		2 X
MW-209	W209M1A	05/03/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.8		UG/L	121	131		2 X
MW-210	W210M2A	05/20/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.9		UG/L	54.69	64.69		2 X
MW-210	W210M2D	05/20/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	54.69	64.69		2 X
MW-210	W210M2A	08/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.9		UG/L	54.69	64.69		2 X
MW-215	W215M2A	08/01/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	98.9	108.9		2 X
MW-215	W215M2A	10/28/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	98.9	108.9		2 X
MW-215	W215M2A	03/03/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4J		UG/L	98.9	108.9		2 X
MW-215	W215M2A	07/06/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	98.9	108.9		2 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-215	W215M2D	07/06/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	98.9	108.9	2X	
MW-215	W215M2A	09/09/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	98.9	108.9	2X	
MW-215	W215M2D	09/09/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	98.9	108.9	2X	
MW-218	W218M2A	03/12/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.2		UG/L	93	98	2X	
MW-218	W218M2A	02/02/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	93	98	2X	
MW-218	W218M2A	03/15/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3		UG/L	93	98	2X	
MW-218	W218M2A	05/06/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	93	98	2X	
MW-223	W223M2A	11/05/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	93.31	103.31	2X	
MW-223	W223M2A	02/28/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.8	J	UG/L	93.31	103.31	2X	
MW-223	W223M2A	01/30/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	93.31	103.31	2X	
MW-223	W223M2A	03/12/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	93.31	103.31	2X	
MW-223	W223M2D	03/12/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	93.31	103.31	2X	
MW-227	W227M2A	08/06/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	56.38	66.38	2X	
MW-227	W227M2A	11/04/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.9	J	UG/L	56.38	66.38	2X	
MW-227	W227M2A	02/10/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9		UG/L	56.38	66.38	2X	
MW-227	W227M2A	02/03/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.2		UG/L	56.38	66.38	2X	
MW-227	W227M2A	03/16/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.4		UG/L	56.38	66.38	2X	
MW-227	W227M2A	05/13/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.4		UG/L	56.38	66.38	2X	
MW-227	W227M2A	09/21/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.9		UG/L	56.38	66.38	2X	
MW-227	W227M1A	02/10/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2	J	UG/L	76.38	86.38	2X	
MW-227	W227M1D	02/10/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3	J	UG/L	76.38	86.38	2X	
MW-227	W227M1A	02/03/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	76.38	86.38	2X	
MW-227	W227M1A	03/16/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.7	J	UG/L	76.38	86.38	2X	
MW-227	W227M1A	05/13/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.5		UG/L	76.38	86.38	2X	
MW-227	W227M1A	09/21/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	76.38	86.38	2X	
MW-23	W23M1A	11/07/1997	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3	J	UG/L	103	113	2X	
MW-23	W23M1A	03/18/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.4		UG/L	103	113	2X	
MW-23	W23M1D	03/18/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.7		UG/L	103	113	2X	
MW-23	W23M1A	09/13/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.1		UG/L	103	113	2X	
MW-23	W23M1A	05/12/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.6	J	UG/L	103	113	2X	
MW-23	W23M1A	08/08/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.3		UG/L	103	113	2X	
MW-23	W23M1A	12/04/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6		UG/L	103	113	2X	
MW-23	W23M1D	12/04/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.2		UG/L	103	113	2X	

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-23	W23M1A	04/27/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.9		UG/L	103	113		2X
MW-23	W23M1A	07/30/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.3		UG/L	103	113		2X
MW-23	W23M1A	12/06/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.3		UG/L	103	113		2X
MW-23	W23M1A	05/09/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.5		UG/L	103	113		2X
MW-23	W23M1D	05/09/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.5		UG/L	103	113		2X
MW-23	W23M1A	08/15/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5		UG/L	103	113		2X
MW-23	W23M1A	01/30/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.2		UG/L	103	113		2X
MW-23	W23M1A	04/07/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4		UG/L	103	113		2X
MW-23	W23M1A	10/07/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	103	113		2X
MW-23	W23M1A	02/12/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.5		UG/L	103	113		2X
MW-23	W23M1A	07/09/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.2		UG/L	103	113		2X
MW-23	W23M1A	08/30/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	103	113		2X
MW-234	W234M1A	05/12/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6		UG/L	25.3	35.3		2X
MW-234	W234M1D	05/12/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6		UG/L	25.3	35.3		2X
MW-234	W234M1A	08/02/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.5		UG/L	25.3	35.3		2X
MW-235	W235M1A	10/07/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.1		UG/L	25.3	35.3		2X
MW-235	W235M1D	10/07/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.2		UG/L	25.3	35.3		2X
MW-235	W235M1A	03/04/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11J		UG/L	25.3	35.3		2X
MW-235	W235M1A	06/27/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.5		UG/L	25.3	35.3		2X
MW-235	W235M1A	04/23/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	27		UG/L	25.3	35.3		2X
MW-235	W235M1A	05/21/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	30		UG/L	25.3	35.3		2X
MW-247	W247M2A	04/22/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	102.78	112.78		2X
MW-247	W247M2A	05/13/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3		UG/L	102.78	112.78		2X
MW-25	W25SSA	10/16/1997	8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	0	10		2X
MW-25	W25SSA	03/17/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	0	10		2X
MW-262	W262M1A	08/12/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	9.42	19.42		2X
MW-262	W262M1D	08/12/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3		UG/L	9.42	19.42		2X
MW-265	W265M2A	05/15/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	97.6	107.6		2X
MW-265	W265M2A	12/01/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.4		UG/L	97.6	107.6		2X
MW-265	W265M2A	03/03/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.5		UG/L	97.6	107.6		2X
MW-265	W265M2A	09/27/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	97.6	107.6		2X
MW-289	MW-289M2-	09/18/2003	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L				2X
MW-289	MW-289M2-FD	09/18/2003	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L				2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-289	MW-289M2-	03/31/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8		UG/L				2X
MW-289	MW-289M2-	07/29/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.9		UG/L	59.72	69.72		2X
MW-289	MW-289M2-FD	07/29/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.7		UG/L	59.72	69.72		2X
MW-289	MW-289M1-	09/18/2003	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	203	213		2X
MW-289	MW-289M1-	07/29/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	203	213		2X
MW-303	MW-303M3-	03/25/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3		UG/L				2X
MW-303	MW-303M2-	03/30/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	32		UG/L				2X
MW-303	MW-303M2-	08/12/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	28		UG/L	122.09	132.1		2X
MW-306	MW-306M2-	08/13/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.2		UG/L	40.69	50.69		2X
MW-306	MW-306M2-FD	08/13/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.5		UG/L	40.69	50.69		2X
MW-306	MW-306M2-	04/01/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.3		UG/L	41	51		2X
MW-306	MW-306M1-	04/01/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	61	71		2X
MW-31	W31SSA	07/15/1998	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	64		UG/L	13	18		2X
MW-31	W31SSA	02/01/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	210		UG/L	13	18		2X
MW-31	W31SSA	09/15/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	50		UG/L	13	18		2X
MW-31	W31SSA	05/15/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	110		UG/L	13	18		2X
MW-31	W31SSA	08/09/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	140		UG/L	13	18		2X
MW-31	W31SSA	12/08/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	120		UG/L	13	18		2X
MW-31	W31SSA	05/02/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	81		UG/L	13	18		2X
MW-31	W31SSA	08/24/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	88		UG/L	13	18		2X
MW-31	W31SSA	01/04/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	31		UG/L	13	18		2X
MW-31	W31SSA	05/29/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	130		UG/L	13	18		2X
MW-31	W31SSA	08/07/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	85		UG/L	13	18		2X
MW-31	W31SSA	11/15/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	13	18		2X
MW-31	W31SSA	03/28/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	86		UG/L	13	18		2X
MW-31	W31SSA	09/27/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	63		UG/L	13	18		2X
MW-31	W31SSD	09/27/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	62		UG/L	13	18		2X
MW-31	W31SSA	02/28/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	21		UG/L	13	18		2X
MW-31	W31SSA	05/11/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	72		UG/L	13	18		2X
MW-31	W31MMA	07/15/1998	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	280		UG/L	28	38		2X
MW-31	W31MMA	02/02/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	370		UG/L	28	38		2X
MW-31	W31MMA	09/15/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	29		UG/L	28	38		2X
MW-31	W31M1A	05/15/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	19		UG/L	28	38		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-31	W31M1A	08/09/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	28	38		2X
MW-31	W31MMA	05/23/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	70		UG/L	28	38		2X
MW-31	W31MMA	04/22/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.4		UG/L	28	38		2X
MW-31	W31MMD	04/22/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.2		UG/L	28	38		2X
MW-31	W31MMA	08/07/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.8		UG/L	28	38		2X
MW-31	W31MMA	11/15/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6		UG/L	28	38		2X
MW-31	W31MMA	03/27/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.1		UG/L	28	38		2X
MW-31	W31MMA	05/11/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	28	38		2X
MW-31	W31DDA	08/09/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	150		UG/L	48	53		2X
MW-323	W323M2A	04/19/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.7		UG/L	46.05	56.05		2X
MW-323	W323M2A	07/27/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.5		UG/L	46.05	56.05		2X
MW-323	W323M2D	07/27/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.6		UG/L	46.05	56.05		2X
MW-324	MW-324M2-	10/20/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	80.74	91.74		2X
MW-324	MW-324M2-	07/07/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	82	92		2X
MW-326	MW-326M2-	06/30/2004	SW8330	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L				2X
MW-34	W34M2A	02/19/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.2		UG/L	53	63		2X
MW-34	W34M2A	05/18/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.7		UG/L	53	63		2X
MW-34	W34M2A	08/10/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	53	63		2X
MW-34	W34M2A	11/17/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	53	63		2X
MW-34	W34M2A	11/12/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.9		UG/L	53	63		2X
MW-34	W34M2A	05/14/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.2		UG/L	53	63		2X
MW-34	W34M2A	08/05/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	53	63		2X
MW-34	W34M1A	05/17/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	73	83		2X
MW-34	W34M1A	08/11/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5		UG/L	73	83		2X
MW-34	W34M1A	11/17/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.5		UG/L	73	83		2X
MW-34	W34M1A	03/24/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.3		UG/L	73	83		2X
MW-34	W34M1A	11/12/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.9		UG/L	73	83		2X
MW-34	W34M1A	03/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	73	83		2X
MW-34	W34M1A	05/14/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.8		UG/L	73	83		2X
MW-34	W34M1A	08/05/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.7		UG/L	73	83		2X
MW-37	W37M3A	03/01/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	11	21		2X
MW-37	W37M2A	09/29/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.9		UG/L	26	36		2X
MW-37	W37M2A	12/29/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	26	36		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-37	W37M2A	03/27/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	26	36		2X
MW-37	W37M2A	08/31/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.8	J	UG/L	26	36		2X
MW-37	W37M2A	11/27/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	26	36		2X
MW-37	W37M2D	11/27/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	26	36		2X
MW-37	W37M2A	06/11/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4		UG/L	26	36		2X
MW-37	W37M2D	06/11/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4		UG/L	26	36		2X
MW-37	W37M2A	08/13/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6	J	UG/L	26	36		2X
MW-37	W37M2A	01/31/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.4		UG/L	26	36		2X
MW-37	W37M2A	04/10/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	26	36		2X
MW-37	W37M2A	10/01/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	26	36		2X
MW-37	W37M2A	03/01/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	26	36		2X
MW-38	W38M3A	05/06/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	52	62		2X
MW-38	W38M3A	08/18/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	52	62		2X
MW-38	W38M3A	11/10/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3		UG/L	52	62		2X
MW-38	W38M3A	05/16/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.9	J	UG/L	52	62		2X
MW-38	W38M3A	08/11/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	52	62		2X
MW-38	W38M3A	11/20/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	52	62		2X
MW-38	W38M3A	04/30/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3	J	UG/L	52	62		2X
MW-38	W38M3A	08/14/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	52	62		2X
MW-38	W38M3A	11/29/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1	J	UG/L	52	62		2X
MW-38	W38M3D	11/29/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2	J	UG/L	52	62		2X
MW-40	W40M1A	09/21/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.8		UG/L	13	23		2X
MW-40	W40M1D	09/21/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	13	23		2X
MW-40	W40M1A	12/30/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3	J	UG/L	13	23		2X
MW-40	W40M1A	04/14/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2	J	UG/L	13	23		2X
MW-40	W40M1A	09/01/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4	J	UG/L	13	23		2X
MW-40	W40M1A	11/27/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	13	23		2X
MW-40	W40M1A	06/02/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	13	23		2X
MW-40	W40M1A	08/16/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.9		UG/L	13	23		2X
MW-40	W40M1A	11/29/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1	J	UG/L	13	23		2X
MW-43	W43M2A	04/27/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	67	77		2X
MW-43	W43M2A	09/21/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	67	77		2X
MW-58	W58SSA	11/23/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.7	J	UG/L	0	10		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-58	W58SSA	02/15/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6		UG/L	0	10		2X
MW-58	W58SSA	05/11/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.4	J	UG/L	0	10		2X
MW-58	W58SSA	09/05/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.1		UG/L	0	10		2X
MW-58	W58SSA	12/20/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.1		UG/L	0	10		2X
MW-58	W58SSA	06/14/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.3		UG/L	0	10		2X
MW-58	W58SSA	08/22/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.4		UG/L	0	10		2X
MW-58	W58SSA	12/12/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.8		UG/L	0	10		2X
MW-73	W73SSA	07/09/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	50	J	UG/L	0	10		2X
MW-73	W73SSA	09/16/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	63		UG/L	0	10		2X
MW-73	W73SSA	11/02/1999	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	57		UG/L	0	10		2X
MW-73	W73SSA	06/02/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	44		UG/L	0	10		2X
MW-73	W73SSA	09/05/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	29		UG/L	0	10		2X
MW-73	W73SSA	11/14/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	28		UG/L	0	10		2X
MW-73	W73SSD	11/14/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	29		UG/L	0	10		2X
MW-73	W73SSA	06/14/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	22		UG/L	0	10		2X
MW-73	W73SSA	01/11/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	79		UG/L	0	10		2X
MW-73	W73SSA	08/20/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	34	J	UG/L	0	10		2X
MW-73	W73SSA	09/27/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	0	10		2X
MW-73	W73SSA	02/28/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	18		UG/L	0	10		2X
MW-73	W73SSA	06/01/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	0	10		2X
MW-76	W76SSA	01/20/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	18	28		2X
MW-76	W76SSA	05/02/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.5	J	UG/L	18	28		2X
MW-76	W76SSA	08/01/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	18	28		2X
MW-76	W76SSA	05/07/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	18	28		2X
MW-76	W76SSA	08/10/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.5		UG/L	18	28		2X
MW-76	W76SSA	12/28/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.9	J	UG/L	18	28		2X
MW-76	W76SSA	04/24/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	25		UG/L	18	28		2X
MW-76	W76SSA	08/20/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	31	J	UG/L	18	28		2X
MW-76	W76SSA	11/18/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	10		UG/L	18	28		2X
MW-76	W76SSA	09/27/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	18		UG/L	18	28		2X
MW-76	W76SSA	02/24/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	28		UG/L	18	28		2X
MW-76	W76SSA	04/21/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	18	28		2X
MW-76	W76SSA	08/11/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.5		UG/L	18	28		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-76	W76M2A	01/24/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	31		UG/L	38	48		2 X
MW-76	W76M2D	01/24/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	29		UG/L	38	48		2 X
MW-76	W76M2A	05/02/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	37	J	UG/L	38	48		2 X
MW-76	W76M2A	08/02/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	31		UG/L	38	48		2 X
MW-76	W76M2A	12/07/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	46		UG/L	38	48		2 X
MW-76	W76M2A	05/07/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	56		UG/L	38	48		2 X
MW-76	W76M2A	08/13/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	51		UG/L	38	48		2 X
MW-76	W76M2D	08/13/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	48		UG/L	38	48		2 X
MW-76	W76M2A	01/07/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	92		UG/L	38	48		2 X
MW-76	W76M2A	04/24/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	130		UG/L	38	48		2 X
MW-76	W76M2A	08/19/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	160	J	UG/L	38	48		2 X
MW-76	W76M2A	11/20/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	160		UG/L	38	48		2 X
MW-76	W76M2A	03/26/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	220		UG/L	38	48		2 X
MW-76	W76M2D	03/26/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	220		UG/L	38	48		2 X
MW-76	W76M2A	12/03/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	150		UG/L	38	48		2 X
MW-76	W76M2A	02/24/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	160		UG/L	38	48		2 X
MW-76	W76M2A	04/22/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	160		UG/L	38	48		2 X
MW-76	W76M2A	08/11/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	140		UG/L	38	48		2 X
MW-76	W76M1A	12/07/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.3		UG/L	58	68		2 X
MW-76	W76M1A	05/07/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	28		UG/L	58	68		2 X
MW-76	W76M1A	08/13/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	90		UG/L	58	68		2 X
MW-76	W76M1A	12/28/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	110		UG/L	58	68		2 X
MW-76	W76M1A	04/24/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	79		UG/L	58	68		2 X
MW-76	W76M1A	08/19/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14	J	UG/L	58	68		2 X
MW-76	W76M1A	11/18/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	58	68		2 X
MW-76	W76M1A	03/25/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	110		UG/L	58	68		2 X
MW-76	W76M1A	09/27/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	170		UG/L	58	68		2 X
MW-76	W76M1A	02/24/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	51		UG/L	58	68		2 X
MW-76	W76M1A	04/21/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	38		UG/L	58	68		2 X
MW-76	W76M1A	08/11/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	59		UG/L	58	68		2 X
MW-77	W77M2A	01/25/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	150		UG/L	38	48		2 X
MW-77	W77M2A	05/02/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	100	J	UG/L	38	48		2 X
MW-77	W77M2A	08/01/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	97	J	UG/L	38	48		2 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-77	W77M2A	12/07/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	93		UG/L	38	48		2X
MW-77	W77M2A	05/10/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	39		UG/L	38	48		2X
MW-77	W77M2A	08/10/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	29		UG/L	38	48		2X
MW-77	W77M2A	12/26/2001	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	26		UG/L	38	48		2X
MW-77	W77M2A	04/24/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.4		UG/L	38	48		2X
MW-77	W77M2A	08/07/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5		UG/L	38	48		2X
MW-77	W77M2A	11/19/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8		UG/L	38	48		2X
MW-77	W77M2A	03/26/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	10		UG/L	38	48		2X
MW-77	W77M2A	09/27/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	38	48		2X
MW-77	W77M2A	02/12/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	38	48		2X
MW-77	W77M2A	04/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	38	48		2X
MW-77	W77M2A	07/28/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	38	48		2X
MW-77	W77M2D	07/28/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	38	48		2X
MW-85	W85M1A	05/22/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	29		UG/L	22	32		2X
MW-85	W85M1A	02/10/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	24		UG/L	22	32		2X
MW-85	W85M1A	06/16/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	27		UG/L	22	32		2X
MW-85	W85M1A	09/26/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	22	32		2X
MW-85	W85M1A	12/15/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	19		UG/L	22	32		2X
MW-85	W85M1A	05/22/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7		UG/L	22	32		2X
MW-85	W85M1A	09/12/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.2		UG/L	22	32		2X
MW-85	W85M1A	04/01/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8		UG/L	22	32		2X
MW-85	W85M1A	03/02/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	22	32		2X
MW-85	W85M1D	03/02/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	22	32		2X
MW-86	W86SSA	04/28/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5	J	UG/L	1	11		2X
MW-86	W86SSA	08/16/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.7	J	UG/L	1	11		2X
MW-86	W86SSA	07/12/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	1	11		2X
MW-86	W86M2A	09/27/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3		UG/L	16	26		2X
MW-86	W86M2A	11/30/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	16	26		2X
MW-86	W86M2A	05/16/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	16	26		2X
MW-87	W87M1A	04/28/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.5	J	UG/L	62	72		2X
MW-87	W87M1A	09/14/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5		UG/L	62	72		2X
MW-87	W87M1A	01/10/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6		UG/L	62	72		2X
MW-87	W87M1A	09/27/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5		UG/L	62	72		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-87	W87M1A	12/03/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.2		UG/L	62	72		2X
MW-87	W87M1A	05/17/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.2		UG/L	62	72		2X
MW-87	W87M1A	10/04/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.4		UG/L	62	72		2X
MW-87	W87M1A	01/15/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.4		UG/L	62	72		2X
MW-87	W87M1A	04/07/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.1		UG/L	62	72		2X
MW-87	W87M1A	10/17/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	62	72		2X
MW-87	W87M1A	08/18/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	62	72		2X
MW-88	W88M2A	05/24/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7		UG/L	72	82		2X
MW-88	W88M2A	09/21/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.7		UG/L	72	82		2X
MW-88	W88M2A	01/10/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.8		UG/L	72	82		2X
MW-88	W88M2A	09/28/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.4		UG/L	72	82		2X
MW-88	W88M2A	12/04/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.5		UG/L	72	82		2X
MW-88	W88M2A	05/17/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.1		UG/L	72	82		2X
MW-88	W88M2A	10/04/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.6		UG/L	72	82		2X
MW-88	W88M2A	01/16/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.1		UG/L	72	82		2X
MW-88	W88M2A	04/02/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.5		UG/L	72	82		2X
MW-88	W88M2A	10/16/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.4		UG/L	72	82		2X
MW-88	W88M2A	01/22/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	72	82		2X
MW-88	W88M2A	04/27/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.7		UG/L	72	82		2X
MW-88	W88M2D	04/27/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.7		UG/L	72	82		2X
MW-88	W88M2A	08/20/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	72	82		2X
MW-89	W89M2A	05/26/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.3		UG/L	72	82		2X
MW-89	W89M2A	09/21/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.3		UG/L	72	82		2X
MW-89	W89M2A	01/11/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	7.5		UG/L	72	82		2X
MW-89	W89M2A	10/03/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.8		UG/L	72	82		2X
MW-89	W89M2D	10/03/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.9		UG/L	72	82		2X
MW-89	W89M2A	12/03/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.9		UG/L	72	82		2X
MW-89	W89M2A	05/17/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6		UG/L	72	82		2X
MW-89	W89M2A	10/04/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.6		UG/L	72	82		2X
MW-89	W89M2A	01/16/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.6		UG/L	72	82		2X
MW-89	W89M2A	04/17/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.7		UG/L	72	82		2X
MW-89	W89M2A	10/10/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.2		UG/L	72	82		2X
MW-89	W89M2A	01/23/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.8		UG/L	72	82		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-89	W89M2A	04/27/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.9		UG/L	72	82		2X
MW-89	W89M1A	09/28/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	92	102		2X
MW-89	W89M1A	12/04/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	92	102		2X
MW-89	W89M1A	05/17/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3		UG/L	92	102		2X
MW-89	W89M1A	10/10/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	92	102		2X
MW-90	W90SSA	05/19/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.4	J	UG/L	0	10		2X
MW-90	W90SSA	01/23/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	0	10		2X
MW-90	W90M1A	10/11/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	27	37		2X
MW-91	W91SSA	05/19/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	0	10		2X
MW-91	W91SSA	11/07/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	0	10		2X
MW-91	W91SSA	01/20/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	0	10		2X
MW-91	W91SSA	10/09/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	0	10		2X
MW-91	W91SSA	12/20/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	20		UG/L	0	10		2X
MW-91	W91SSA	05/20/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	17		UG/L	0	10		2X
MW-91	W91SSA	01/31/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	17		UG/L	0	10		2X
MW-91	W91SSA	05/21/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	0	10		2X
MW-91	W91SSA	11/14/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	16		UG/L	0	10		2X
MW-91	W91SSA	02/20/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13		UG/L	0	10		2X
MW-91	W91SSA	05/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	10		UG/L	0	10		2X
MW-91	W91M1A	05/22/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	18		UG/L	45	55		2X
MW-91	W91M1A	11/07/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	45	55		2X
MW-91	W91M1D	11/07/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	11		UG/L	45	55		2X
MW-91	W91M1A	01/20/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	45	55		2X
MW-91	W91M1A	10/03/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	13	J	UG/L	45	55		2X
MW-91	W91M1A	11/29/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	10	J	UG/L	45	55		2X
MW-91	W91M1A	05/20/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.3		UG/L	45	55		2X
MW-91	W91M1D	05/20/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.5		UG/L	45	55		2X
MW-91	W91M1A	09/27/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6		UG/L	45	55		2X
MW-91	W91M1A	01/31/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	45	55		2X
MW-91	W91M1A	05/19/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	45	55		2X
MW-91	W91M1A	11/14/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.7		UG/L	45	55		2X
MW-91	W91M1A	02/20/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6		UG/L	45	55		2X
MW-91	W91M1D	02/20/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.1		UG/L	45	55		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-91	W91M1A	05/05/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.6		UG/L	45	55		2X
MW-93	W93M2A	05/26/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.2		UG/L	16	26		2X
MW-93	W93M2A	11/07/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.2		UG/L	16	26		2X
MW-93	W93M2A	01/20/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1	J	UG/L	16	26		2X
MW-93	W93M2A	10/03/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	9.9		UG/L	16	26		2X
MW-93	W93M2A	11/28/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	12		UG/L	16	26		2X
MW-93	W93M2A	05/20/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.7		UG/L	16	26		2X
MW-93	W93M2A	09/27/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.5	J	UG/L	16	26		2X
MW-93	W93M2A	02/03/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	16	26		2X
MW-93	W93M2D	02/03/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.7		UG/L	16	26		2X
MW-93	W93M2A	03/28/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.2		UG/L	16	26		2X
MW-93	W93M2A	10/23/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2		UG/L	16	26		2X
MW-93	W93M2A	04/30/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	16	26		2X
MW-93	W93M2A	09/28/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3		UG/L	16	26		2X
MW-93	W93M1A	05/26/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2	J	UG/L	56	66		2X
MW-93	W93M1A	11/07/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	56	66		2X
MW-93	W93M1A	01/22/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4	J	UG/L	56	66		2X
MW-93	W93M1D	01/22/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	56	66		2X
MW-93	W93M1A	10/03/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.2		UG/L	56	66		2X
MW-93	W93M1A	11/28/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.8		UG/L	56	66		2X
MW-93	W93M1A	05/20/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.6		UG/L	56	66		2X
MW-93	W93M1A	09/24/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.9		UG/L	56	66		2X
MW-93	W93M1A	02/03/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.7		UG/L	56	66		2X
MW-93	W93M1A	03/31/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.8		UG/L	56	66		2X
MW-93	W93M1A	10/22/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.2		UG/L	56	66		2X
MW-93	W93M1A	02/09/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.2		UG/L	56	66		2X
MW-93	W93M1A	07/15/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.6		UG/L	56	66		2X
MW-93	W93M1D	07/15/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.5		UG/L	56	66		2X
MW-95	W95M1A	05/25/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	78	88		2X
MW-95	W95M1A	10/01/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	78	88		2X
MW-95	W95M1A	12/15/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.2		UG/L	78	88		2X
MW-95	W95M1A	05/20/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.1		UG/L	78	88		2X
MW-95	W95M1D	05/20/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.2		UG/L	78	88		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-95	W95M1A	09/27/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.4		UG/L	78	88		2X
MW-95	W95M1A	02/04/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.1		UG/L	78	88		2X
MW-95	W95M1A	04/11/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.5		UG/L	78	88		2X
MW-95	W95M1D	04/11/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	78	88		2X
MW-95	W95M1A	10/15/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.5		UG/L	78	88		2X
MW-95	W95M1A	02/20/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.1		UG/L	78	88		2X
MW-95	W95M1A	04/30/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.5		UG/L	78	88		2X
MW-95	W95M1A	08/27/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5.1		UG/L	78	88		2X
MW-98	W98M1A	05/25/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.1		UG/L	26	36		2X
MW-99	W99M1A	05/25/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.9		UG/L	60	70		2X
MW-99	W99M1D	05/25/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	6.9		UG/L	60	70		2X
MW-99	W99M1A	09/29/2000	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	5		UG/L	60	70		2X
MW-99	W99M1A	01/13/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.2		UG/L	60	70		2X
MW-99	W99M1A	06/02/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.4		UG/L	60	70		2X
MW-99	W99M1A	10/02/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.2		UG/L	60	70		2X
OW-1	WOW-1A	11/15/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	0	10		2X
OW-1	WOW-1A	05/21/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.2		UG/L	0	10		2X
OW-1	WOW-1D	05/21/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.5		UG/L	0	10		2X
OW-1	OW-1-A	09/04/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4		UG/L	0	10		2X
OW-1	OW-1-A	01/16/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	4.2		UG/L	0	10		2X
OW-1	OW-1-A	11/13/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3		UG/L	0	10		2X
OW-1	OW-1-A	03/02/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.6		UG/L	0	10		2X
OW-1	OW-1-A	09/28/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3.3		UG/L	0	10		2X
OW-2	WOW-2A	11/14/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	3		UG/L	48.78	58.78		2X
OW-2	WOW-2A	05/21/2002	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.2		UG/L	48.78	58.78		2X
OW-2	OW-2-A	08/30/2002	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	48.78	58.78		2X
OW-2	OW-2-A	01/23/2003	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	8.6		UG/L	48.78	58.78		2X
OW-2	OW-2-A	11/13/2003	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	14		UG/L	48.78	58.78		2X
OW-2	OW-2-A	03/02/2004	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	16		UG/L	48.78	58.78		2X
OW-2	OW-2-A	09/28/2004	8330NX	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	10		UG/L	48.78	58.78		2X
OW-6	WOW-6A	11/14/2001	8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-T	2.3		UG/L	46.8	56.8		2X
ASPWELL	ASPWELL	07/20/1999	E200.8	LEAD	53		UG/L				15X
ASPWELL	ASPWELL	12/12/2000	IM40PB	LEAD	20.9		UG/L				15X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
ASPWELL	ASPWELL	05/24/2001	IM40MB	LEAD	30.4		UG/L			15	X
MW-2	W02SSA	02/23/1998	IM40MB	LEAD	20.1		UG/L	0	10	15	X
MW-45	W45SSA	08/23/2001	IM40MB	LEAD	42.2		UG/L	0	10	15	X
MW-45	W45SSA	12/14/2001	IM40MB	LEAD	42.8		UG/L	0	10	15	X
MW-45	W45SSA	06/09/2003	IM40MB	LEAD	619		UG/L	0	10	15	X
MW-45	W45SSL	06/09/2003	IM40MB	LEAD	516		UG/L	0	10	15	X
MW-45	W45SSA	07/28/2003	IM40MB	LEAD	326		UG/L	0	10	15	X
MW-45	W45SSA	01/21/2004	IM40MB	LEAD	50.7		UG/L	0	10	15	X
MW-45	W45SSA	06/30/2004	IM40MBM	LEAD	35.2		UG/L	0	10	15	X
MW-7	W07M1A	09/07/1999	IM40MB	LEAD	40.2		UG/L	135	140	15	X
MW-7	W07M1D	09/07/1999	IM40MB	LEAD	18.3		UG/L	135	140	15	X
MW-45	W45SSA	06/09/2003	OC21V	METHYLENE CHLORIDE	5J		UG/L	0	10	5	X
MW-45	W45SSA	07/28/2003	OC21V	METHYLENE CHLORIDE	8J		UG/L	0	10	5	X
MW-2	W02SSA	02/23/1998	IM40MB	MOLYBDENUM	72.1		UG/L	0	10	40	X
MW-2	W02SSL	02/23/1998	IM40MB	MOLYBDENUM	63.3		UG/L	0	10	40	X
MW-46	W46M2A	03/30/1999	IM40MB	MOLYBDENUM	48.9		UG/L	56	66	40	X
MW-46	W46M2L	03/30/1999	IM40MB	MOLYBDENUM	51		UG/L	56	66	40	X
MW-47	W47M3A	03/29/1999	IM40MB	MOLYBDENUM	43.1		UG/L	21	31	40	X
MW-47	W47M3L	03/29/1999	IM40MB	MOLYBDENUM	40.5		UG/L	21	31	40	X
MW-52	W52M3A	04/07/1999	IM40MB	MOLYBDENUM	72.6		UG/L	59	64	40	X
MW-52	W52M3L	04/07/1999	IM40MB	MOLYBDENUM	67.6		UG/L	59	64	40	X
MW-52	W52DDA	04/02/1999	IM40MB	MOLYBDENUM	51.1		UG/L	218	228	40	X
MW-52	W52DDL	04/02/1999	IM40MB	MOLYBDENUM	48.9		UG/L	218	228	40	X
MW-53	W53M1A	05/03/1999	IM40MB	MOLYBDENUM	122		UG/L	99	109	40	X
MW-53	W53M1L	05/03/1999	IM40MB	MOLYBDENUM	132		UG/L	99	109	40	X
MW-53	W53M1A	08/30/1999	IM40MB	MOLYBDENUM	55.2		UG/L	99	109	40	X
MW-53	W53M1L	08/30/1999	IM40MB	MOLYBDENUM	54.1		UG/L	99	109	40	X
MW-53	W53M1A	11/05/1999	IM40MB	MOLYBDENUM	41.2		UG/L	99	109	40	X
MW-54	W54SSA	04/30/1999	IM40MB	MOLYBDENUM	56.7		UG/L	0	10	40	X
MW-54	W54SSL	04/30/1999	IM40MB	MOLYBDENUM	66.2		UG/L	0	10	40	X
MW-54	W54SSA	08/27/1999	IM40MB	MOLYBDENUM	61.4		UG/L	0	10	40	X
MW-54	W54M2A	08/27/1999	IM40MB	MOLYBDENUM	43.7		UG/L	59	69	40	X
MW-54	W54M2L	08/27/1999	IM40MB	MOLYBDENUM	43.2		UG/L	59	69	40	X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE_ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-41	W41M1A	05/18/2000	8151	PENTACHLOROPHENOL	1.8	J	UG/L	108	118		1 X
4036009DC	GLSKRNK-A	12/20/2002	E314.0	PERCHLORATE	5.26		UG/L				4 X
4036009DC	GLSKRNK-D	12/20/2002	E314.0	PERCHLORATE	5.51		UG/L				4 X
4036009DC	GLSKRNK-A	01/08/2003	E314.0	PERCHLORATE	6.06		UG/L				4 X
4036009DC	GLSKRNK-D	01/08/2003	E314.0	PERCHLORATE	5.99		UG/L				4 X
4036009DC	4036009DC-A	09/03/2003	E314.0	PERCHLORATE	4.15		UG/L				4 X
4036009DC	4036009DC-A	11/24/2003	E314.0	PERCHLORATE	4.88		UG/L				4 X
4036009DC	4036009DC-A	02/17/2004	E314.0	PERCHLORATE	5.13		UG/L				4 X
4036009DC	4036009DC-A	05/19/2004	E314.0	PERCHLORATE	5.36		UG/L				4 X
4036009DC	4036009DC-D	05/19/2004	E314.0	PERCHLORATE	5.23		UG/L				4 X
4036009DC	4036009DC-A	08/18/2004	E314.0	PERCHLORATE	5.63		UG/L				4 X
90MW0022	90MW0022-A	09/21/2004	E314.0	PERCHLORATE	4.3		UG/L	72.79	77.79		4 X
90MW0054	90MW0054AA	01/30/2001	E314.0	PERCHLORATE	9		UG/L	91.83	96.83		4 X
90MW0054	90MW0054AD	01/30/2001	E314.0	PERCHLORATE	10		UG/L	91.83	96.83		4 X
90MW0054	90MW0054	10/24/2001	E314.0	PERCHLORATE	27.8		UG/L	91.83	96.83		4 X
90MW0054	90MW0054	12/13/2001	E314.0	PERCHLORATE	32.1		UG/L	91.83	96.83		4 X
90MW0054	90MW0054	04/20/2002	E314.0	PERCHLORATE	26.3	J	UG/L	91.83	96.83		4 X
90MW0054	90MW0054-A	09/12/2002	E314.0	PERCHLORATE	19	J	UG/L	91.83	96.83		4 X
90MW0054	90MW0054-A	12/30/2002	E314.0	PERCHLORATE	17		UG/L	91.83	96.83		4 X
90MW0054	90MW0054-A	05/01/2003	E314.0	PERCHLORATE	7.5		UG/L	91.83	96.83		4 X
90MW0054	90MW0054-A	10/04/2003	E314.0	PERCHLORATE	4.3	J	UG/L	91.83	96.83		4 X
90MW0054	90MW0054-D	10/04/2003	E314.0	PERCHLORATE	4.4	J	UG/L	91.83	96.83		4 X
90MW0054	90MW0054-A	02/18/2004	E314.0	PERCHLORATE	4.2		UG/L	91.83	96.83		4 X
90PZ0211	90PZ0211A-A	05/20/2004	E314.0	PERCHLORATE	5		UG/L	76.85	76.85		4 X
90PZ0211	90PZ0211A-A	09/23/2004	E314.0	PERCHLORATE	7.4		UG/L	76.85	76.85		4 X
90PZ0211	90PZ0211B-A	05/20/2004	E314.0	PERCHLORATE	5.3		UG/L	86.85	86.85		4 X
90PZ0211	90PZ0211B-A	09/23/2004	E314.0	PERCHLORATE	8.1		UG/L	86.85	86.85		4 X
90PZ0211	90PZ0211C-A	05/20/2004	E314.0	PERCHLORATE	5.7		UG/L	96.85	96.85		4 X
90PZ0211	90PZ0211C-A	09/23/2004	E314.0	PERCHLORATE	9.4		UG/L	96.85	96.85		4 X
MW-114	W114M2A	12/29/2000	E314.0	PERCHLORATE	300		UG/L	39	49		4 X
MW-114	W114M2A	03/14/2001	E314.0	PERCHLORATE	260		UG/L	39	49		4 X
MW-114	W114M2A	06/19/2001	E314.0	PERCHLORATE	207		UG/L	39	49		4 X
MW-114	W114M2A	01/10/2002	E314.0	PERCHLORATE	127		UG/L	39	49		4 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-114	W114M2A	05/29/2002	E314.0	PERCHLORATE	72		UG/L	39	49		4 X
MW-114	W114M2A	08/09/2002	E314.0	PERCHLORATE	64		UG/L	39	49		4 X
MW-114	W114M2A	11/13/2002	E314.0	PERCHLORATE	71		UG/L	39	49		4 X
MW-114	W114M2A	05/27/2003	E314.0	PERCHLORATE	56		UG/L	39	49		4 X
MW-114	W114M2A	10/01/2003	E314.0	PERCHLORATE	52	J	UG/L	39	49		4 X
MW-114	W114M2A	02/09/2004	E314.0	PERCHLORATE	42.3		UG/L	39	49		4 X
MW-114	W114M2A	04/19/2004	E314.0	PERCHLORATE	37.7		UG/L	39	49		4 X
MW-114	W114M2A	07/30/2004	E314.0	PERCHLORATE	40.8		UG/L	39	49		4 X
MW-114	W114M1A	12/28/2000	E314.0	PERCHLORATE	11		UG/L	96	106		4 X
MW-114	W114M1A	03/14/2001	E314.0	PERCHLORATE	13		UG/L	96	106		4 X
MW-114	W114M1A	06/18/2001	E314.0	PERCHLORATE	10		UG/L	96	106		4 X
MW-114	W114M1A	12/21/2001	E314.0	PERCHLORATE	22.1		UG/L	96	106		4 X
MW-114	W114M1A	06/21/2002	E314.0	PERCHLORATE	12		UG/L	96	106		4 X
MW-114	W114M1A	08/09/2002	E314.0	PERCHLORATE	14		UG/L	96	106		4 X
MW-114	W114M1A	11/13/2002	E314.0	PERCHLORATE	11		UG/L	96	106		4 X
MW-114	W114M1A	05/27/2003	E314.0	PERCHLORATE	9.6		UG/L	96	106		4 X
MW-114	W114M1A	10/02/2003	E314.0	PERCHLORATE	7.7	J	UG/L	96	106		4 X
MW-114	W114M1A	02/09/2004	E314.0	PERCHLORATE	13.4		UG/L	96	106		4 X
MW-114	W114M1A	04/19/2004	E314.0	PERCHLORATE	9.67		UG/L	96	106		4 X
MW-114	W114M1A	07/30/2004	E314.0	PERCHLORATE	4.36		UG/L	96	106		4 X
MW-127	W127SSA	02/14/2001	E314.0	PERCHLORATE	4	J	UG/L	0	10		4 X
MW-129	W129M2A	03/14/2001	E314.0	PERCHLORATE	6		UG/L	46	56		4 X
MW-129	W129M2A	06/20/2001	E314.0	PERCHLORATE	8		UG/L	46	56		4 X
MW-129	W129M2A	12/21/2001	E314.0	PERCHLORATE	6.93	J	UG/L	46	56		4 X
MW-129	W129M2A	08/19/2002	E314.0	PERCHLORATE	13		UG/L	46	56		4 X
MW-129	W129M2A	11/13/2002	E314.0	PERCHLORATE	16		UG/L	46	56		4 X
MW-129	W129M2D	11/13/2002	E314.0	PERCHLORATE	15		UG/L	46	56		4 X
MW-129	W129M2A	03/24/2003	E314.0	PERCHLORATE	14	J	UG/L	46	56		4 X
MW-129	W129M2A	10/02/2003	E314.0	PERCHLORATE	6.7	J	UG/L	46	56		4 X
MW-129	W129M2A	02/10/2004	E314.0	PERCHLORATE	5.13		UG/L	46	56		4 X
MW-129	W129M2A	04/07/2004	E314.0	PERCHLORATE	5.27		UG/L	46	56		4 X
MW-129	W129M2A	08/06/2004	E314.0	PERCHLORATE	4.74		UG/L	46	56		4 X
MW-129	W129M1A	01/02/2001	E314.0	PERCHLORATE	10		UG/L	66	76		4 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-129	W129M1A	03/14/2001	E314.0	PERCHLORATE	9		UG/L	66	76		4 X
MW-129	W129M1A	06/19/2001	E314.0	PERCHLORATE	6		UG/L	66	76		4 X
MW-129	W129M1A	12/21/2001	E314.0	PERCHLORATE	5.92	J	UG/L	66	76		4 X
MW-129	W129M1A	04/12/2002	E314.0	PERCHLORATE	4.63		UG/L	66	76		4 X
MW-129	W129M1A	03/21/2003	E314.0	PERCHLORATE	5.9	J	UG/L	66	76		4 X
MW-129	W129M1A	10/02/2003	E314.0	PERCHLORATE	8.5	J	UG/L	66	76		4 X
MW-129	W129M1A	02/10/2004	E314.0	PERCHLORATE	6.62		UG/L	66	76		4 X
MW-129	W129M1A	04/07/2004	E314.0	PERCHLORATE	6.54		UG/L	66	76		4 X
MW-130	W130SSA	12/13/2001	E314.0	PERCHLORATE	4.21		UG/L	0	10		4 X
MW-130	W130SSD	12/13/2001	E314.0	PERCHLORATE	4.1		UG/L	0	10		4 X
MW-132	W132SSA	11/09/2000	E314.0	PERCHLORATE	39	J	UG/L	0	10		4 X
MW-132	W132SSA	02/16/2001	E314.0	PERCHLORATE	65		UG/L	0	10		4 X
MW-132	W132SSA	06/15/2001	E314.0	PERCHLORATE	75		UG/L	0	10		4 X
MW-132	W132SSA	12/12/2001	E314.0	PERCHLORATE	27.4		UG/L	0	10		4 X
MW-132	W132SSA	06/28/2002	E314.0	PERCHLORATE	28		UG/L	0	10		4 X
MW-132	W132SSA	09/20/2002	E314.0	PERCHLORATE	13	J	UG/L	0	10		4 X
MW-132	W132SSA	12/10/2002	E314.0	PERCHLORATE	20		UG/L	0	10		4 X
MW-132	W132SSA	03/27/2003	E314.0	PERCHLORATE	17		UG/L	0	10		4 X
MW-132	W132SSA	11/04/2003	E314.0	PERCHLORATE	11		UG/L	0	10		4 X
MW-132	W132SSA	12/18/2003	E314.0	PERCHLORATE	17	J	UG/L	0	10		4 X
MW-132	W132SSA	05/18/2004	E314.0	PERCHLORATE	13		UG/L	0	10		4 X
MW-139	W139M2A	12/29/2000	E314.0	PERCHLORATE	8		UG/L	70	80		4 X
MW-139	W139M2A	03/15/2001	E314.0	PERCHLORATE	11	J	UG/L	70	80		4 X
MW-139	W139M2A	10/10/2003	E314.0	PERCHLORATE	13		UG/L	70	80		4 X
MW-143	W143M3A	05/07/2004	E314.0	PERCHLORATE	12	J	UG/L	77	82		4 X
MW-143	W143M3D	05/07/2004	E314.0	PERCHLORATE	12	J	UG/L	77	82		4 X
MW-143	W143M3A	09/20/2004	E314.0	PERCHLORATE	12		UG/L	77	82		4 X
MW-143	W143M2A	12/18/2003	E314.0	PERCHLORATE	4.4	J	UG/L	87	92		4 X
MW-143	W143M2A	05/07/2004	E314.0	PERCHLORATE	5.7	J	UG/L	87	92		4 X
MW-143	W143M2A	09/20/2004	E314.0	PERCHLORATE	7.3		UG/L	87	92		4 X
MW-143	W143M1A	05/07/2004	E314.0	PERCHLORATE	5	J	UG/L	114	124		4 X
MW-143	W143M1A	09/20/2004	E314.0	PERCHLORATE	5.5		UG/L	114	124		4 X
MW-162	W162M2A	10/10/2003	E314.0	PERCHLORATE	4.4		UG/L	49.28	59.28		4 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-162	W162M2A	04/16/2004	E314.0	PERCHLORATE	4.11		UG/L	49.28	59.28		4 X
MW-162	W162M2A	07/28/2004	E314.0	PERCHLORATE	6.2		UG/L	49.28	59.28		4 X
MW-163	W163SSA	06/14/2001	E314.0	PERCHLORATE	67		UG/L	0	10		4 X
MW-163	W163SSA	10/10/2001	E314.0	PERCHLORATE	39.6		UG/L	0	10		4 X
MW-163	W163SSA	02/05/2002	E314.0	PERCHLORATE	17.9		UG/L	0	10		4 X
MW-163	W163SSA	03/07/2002	E314.0	PERCHLORATE	33.1		UG/L	0	10		4 X
MW-163	W163SSA	07/02/2002	E314.0	PERCHLORATE	46		UG/L	0	10		4 X
MW-163	W163SSA	01/08/2003	E314.0	PERCHLORATE	62		UG/L	0	10		4 X
MW-163	W163SSA	03/27/2003	E314.0	PERCHLORATE	44		UG/L	0	10		4 X
MW-163	W163SSA	11/04/2003	E314.0	PERCHLORATE	31		UG/L	0	10		4 X
MW-163	W163SSA	02/13/2004	E314.0	PERCHLORATE	41		UG/L	0	10		4 X
MW-163	W163SSA	05/11/2004	E314.0	PERCHLORATE	58 J		UG/L	0	10		4 X
MW-165	W165M2A	05/08/2001	E314.0	PERCHLORATE	122 J		UG/L	46	56		4 X
MW-165	W165M2A	08/16/2001	E314.0	PERCHLORATE	102		UG/L	46	56		4 X
MW-165	W165M2A	01/10/2002	E314.0	PERCHLORATE	81.2		UG/L	46	56		4 X
MW-165	W165M2A	04/18/2002	E314.0	PERCHLORATE	83.5		UG/L	46	56		4 X
MW-165	W165M2A	08/10/2002	E314.0	PERCHLORATE	64		UG/L	46	56		4 X
MW-165	W165M2A	11/26/2002	E314.0	PERCHLORATE	78		UG/L	46	56		4 X
MW-165	W165M2A	03/27/2003	E314.0	PERCHLORATE	110 J		UG/L	46	56		4 X
MW-165	W165M2A	09/11/2003	E314.0	PERCHLORATE	57 J		UG/L	46	56		4 X
MW-165	W165M2D	09/11/2003	E314.0	PERCHLORATE	58 J		UG/L	46	56		4 X
MW-165	W165M2A	03/01/2004	E314.0	PERCHLORATE	50.9 J		UG/L	46	56		4 X
MW-165	W165M2D	03/01/2004	E314.0	PERCHLORATE	50.9 J		UG/L	46	56		4 X
MW-165	W165M2A	04/09/2004	E314.0	PERCHLORATE	39		UG/L	46	56		4 X
MW-165	W165M2A	08/06/2004	E314.0	PERCHLORATE	41.3		UG/L	46	56		4 X
MW-165	W165M1A	03/27/2003	E314.0	PERCHLORATE	4 J		UG/L	106	116		4 X
MW-172	W172M2A	02/08/2002	E314.0	PERCHLORATE	5.45		UG/L	104	114		4 X
MW-172	W172M2A	09/18/2002	E314.0	PERCHLORATE	7.1		UG/L	104	114		4 X
MW-172	W172M2A	11/26/2002	E314.0	PERCHLORATE	6.8		UG/L	104	114		4 X
MW-172	W172M2A	03/28/2003	E314.0	PERCHLORATE	6.8 J		UG/L	104	114		4 X
MW-172	W172M2A	10/15/2003	E314.0	PERCHLORATE	6.8		UG/L	104	114		4 X
MW-172	W172M2A	02/10/2004	E314.0	PERCHLORATE	4.45		UG/L	104	114		4 X
MW-172	W172M2D	02/10/2004	E314.0	PERCHLORATE	4.44		UG/L	104	114		4 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-172	W172M2A	04/19/2004	E314.0	PERCHLORATE	4.39		UG/L	104	114		4 X
MW-172	W172M2A	07/28/2004	E314.0	PERCHLORATE	4.1		UG/L	104	114		4 X
MW-19	W19SSA	08/08/2000	E314.0	PERCHLORATE	104	J	UG/L	0	10		4 X
MW-19	W19SSA	12/08/2000	E314.0	PERCHLORATE	12		UG/L	0	10		4 X
MW-19	W19SSA	06/18/2001	E314.0	PERCHLORATE	41		UG/L	0	10		4 X
MW-19	W19SSA	08/24/2001	E314.0	PERCHLORATE	8.49		UG/L	0	10		4 X
MW-19	W19SSA	12/27/2001	E314.0	PERCHLORATE	18.6	J	UG/L	0	10		4 X
MW-19	W19SSA	05/29/2002	E314.0	PERCHLORATE	5.2		UG/L	0	10		4 X
MW-19	W19SSA	08/07/2002	E314.0	PERCHLORATE	4.1	J	UG/L	0	10		4 X
MW-19	W19SSA	09/27/2003	E314.0	PERCHLORATE	7.8	J	UG/L	0	10		4 X
MW-193	W193M1A	02/20/2002	E314.0	PERCHLORATE	7.02		UG/L	23.8	28.8		4 X
MW-193	W193M1D	02/20/2002	E314.0	PERCHLORATE	7.3		UG/L	23.8	28.8		4 X
MW-197	W197M3A	02/12/2002	E314.0	PERCHLORATE	34.1		UG/L	39.4	44.4		4 X
MW-197	W197M3A	07/18/2002	E314.0	PERCHLORATE	54	J	UG/L	39.4	44.4		4 X
MW-197	W197M3A	10/30/2002	E314.0	PERCHLORATE	41		UG/L	39.4	44.4		4 X
MW-197	W197M2A	02/04/2004	E314.0	PERCHLORATE	19		UG/L	59.3	64.3		4 X
MW-197	W197M2A	04/13/2004	E314.0	PERCHLORATE	23.3		UG/L	59.3	64.3		4 X
MW-197	W197M2A	05/26/2004	E314.0	PERCHLORATE	20		UG/L	59.3	64.3		4 X
MW-198	W198M4A	02/21/2002	E314.0	PERCHLORATE	311		UG/L	48.4	53.4		4 X
MW-198	W198M4A	07/19/2002	E314.0	PERCHLORATE	170	J	UG/L	48.4	53.4		4 X
MW-198	W198M4A	11/01/2002	E314.0	PERCHLORATE	75.9		UG/L	48.4	53.4		4 X
MW-198	W198M4A	12/05/2002	E314.0	PERCHLORATE	60	J	UG/L	48.4	53.4		4 X
MW-198	W198M4A	06/04/2003	E314.0	PERCHLORATE	46		UG/L	48.4	53.4		4 X
MW-198	W198M4A	11/05/2003	E314.0	PERCHLORATE	100		UG/L	48.4	53.4		4 X
MW-198	W198M4A	02/05/2004	E314.0	PERCHLORATE	54		UG/L	48.4	53.4		4 X
MW-198	W198M4A	05/26/2004	E314.0	PERCHLORATE	81.6		UG/L	48.4	53.4		4 X
MW-198	W198M3A	02/15/2002	E314.0	PERCHLORATE	40.9		UG/L	78.5	83.5		4 X
MW-198	W198M3A	07/22/2002	E314.0	PERCHLORATE	65	J	UG/L	78.5	83.5		4 X
MW-198	W198M3A	11/06/2002	E314.0	PERCHLORATE	170		UG/L	78.5	83.5		4 X
MW-198	W198M3A	12/05/2002	E314.0	PERCHLORATE	200	J	UG/L	78.5	83.5		4 X
MW-198	W198M3A	06/04/2003	E314.0	PERCHLORATE	310		UG/L	78.5	83.5		4 X
MW-198	W198M3A	11/05/2003	E314.0	PERCHLORATE	310		UG/L	78.5	83.5		4 X
MW-198	W198M3D	11/05/2003	E314.0	PERCHLORATE	320		UG/L	78.5	83.5		4 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-198	W198M3A	02/05/2004	E314.0	PERCHLORATE	260		UG/L	78.5	83.5		4 X
MW-198	W198M3A	05/27/2004	E314.0	PERCHLORATE	92.9		UG/L	78.5	83.5		4 X
MW-198	W198M2A	06/04/2003	E314.0	PERCHLORATE	23		UG/L	98.4	103.4		4 X
MW-198	W198M2A	11/04/2003	E314.0	PERCHLORATE	54		UG/L	98.4	103.4		4 X
MW-198	W198M2A	02/05/2004	E314.0	PERCHLORATE	280		UG/L	98.4	103.4		4 X
MW-198	W198M2A	05/27/2004	E314.0	PERCHLORATE	494		UG/L	98.4	103.4		4 X
MW-210	W210M2A	06/06/2002	E314.0	PERCHLORATE	12		UG/L	54.69	64.69		4 X
MW-210	W210M2D	06/06/2002	E314.0	PERCHLORATE	11		UG/L	54.69	64.69		4 X
MW-210	W210M2A	10/28/2002	E314.0	PERCHLORATE	9.93		UG/L	54.69	64.69		4 X
MW-210	W210M2A	02/28/2003	E314.0	PERCHLORATE	12	J	UG/L	54.69	64.69		4 X
MW-210	W210M2A	02/05/2004	E314.0	PERCHLORATE	19		UG/L	54.69	64.69		4 X
MW-210	W210M2A	03/11/2004	E314.0	PERCHLORATE	23		UG/L	54.69	64.69		4 X
MW-210	W210M2A	05/20/2004	E314.0	PERCHLORATE	44		UG/L	54.69	64.69		4 X
MW-210	W210M2D	05/20/2004	E314.0	PERCHLORATE	43		UG/L	54.69	64.69		4 X
MW-210	W210M2A	08/05/2004	E314.0	PERCHLORATE	59	J	UG/L	54.69	64.69		4 X
MW-211	W211M1A	02/04/2004	E314.0	PERCHLORATE	5.6		UG/L	55	65		4 X
MW-211	W211M1A	03/10/2004	E314.0	PERCHLORATE	9.8		UG/L	55	65		4 X
MW-211	W211M1A	05/21/2004	E314.0	PERCHLORATE	11		UG/L	55	65		4 X
MW-211	W211M1A	07/30/2004	E314.0	PERCHLORATE	13		UG/L	55	65		4 X
MW-232	W232M1A	05/12/2003	E314.0	PERCHLORATE	4.01		UG/L	34.94	39.94		4 X
MW-232	W232M1A-DA	05/12/2003	E314.0	PERCHLORATE	4.32		UG/L	34.94	39.94		4 X
MW-247	W247M2A	01/06/2003	E314.0	PERCHLORATE	5.2		UG/L	102.78	112.78		4 X
MW-247	W247M2D	01/06/2003	E314.0	PERCHLORATE	5.4		UG/L	102.78	112.78		4 X
MW-247	W247M2A	03/20/2003	E314.0	PERCHLORATE	5.7		UG/L	102.78	112.78		4 X
MW-247	W247M2A	06/23/2003	E314.0	PERCHLORATE	5.5		UG/L	102.78	112.78		4 X
MW-247	W247M2A	04/22/2004	E314.0	PERCHLORATE	4.4		UG/L	102.78	112.78		4 X
MW-247	W247M2A	05/13/2004	E314.0	PERCHLORATE	4.9		UG/L	102.78	112.78		4 X
MW-250	W250M2A	01/06/2003	E314.0	PERCHLORATE	7		UG/L	134.82	144.82		4 X
MW-250	W250M2A	03/19/2003	E314.0	PERCHLORATE	6.7		UG/L	134.82	144.82		4 X
MW-250	W250M2A	06/23/2003	E314.0	PERCHLORATE	6.2		UG/L	134.82	144.82		4 X
MW-250	W250M2A	04/22/2004	E314.0	PERCHLORATE	6.3		UG/L	134.82	144.82		4 X
MW-250	W250M2A	05/19/2004	E314.0	PERCHLORATE	6.6		UG/L	134.82	144.82		4 X
MW-263	W263M2A	08/25/2003	E314.0	PERCHLORATE	8.7		UG/L	8.66	18.66		4 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-263	W263M2A	12/22/2003	E314.0	PERCHLORATE	15	J	UG/L	8.66	18.66	4	X
MW-263	W263M2A	08/02/2004	E314.0	PERCHLORATE	4	J	UG/L	8.66	18.66	4	X
MW-263	W263M2D	08/02/2004	E314.0	PERCHLORATE	4.3	J	UG/L	8.66	18.66	4	X
MW-265	W265M3A	05/15/2003	E314.0	PERCHLORATE	4.41		UG/L	72.44	82.44	4	X
MW-265	W265M3A	12/01/2003	E314.0	PERCHLORATE	9.7		UG/L	72.44	82.44	4	X
MW-265	W265M3A	03/03/2004	E314.0	PERCHLORATE	10		UG/L	72.44	82.44	4	X
MW-265	W265M2A	05/15/2003	E314.0	PERCHLORATE	30.4		UG/L	97.6	107.6	4	X
MW-265	W265M2A	12/01/2003	E314.0	PERCHLORATE	33		UG/L	97.6	107.6	4	X
MW-265	W265M2A	03/03/2004	E314.0	PERCHLORATE	30		UG/L	97.6	107.6	4	X
MW-265	W265M2A	09/27/2004	E314.0	PERCHLORATE	23		UG/L	97.6	107.6	4	X
MW-270	W270M1A	06/16/2003	E314.0	PERCHLORATE	8.9		UG/L	50.89	55.89	4	X
MW-270	W270M1D	06/16/2003	E314.0	PERCHLORATE	9.1		UG/L	50.89	55.89	4	X
MW-270	W270M1A	09/30/2003	E314.0	PERCHLORATE	11		UG/L	50.89	55.89	4	X
MW-270	W270M1D	09/30/2003	E314.0	PERCHLORATE	11		UG/L	50.89	55.89	4	X
MW-270	W270M1A	01/06/2004	E314.0	PERCHLORATE	11	J	UG/L	50.89	55.89	4	X
MW-270	W270M1D	01/06/2004	E314.0	PERCHLORATE	11	J	UG/L	50.89	55.89	4	X
MW-270	W270M1A	04/29/2004	E314.0	PERCHLORATE	8.94		UG/L	50.89	55.89	4	X
MW-270	W270M1A	09/10/2004	E314.0	PERCHLORATE	9.7		UG/L	50.89	55.89	4	X
MW-277	W277SSA	07/10/2003	E314.0	PERCHLORATE	6.68		UG/L	0	10	4	X
MW-277	W277SSA	12/12/2003	E314.0	PERCHLORATE	5.27		UG/L	0	10	4	X
MW-277	W277SSA	01/20/2004	E314.0	PERCHLORATE	5.2		UG/L	0	10	4	X
MW-277	W277SSA	02/18/2004	E314.0	PERCHLORATE	4.06		UG/L	0	10	4	X
MW-277	W277SSA	03/17/2004	E314.0	PERCHLORATE	4.18		UG/L	0	10	4	X
MW-278	W278SSA	07/18/2003	E314.0	PERCHLORATE	19.3		UG/L	0	10	4	X
MW-278	W278M2A	12/03/2003	E314.0	PERCHLORATE	7.1		UG/L	9.79	14.79	4	X
MW-278	W278M2D	12/03/2003	E314.0	PERCHLORATE	7.4		UG/L	9.79	14.79	4	X
MW-278	W278M2A	01/20/2004	E314.0	PERCHLORATE	5.4		UG/L	9.79	14.79	4	X
MW-279	W279SSA	07/30/2003	E314.0	PERCHLORATE	16.7		UG/L	10	20	4	X
MW-279	W279SSA	12/10/2003	E314.0	PERCHLORATE	15.7		UG/L	10	20	4	X
MW-279	W279SSA	01/20/2004	E314.0	PERCHLORATE	17		UG/L	10	20	4	X
MW-279	W279SSA	02/19/2004	E314.0	PERCHLORATE	11.4		UG/L	10	20	4	X
MW-279	W279SSA	03/17/2004	E314.0	PERCHLORATE	11.2		UG/L	10	20	4	X
MW-279	W279SSA	04/15/2004	E314.0	PERCHLORATE	9.84		UG/L	10	20	4	X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-279	W279SSA	05/14/2004	E314.0	PERCHLORATE	11.9		UG/L	10	20		4 X
MW-279	W279SSA	06/09/2004	E314.0	PERCHLORATE	11.1		UG/L	10	20		4 X
MW-279	W279SSA	07/07/2004	E314.0	PERCHLORATE	10.5		UG/L	10	20		4 X
MW-279	W279SSA	08/04/2004	E314.0	PERCHLORATE	13.7		UG/L	10	20		4 X
MW-279	W279SSA	09/08/2004	E314.0	PERCHLORATE	15.2		UG/L	10	20		4 X
MW-279	W279M2A	07/30/2003	E314.0	PERCHLORATE	6.06		UG/L	26.8	31.8		4 X
MW-279	W279M2D	07/30/2003	E314.0	PERCHLORATE	6.15		UG/L	26.8	31.8		4 X
MW-279	W279M2A	04/14/2004	E314.0	PERCHLORATE	4.03		UG/L	26.8	31.8		4 X
MW-279	W279M2D	04/14/2004	E314.0	PERCHLORATE	4.04		UG/L	26.8	31.8		4 X
MW-279	W279M2A	05/12/2004	E314.0	PERCHLORATE	4.51		UG/L	26.8	31.8		4 X
MW-279	W279M2A	06/09/2004	E314.0	PERCHLORATE	4.95		UG/L	26.8	31.8		4 X
MW-279	W279M2A	07/07/2004	E314.0	PERCHLORATE	4.84		UG/L	26.8	31.8		4 X
MW-279	W279M2D	07/07/2004	E314.0	PERCHLORATE	4.87		UG/L	26.8	31.8		4 X
MW-279	W279M2A	08/04/2004	E314.0	PERCHLORATE	4.99		UG/L	26.8	31.8		4 X
MW-279	W279M2A	09/08/2004	E314.0	PERCHLORATE	4.5		UG/L	26.8	31.8		4 X
MW-279	W279M2D	09/08/2004	E314.0	PERCHLORATE	4.63		UG/L	26.8	31.8		4 X
MW-279	W279M1A	03/17/2004	E314.0	PERCHLORATE	4.6		UG/L	37.4	47.4		4 X
MW-279	W279M1A	04/14/2004	E314.0	PERCHLORATE	6.15		UG/L	37.4	47.4		4 X
MW-279	W279M1A	05/12/2004	E314.0	PERCHLORATE	5.17		UG/L	37.4	47.4		4 X
MW-279	W279M1A	06/09/2004	E314.0	PERCHLORATE	5.05		UG/L	37.4	47.4		4 X
MW-279	W279M1D	06/09/2004	E314.0	PERCHLORATE	5.14		UG/L	37.4	47.4		4 X
MW-279	W279M1A	07/07/2004	E314.0	PERCHLORATE	4.63		UG/L	37.4	47.4		4 X
MW-279	W279M1A	08/04/2004	E314.0	PERCHLORATE	4.61		UG/L	37.4	47.4		4 X
MW-289	MW-289M2-	09/18/2003	E314.0	PERCHLORATE	140		UG/L				4 X
MW-289	MW-289M2-FD	09/18/2003	E314.0	PERCHLORATE	140		UG/L				4 X
MW-289	MW-289M2-	03/31/2004	E314.0	PERCHLORATE	110		UG/L				4 X
MW-289	MW-289M2-	07/29/2004	E314.0	PERCHLORATE	63		UG/L	59.72	69.72		4 X
MW-289	MW-289M2-FD	07/29/2004	E314.0	PERCHLORATE	64		UG/L	59.72	69.72		4 X
MW-289	MW-289M1-	09/18/2003	E314.0	PERCHLORATE	24		UG/L	203	213		4 X
MW-289	MW-289M1-	03/31/2004	E314.0	PERCHLORATE	6.9		UG/L	203	213		4 X
MW-289	MW-289M1-	07/29/2004	E314.0	PERCHLORATE	9.2		UG/L	203	213		4 X
MW-293	MW-293M2-	02/26/2004	E314.0	PERCHLORATE	44		UG/L				4 X
MW-293	MW-293M2-FD	02/26/2004	E314.0	PERCHLORATE	44		UG/L				4 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-293	MW-293M2-	07/15/2004	E314.0	PERCHLORATE	43		UG/L	90.22	100.22		4 X
MW-300	MW-300M2-	03/03/2004	E314.0	PERCHLORATE	51		UG/L				4 X
MW-300	MW-300M2-	07/07/2004	E314.0	PERCHLORATE	41		UG/L	94.38	104.38		4 X
MW-300	MW-300M2-FD	07/07/2004	E314.0	PERCHLORATE	41		UG/L	94.38	104.38		4 X
MW-300	MW-300M2-	11/04/2004	E314.0	PERCHLORATE	57		UG/L	94.38	104.38		4 X
MW-300	MW-300M2-FD	11/04/2004	E314.0	PERCHLORATE	57		UG/L	94.38	104.38		4 X
MW-302	MW-302M2-	03/09/2004	E314.0	PERCHLORATE	6.9		UG/L				4 X
MW-302	MW-302M2-FD	03/09/2004	E314.0	PERCHLORATE	7		UG/L				4 X
MW-302	MW-302M2-	07/12/2004	E314.0	PERCHLORATE	9.3		UG/L	85.35	95.43		4 X
MW-303	MW-303M2-	03/30/2004	E314.0	PERCHLORATE	31		UG/L				4 X
MW-303	MW-303M2-	08/12/2004	E314.0	PERCHLORATE	29		UG/L	122.09	132.1		4 X
MW-305	MW-305M1-	03/09/2004	E314.0	PERCHLORATE	36		UG/L				4 X
MW-305	MW-305M1-	07/06/2004	E314.0	PERCHLORATE	34		UG/L	99.82	109.82		4 X
MW-305	MW-305M1-	11/03/2004	E314.0	PERCHLORATE	34		UG/L	99.82	109.82		4 X
MW-307	MW-307M3-	04/27/2004	E314.0	PERCHLORATE	24		UG/L				4 X
MW-307	MW-307M3-	10/25/2004	E314.0	PERCHLORATE	24		UG/L	17.8	27.82		4 X
MW-31	W31SSA	08/09/2000	E314.0	PERCHLORATE	43	J	UG/L	13	18		4 X
MW-31	W31SSA	12/08/2000	E314.0	PERCHLORATE	30		UG/L	13	18		4 X
MW-31	W31SSA	05/02/2001	E314.0	PERCHLORATE	20	J	UG/L	13	18		4 X
MW-31	W31SSA	08/24/2001	E314.0	PERCHLORATE	16.2		UG/L	13	18		4 X
MW-31	W31SSA	01/04/2002	E314.0	PERCHLORATE	12.5		UG/L	13	18		4 X
MW-31	W31SSA	05/29/2002	E314.0	PERCHLORATE	12		UG/L	13	18		4 X
MW-31	W31SSA	08/07/2002	E314.0	PERCHLORATE	7.2	J	UG/L	13	18		4 X
MW-31	W31SSA	11/15/2002	E314.0	PERCHLORATE	4.9		UG/L	13	18		4 X
MW-31	W31SSA	03/28/2003	E314.0	PERCHLORATE	10		UG/L	13	18		4 X
MW-31	W31SSA	09/27/2003	E314.0	PERCHLORATE	4.6		UG/L	13	18		4 X
MW-31	W31SSD	09/27/2003	E314.0	PERCHLORATE	5.3		UG/L	13	18		4 X
MW-31	W31SSA	02/28/2004	E314.0	PERCHLORATE	7.77	J	UG/L	13	18		4 X
MW-31	W31SSA	05/11/2004	E314.0	PERCHLORATE	5.02		UG/L	13	18		4 X
MW-31	W31M1A	08/09/2000	E314.0	PERCHLORATE	46	J	UG/L	28	38		4 X
MW-31	W31MMA	05/23/2001	E314.0	PERCHLORATE	19		UG/L	28	38		4 X
MW-31	W31MMA	08/07/2002	E314.0	PERCHLORATE	10	J	UG/L	28	38		4 X
MW-31	W31MMA	11/15/2002	E314.0	PERCHLORATE	5.2		UG/L	28	38		4 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE_ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-310	MW-310M1-	04/23/2004	E314.0	PERCHLORATE	16		UG/L				4 X
MW-310	MW-310M1-	08/23/2004	E314.0	PERCHLORATE	15		UG/L	86.4	96.41		4 X
MW-313	MW-313M2-	06/29/2004	E314.0	PERCHLORATE	8.2		UG/L				4 X
MW-313	MW-313M2-	10/25/2004	E314.0	PERCHLORATE	9.1		UG/L	93.46	103.49		4 X
MW-32	W32MMA	04/21/2004	E314.0	PERCHLORATE	4.14		UG/L	65	75		4 X
MW-32	W32MMA	08/04/2004	E314.0	PERCHLORATE	4.21		UG/L	65	75		4 X
MW-32	W32MMD	08/04/2004	E314.0	PERCHLORATE	4.03		UG/L	65	75		4 X
MW-32	W32DDA	08/03/2004	E314.0	PERCHLORATE	4.78		UG/L	85	90		4 X
MW-321	MW-321M1-	10/14/2004	E314.0	PERCHLORATE	4.5		UG/L	69.61	79.61		4 X
MW-326	MW-326M2-	06/30/2004	E314.0	PERCHLORATE	21		UG/L				4 X
MW-326	MW-326M2-	10/29/2004	E314.0	PERCHLORATE	18		UG/L	75.27	85.28		4 X
MW-339	MW-339M1-	08/20/2004	E314.0	PERCHLORATE	5.6		UG/L	125	135		4 X
MW-34	W34M2A	08/10/2000	E314.0	PERCHLORATE	56J		UG/L	53	63		4 X
MW-34	W34M2A	12/18/2000	E314.0	PERCHLORATE	34		UG/L	53	63		4 X
MW-34	W34M2A	05/01/2001	E314.0	PERCHLORATE	28J		UG/L	53	63		4 X
MW-34	W34M2A	07/30/2001	E314.0	PERCHLORATE	16.2		UG/L	53	63		4 X
MW-34	W34M2A	12/26/2001	E314.0	PERCHLORATE	5.85J		UG/L	53	63		4 X
MW-34	W34M2A	04/24/2002	E314.0	PERCHLORATE	19.6		UG/L	53	63		4 X
MW-34	W34M2A	08/20/2002	E314.0	PERCHLORATE	17		UG/L	53	63		4 X
MW-34	W34M2A	11/15/2002	E314.0	PERCHLORATE	14		UG/L	53	63		4 X
MW-34	W34M2A	03/24/2003	E314.0	PERCHLORATE	10J		UG/L	53	63		4 X
MW-34	W34M2A	11/12/2003	E314.0	PERCHLORATE	7.3		UG/L	53	63		4 X
MW-34	W34M2A	03/05/2004	E314.0	PERCHLORATE	7.02		UG/L	53	63		4 X
MW-34	W34M2A	05/14/2004	E314.0	PERCHLORATE	5.23		UG/L	53	63		4 X
MW-34	W34M2A	08/05/2004	E314.0	PERCHLORATE	5.87J		UG/L	53	63		4 X
MW-34	W34M1A	12/18/2000	E314.0	PERCHLORATE	109		UG/L	73	83		4 X
MW-34	W34M1A	05/05/2001	E314.0	PERCHLORATE	46		UG/L	73	83		4 X
MW-34	W34M1A	07/31/2001	E314.0	PERCHLORATE	30.8		UG/L	73	83		4 X
MW-34	W34M1D	07/31/2001	E314.0	PERCHLORATE	31.4		UG/L	73	83		4 X
MW-34	W34M1A	12/26/2001	E314.0	PERCHLORATE	17.7		UG/L	73	83		4 X
MW-34	W34M1A	04/24/2002	E314.0	PERCHLORATE	7.9		UG/L	73	83		4 X
MW-34	W34M1A	08/20/2002	E314.0	PERCHLORATE	7.1J		UG/L	73	83		4 X
MW-34	W34M1D	08/20/2002	E314.0	PERCHLORATE	7.3		UG/L	73	83		4 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE_ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-34	W34M1A	11/15/2002	E314.0	PERCHLORATE	8		UG/L	73	83		4 X
MW-34	W34M1A	03/24/2003	E314.0	PERCHLORATE	8	J	UG/L	73	83		4 X
MW-34	W34M1A	11/12/2003	E314.0	PERCHLORATE	6.9		UG/L	73	83		4 X
MW-34	W34M1A	05/14/2004	E314.0	PERCHLORATE	5.28		UG/L	73	83		4 X
MW-341	W341M4A	08/31/2004	E314.0	PERCHLORATE	14.7		UG/L	22.66	27.66		4 X
MW-348	MW-348M2-	11/03/2004	E314.0	PERCHLORATE	38		UG/L	89.54	99.54		4 X
MW-35	W35M1A	05/04/2001	E314.0	PERCHLORATE	4	J	UG/L	68	78		4 X
MW-35	W35M1A	08/03/2001	E314.0	PERCHLORATE	5.4		UG/L	68	78		4 X
MW-35	W35M1A	12/21/2001	E314.0	PERCHLORATE	6.34	J	UG/L	68	78		4 X
MW-35	W35M1A	04/24/2002	E314.0	PERCHLORATE	6.44	J	UG/L	68	78		4 X
MW-35	W35M1A	08/19/2002	E314.0	PERCHLORATE	5		UG/L	68	78		4 X
MW-35	W35M1A	11/18/2002	E314.0	PERCHLORATE	4.2		UG/L	68	78		4 X
MW-36	W36M2A	08/08/2002	E314.0	PERCHLORATE	4	J	UG/L	54	64		4 X
MW-36	W36M2A	11/18/2002	E314.0	PERCHLORATE	4.2	J	UG/L	54	64		4 X
MW-36	W36M2A	11/12/2003	E314.0	PERCHLORATE	4.8		UG/L	54	64		4 X
MW-73	W73SSD	12/19/2000	E314.0	PERCHLORATE	6		UG/L	0	10		4 X
MW-73	W73SSA	06/14/2001	E314.0	PERCHLORATE	10		UG/L	0	10		4 X
MW-75	W75M2A	05/09/2001	E314.0	PERCHLORATE	9	J	UG/L	34	44		4 X
MW-75	W75M2D	05/09/2001	E314.0	PERCHLORATE	9	J	UG/L	34	44		4 X
MW-75	W75M2A	08/09/2001	E314.0	PERCHLORATE	6.24		UG/L	34	44		4 X
MW-75	W75M2A	01/07/2002	E314.0	PERCHLORATE	4.08		UG/L	34	44		4 X
MW-75	W75M2A	04/25/2002	E314.0	PERCHLORATE	4.89		UG/L	34	44		4 X
MW-75	W75M2A	03/26/2003	E314.0	PERCHLORATE	6.8	J	UG/L	34	44		4 X
MW-75	W75M2A	12/04/2003	E314.0	PERCHLORATE	4.2		UG/L	34	44		4 X
MW-76	W76SSA	12/07/2000	E314.0	PERCHLORATE	5		UG/L	18	28		4 X
MW-76	W76SSA	05/07/2001	E314.0	PERCHLORATE	7		UG/L	18	28		4 X
MW-76	W76SSA	08/10/2001	E314.0	PERCHLORATE	13.3		UG/L	18	28		4 X
MW-76	W76SSA	12/28/2001	E314.0	PERCHLORATE	41.2		UG/L	18	28		4 X
MW-76	W76SSA	04/24/2002	E314.0	PERCHLORATE	175		UG/L	18	28		4 X
MW-76	W76SSA	08/20/2002	E314.0	PERCHLORATE	88		UG/L	18	28		4 X
MW-76	W76SSA	11/18/2002	E314.0	PERCHLORATE	26	J	UG/L	18	28		4 X
MW-76	W76SSA	09/27/2003	E314.0	PERCHLORATE	19		UG/L	18	28		4 X
MW-76	W76SSA	02/24/2004	E314.0	PERCHLORATE	19.1		UG/L	18	28		4 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-76	W76SSA	04/21/2004	E314.0	PERCHLORATE	11.3		UG/L	18	28		4 X
MW-76	W76M2A	12/06/2000	E314.0	PERCHLORATE	11		UG/L	38	48		4 X
MW-76	W76M2A	05/07/2001	E314.0	PERCHLORATE	17		UG/L	38	48		4 X
MW-76	W76M2A	08/13/2001	E314.0	PERCHLORATE	22.1		UG/L	38	48		4 X
MW-76	W76M2D	08/13/2001	E314.0	PERCHLORATE	22.5		UG/L	38	48		4 X
MW-76	W76M2A	01/07/2002	E314.0	PERCHLORATE	126		UG/L	38	48		4 X
MW-76	W76M2A	04/24/2002	E314.0	PERCHLORATE	174		UG/L	38	48		4 X
MW-76	W76M2A	08/19/2002	E314.0	PERCHLORATE	250		UG/L	38	48		4 X
MW-76	W76M2A	11/20/2002	E314.0	PERCHLORATE	290		UG/L	38	48		4 X
MW-76	W76M2A	03/26/2003	E314.0	PERCHLORATE	500 J		UG/L	38	48		4 X
MW-76	W76M2D	03/26/2003	E314.0	PERCHLORATE	500 J		UG/L	38	48		4 X
MW-76	W76M2A	12/03/2003	E314.0	PERCHLORATE	210		UG/L	38	48		4 X
MW-76	W76M2A	02/24/2004	E314.0	PERCHLORATE	115		UG/L	38	48		4 X
MW-76	W76M2A	04/22/2004	E314.0	PERCHLORATE	93.1		UG/L	38	48		4 X
MW-76	W76M2A	08/11/2004	E314.0	PERCHLORATE	57.2		UG/L	38	48		4 X
MW-76	W76M1A	05/07/2001	E314.0	PERCHLORATE	8		UG/L	58	68		4 X
MW-76	W76M1A	08/13/2001	E314.0	PERCHLORATE	16		UG/L	58	68		4 X
MW-76	W76M1A	12/28/2001	E314.0	PERCHLORATE	30.6		UG/L	58	68		4 X
MW-76	W76M1A	04/24/2002	E314.0	PERCHLORATE	15.3		UG/L	58	68		4 X
MW-76	W76M1A	11/18/2002	E314.0	PERCHLORATE	11 J		UG/L	58	68		4 X
MW-76	W76M1A	03/25/2003	E314.0	PERCHLORATE	200 J		UG/L	58	68		4 X
MW-76	W76M1A	09/27/2003	E314.0	PERCHLORATE	97 J		UG/L	58	68		4 X
MW-76	W76M1A	02/24/2004	E314.0	PERCHLORATE	16.4		UG/L	58	68		4 X
MW-76	W76M1A	04/21/2004	E314.0	PERCHLORATE	17.9		UG/L	58	68		4 X
MW-76	W76M1A	08/11/2004	E314.0	PERCHLORATE	47.3		UG/L	58	68		4 X
MW-77	W77M2A	12/06/2000	E314.0	PERCHLORATE	28		UG/L	38	48		4 X
MW-77	W77M2A	05/10/2001	E314.0	PERCHLORATE	16 J		UG/L	38	48		4 X
MW-77	W77M2A	08/10/2001	E314.0	PERCHLORATE	13.9		UG/L	38	48		4 X
MW-77	W77M2A	12/26/2001	E314.0	PERCHLORATE	12.3		UG/L	38	48		4 X
MW-77	W77M2A	04/24/2002	E314.0	PERCHLORATE	8.01		UG/L	38	48		4 X
MW-77	W77M2A	08/07/2002	E314.0	PERCHLORATE	7.2 J		UG/L	38	48		4 X
MW-77	W77M2A	11/19/2002	E314.0	PERCHLORATE	7.2		UG/L	38	48		4 X
MW-77	W77M2A	03/26/2003	E314.0	PERCHLORATE	5.4 J		UG/L	38	48		4 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-77	W77M2A	09/27/2003	E314.0	PERCHLORATE	9.1		UG/L	38	48		4 X
MW-77	W77M2A	02/12/2004	E314.0	PERCHLORATE	5.32		UG/L	38	48		4 X
MW-77	W77M2A	04/05/2004	E314.0	PERCHLORATE	5.7	J	UG/L	38	48		4 X
MW-77	W77M2A	07/28/2004	E314.0	PERCHLORATE	5.1		UG/L	38	48		4 X
MW-77	W77M2D	07/28/2004	E314.0	PERCHLORATE	5.1		UG/L	38	48		4 X
MW-78	W78M2A	12/06/2000	E314.0	PERCHLORATE	19		UG/L	38	48		4 X
MW-78	W78M2A	05/10/2001	E314.0	PERCHLORATE	9	J	UG/L	38	48		4 X
MW-78	W78M2A	08/15/2001	E314.0	PERCHLORATE	11.4		UG/L	38	48		4 X
MW-78	W78M2A	12/28/2001	E314.0	PERCHLORATE	4.43		UG/L	38	48		4 X
MW-78	W78M2A	04/25/2002	E314.0	PERCHLORATE	4.75		UG/L	38	48		4 X
MW-78	W78M2A	08/20/2002	E314.0	PERCHLORATE	6.3	J	UG/L	38	48		4 X
MW-78	W78M2A	11/20/2002	E314.0	PERCHLORATE	8.7		UG/L	38	48		4 X
MW-78	W78M2A	03/27/2003	E314.0	PERCHLORATE	4.7	J	UG/L	38	48		4 X
MW-78	W78M2A	12/04/2003	E314.0	PERCHLORATE	11		UG/L	38	48		4 X
MW-78	W78M2A	02/24/2004	E314.0	PERCHLORATE	8.34		UG/L	38	48		4 X
MW-78	W78M2D	02/24/2004	E314.0	PERCHLORATE	8.18	J	UG/L	38	48		4 X
MW-78	W78M2A	04/06/2004	E314.0	PERCHLORATE	8.2		UG/L	38	48		4 X
MW-78	W78M2A	08/12/2004	E314.0	PERCHLORATE	6.48		UG/L	38	48		4 X
MW-78	W78M1A	08/20/2002	E314.0	PERCHLORATE	4.6	J	UG/L	58	68		4 X
MW-78	W78M1A	11/20/2002	E314.0	PERCHLORATE	4.1		UG/L	58	68		4 X
MW-78	W78M1A	03/26/2003	E314.0	PERCHLORATE	4.9	J	UG/L	58	68		4 X
MW-78	W78M1A	12/04/2003	E314.0	PERCHLORATE	5.3		UG/L	58	68		4 X
MW-78	W78M1A	02/23/2004	E314.0	PERCHLORATE	4.83		UG/L	58	68		4 X
MW-78	W78M1A	04/06/2004	E314.0	PERCHLORATE	4.37		UG/L	58	68		4 X
MW-91	W91SSA	01/20/2001	E314.0	PERCHLORATE	5	J	UG/L	0	10		4 X
MW-91	W91SSA	05/20/2002	E314.0	PERCHLORATE	4		UG/L	0	10		4 X
15MW0002	15MW0002	04/08/1999	IM40MB	SODIUM	37600		UG/L	0	10		20000 X
90WT0010	90WT0010	06/05/2000	IM40MB	SODIUM	23600		UG/L	2	12		20000 X
90WT0010	90WT0010-L	06/05/2000	IM40MB	SODIUM	24200		UG/L	2	12		20000 X
90WT0015	90WT0015	04/23/1999	IM40MB	SODIUM	34300		UG/L	0	10		20000 X
ASPWELL	ASPWELL	05/24/2001	IM40MB	SODIUM	24900		UG/L				20000 X
ASPWELL	ASPWELL	09/27/2001	IM40MB	SODIUM	22600		UG/L				20000 X
ASPWELL	ASPWELL	09/27/2001	A3111B	SODIUM	21000		UG/L				20000 X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
ASPWELL	ASPWELL	12/19/2001	IM40MB	SODIUM	28500		UG/L			20000	X
MW-144	W144SSA	06/18/2001	IM40MB	SODIUM	77200		UG/L	5	15	20000	X
MW-144	W144SSA	09/06/2002	IM40MB	SODIUM	43000		UG/L	5	15	20000	X
MW-144	W144SSA	11/25/2002	IM40MB	SODIUM	28100		UG/L	5	15	20000	X
MW-144	W144SSA	10/16/2003	IM40MB	SODIUM	31400		UG/L	5	15	20000	X
MW-144	W144SSA	12/18/2003	IM40MB	SODIUM	27800		UG/L	5	15	20000	X
MW-145	W145SSA	02/12/2001	IM40MB	SODIUM	37000		UG/L	0	10	20000	X
MW-145	W145SSA	06/20/2001	IM40MB	SODIUM	73600		UG/L	0	10	20000	X
MW-145	W145SSA	06/28/2002	IM40MB	SODIUM	53300		UG/L	0	10	20000	X
MW-145	W145SSA	12/02/2002	IM40MB	SODIUM	24100		UG/L	0	10	20000	X
MW-145	W145SSA	11/04/2003	IM40MB	SODIUM	77200		UG/L	0	10	20000	X
MW-148	W148SSA	10/18/2001	IM40MB	SODIUM	23500		UG/L	0	10	20000	X
MW-148	W148SSA	12/18/2003	IM40MB	SODIUM	27800		UG/L	0	10	20000	X
MW-16	W16SSA	11/17/1997	IM40	SODIUM	20900		UG/L	0	10	20000	X
MW-16	W16SSL	11/17/1997	IM40	SODIUM	20400		UG/L	0	10	20000	X
MW-187	W187DDA	01/23/2002	IM40MB	SODIUM	25300		UG/L	199.5	209.5	20000	X
MW-187	W187DDX	01/23/2002	IM40MB	SODIUM	25200		UG/L	199.5	209.5	20000	X
MW-187	W187DDA	07/11/2002	IM40MB	SODIUM	27100		UG/L	199.5	209.5	20000	X
MW-187	W187DDA	10/17/2002	IM40MB	SODIUM	25300		UG/L	199.5	209.5	20000	X
MW-187	W187DDA	07/07/2003	IM40MB	SODIUM	22700		UG/L	199.5	209.5	20000	X
MW-187	W187DDA	11/21/2003	IM40MB	SODIUM	24200		UG/L	199.5	209.5	20000	X
MW-187	W187DDA	03/05/2004	IM40MB	SODIUM	24100		UG/L	199.5	209.5	20000	X
MW-2	W02SSA	02/23/1998	IM40MB	SODIUM	27200		UG/L	0	10	20000	X
MW-2	W02SSL	02/23/1998	IM40MB	SODIUM	26300		UG/L	0	10	20000	X
MW-2	W02SSA	02/01/1999	IM40MB	SODIUM	20300		UG/L	0	10	20000	X
MW-2	W02SSL	02/01/1999	IM40MB	SODIUM	20100		UG/L	0	10	20000	X
MW-2	W02DDA	11/19/1997	IM40	SODIUM	21500		UG/L	218	223	20000	X
MW-2	W02DDL	11/19/1997	IM40	SODIUM	22600		UG/L	218	223	20000	X
MW-21	W21SSA	10/24/1997	IM40	SODIUM	24000		UG/L	0	10	20000	X
MW-21	W21SSL	10/24/1997	IM40	SODIUM	24200		UG/L	0	10	20000	X
MW-21	W21SSA	11/15/2000	IM40MB	SODIUM	22500		UG/L	0	10	20000	X
MW-21	W21SSA	12/20/2001	IM40MB	SODIUM	26400		UG/L	0	10	20000	X
MW-21	W21SSA	10/02/2003	IM40MB	SODIUM	20200		UG/L	0	10	20000	X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-21	W21SSA	01/23/2004	IM40MB	SODIUM	31600		UG/L	0	10	20000	X
MW-46	W46SSA	08/25/1999	IM40MB	SODIUM	20600		UG/L	0	10	20000	X
MW-46	W46SSA	06/15/2000	IM40MB	SODIUM	32200		UG/L	0	10	20000	X
MW-46	W46SSA	09/12/2000	IM40MB	SODIUM	31300		UG/L	0	10	20000	X
MW-46	W46SSA	11/17/2000	IM40MB	SODIUM	22500	J	UG/L	0	10	20000	X
MW-46	W46M2A	03/30/1999	IM40MB	SODIUM	23300		UG/L	56	66	20000	X
MW-46	W46M2L	03/30/1999	IM40MB	SODIUM	24400		UG/L	56	66	20000	X
MW-54	W54SSA	08/27/1999	IM40MB	SODIUM	33300		UG/L	0	10	20000	X
MW-57	W57M3A	10/07/2002	IM40MB	SODIUM	21500		UG/L	31	41	20000	X
MW-57	W57M2A	12/21/1999	IM40MB	SODIUM	23500		UG/L	62	72	20000	X
MW-57	W57M2A	03/22/2000	IM40MB	SODIUM	24500		UG/L	62	72	20000	X
MW-57	W57M2A	06/30/2000	IM40MB	SODIUM	25900		UG/L	62	72	20000	X
MW-57	W57M2A	08/29/2000	IM40MB	SODIUM	23200		UG/L	62	72	20000	X
MW-57	W57M1A	12/14/1999	IM40MB	SODIUM	23700		UG/L	102	112	20000	X
MW-57	W57M1A	03/07/2000	IM40MB	SODIUM	20900		UG/L	102	112	20000	X
MW-57	W57M1A	07/05/2000	IM40MB	SODIUM	22200		UG/L	102	112	20000	X
MW-57	W57M1A	08/29/2000	IM40MB	SODIUM	20100		UG/L	102	112	20000	X
MW-57	W57M1A	09/14/2004	IM40MBM	SODIUM	21800		UG/L	102	112	20000	X
SDW261160	WG160L	01/07/1998	IM40MB	SODIUM	20600		UG/L	10	20	20000	X
SDW261160	WG160A	01/13/1999	IM40MB	SODIUM	27200		UG/L	10	20	20000	X
SDW261160	WG160L	01/13/1999	IM40MB	SODIUM	28200		UG/L	10	20	20000	X
MW-187	W187DDA	02/11/2002	VPHMA	TERT-BUTYL METHYL ETHER	30		UG/L	199.5	209.5	20	X
03MW0007A	03MW0007A	04/13/1999	OC21V	TETRACHLOROETHYLENE(PCE)	6		UG/L	21	26		5X
03MW0014A	03MW0014A	04/13/1999	OC21V	TETRACHLOROETHYLENE(PCE)	8		UG/L	38	43		5X
03MW0020	03MW0020	04/14/1999	OC21V	TETRACHLOROETHYLENE(PCE)	12		UG/L	36	41		5X
03MW0006	03MW0006	04/15/1999	IM40MB	THALLIUM	2.6	J	UG/L	0	10		2X
03MW0022A	03MW0022A	04/16/1999	IM40MB	THALLIUM	3.9		UG/L	71	76		2X
03MW0027A	03MW0027A	04/14/1999	IM40MB	THALLIUM	2	J	UG/L	64	69		2X
11MW0004	11MW0004	04/16/1999	IM40MB	THALLIUM	2.3	J	UG/L	0	10		2X
27MW0020Z	27MW0020Z	04/16/1999	IM40MB	THALLIUM	2.7	J	UG/L	98	103		2X
90MW0038	90MW0038	04/21/1999	IM40MB	THALLIUM	4.4	J	UG/L	29	34		2X
90WT0010	WF10XA	01/16/1998	IM40MB	THALLIUM	6.5	J	UG/L	2	12		2X
LRWS1-4	WL14XA	01/06/1999	IM40MB	THALLIUM	5.2	J	UG/L	107	117		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE_ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-1	W01SSA	09/07/1999	IM40MB	THALLIUM	2.9	J	UG/L	0	10		2X
MW-127	W127SSA	11/15/2000	IM40MB	THALLIUM	2.4	J	UG/L	0	10		2X
MW-132	W132SSA	02/16/2001	IM40MB	THALLIUM	2.1	J	UG/L	0	10		2X
MW-145	W145SSA	10/18/2001	IM40MB	THALLIUM	4.8	J	UG/L	0	10		2X
MW-148	W148SSA	12/02/2002	IM40MB	THALLIUM	3.8	J	UG/L	0	10		2X
MW-150	W150SSA	03/07/2001	IM40MB	THALLIUM	2.2	J	UG/L	1	11		2X
MW-18	W18SSA	03/12/1999	IM40MB	THALLIUM	2.3	J	UG/L	0	10		2X
MW-19	W19SSA	09/10/1999	IM40MB	THALLIUM	3.8	J	UG/L	0	10		2X
MW-19	W19SSA	08/24/2001	IM40MB	THALLIUM	4.2	J	UG/L	0	10		2X
MW-19	W19DDL	02/11/1999	IM40MB	THALLIUM	3.1	J	UG/L	254	259		2X
MW-191	W191M1A	07/25/2002	IM40MB	THALLIUM	6.3		UG/L	25.2	30.2		2X
MW-2	W02DDD	08/02/2000	IM40MB	THALLIUM	4.9	J	UG/L	218	223		2X
MW-21	W21SSA	10/24/1997	IM40	THALLIUM	6.9	J	UG/L	0	10		2X
MW-21	W21M2A	11/01/1999	IM40MB	THALLIUM	4	J	UG/L	58	68		2X
MW-23	W23SSA	09/14/1999	IM40MB	THALLIUM	4.7	J	UG/L	0	10		2X
MW-25	W25SSA	09/14/1999	IM40MB	THALLIUM	5.3	J	UG/L	0	10		2X
MW-3	W03DDA	12/20/2000	IM40MB	THALLIUM	3.3		UG/L	219	224		2X
MW-35	W35SSA	12/18/2000	IM40MB	THALLIUM	2.9	J	UG/L	0	10		2X
MW-37	W37M2A	12/29/1999	IM40MB	THALLIUM	4.9	J	UG/L	26	36		2X
MW-38	W38M4A	08/18/1999	IM40MB	THALLIUM	2.8	J	UG/L	14	24		2X
MW-38	W38M2A	05/11/1999	IM40MB	THALLIUM	4.9	J	UG/L	69	79		2X
MW-38	W38DDA	08/22/2001	IM40MB	THALLIUM	3	J	UG/L	124	134		2X
MW-39	W39M1A	12/21/2000	IM40MB	THALLIUM	4		UG/L	84	94		2X
MW-41	W41M2A	04/02/1999	IM40MB	THALLIUM	2.5	J	UG/L	67	77		2X
MW-42	W42M2A	11/19/1999	IM40MB	THALLIUM	4	J	UG/L	118	128		2X
MW-44	W44SSA	08/24/2001	IM40MB	THALLIUM	3	J	UG/L	0	10		2X
MW-45	W45SSA	05/26/1999	IM40MB	THALLIUM	3	J	UG/L	0	10		2X
MW-45	W45SSA	08/31/2000	IM40MB	THALLIUM	4.4	J	UG/L	0	10		2X
MW-46	W46M1A	05/16/2000	IM40MB	THALLIUM	5.3	J	UG/L	103	113		2X
MW-46	W46DDA	11/02/1999	IM40MB	THALLIUM	5.1	J	UG/L	136	146		2X
MW-47	W47M3A	08/25/1999	IM40MB	THALLIUM	3.2	J	UG/L	21	31		2X
MW-47	W47M3A	05/31/2000	IM40MB	THALLIUM	5	J	UG/L	21	31		2X
MW-47	W47M2A	03/26/1999	IM40MB	THALLIUM	3.2	J	UG/L	38	48		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-47	W47M2A	08/25/1999	IM40MB	THALLIUM	4J		UG/L	38	48		2X
MW-47	W47M2A	05/30/2000	IM40MB	THALLIUM	4.5J		UG/L	38	48		2X
MW-47	W47M1A	08/24/1999	IM40MB	THALLIUM	2.6J		UG/L	75	85		2X
MW-48	W48M3A	02/28/2000	IM40MB	THALLIUM	4.2J		UG/L	31	41		2X
MW-48	W48DAA	06/26/2000	IM40MB	THALLIUM	4.7J		UG/L	121	131		2X
MW-49	W49SSA	11/19/1999	IM40MB	THALLIUM	4.7J		UG/L	0	10		2X
MW-49	W49M3D	06/27/2000	IM40MB	THALLIUM	4.3J		UG/L	31	41		2X
MW-50	W50M1A	05/15/2000	IM40MB	THALLIUM	6.2J		UG/L	89	99		2X
MW-51	W51M3A	08/25/1999	IM40MB	THALLIUM	4.3J		UG/L	28	38		2X
MW-52	W52SSA	08/26/1999	IM40MB	THALLIUM	3.6J		UG/L	0	10		2X
MW-52	W52SSA	11/18/1999	IM40MB	THALLIUM	4.3J		UG/L	0	10		2X
MW-52	W52SSA	05/23/2000	IM40MB	THALLIUM	4.7J		UG/L	0	10		2X
MW-52	W52M3L	04/07/1999	IM40MB	THALLIUM	3.6J		UG/L	59	64		2X
MW-52	W52DDA	04/02/1999	IM40MB	THALLIUM	2.8J		UG/L	218	228		2X
MW-52	W52DDL	04/02/1999	IM40MB	THALLIUM	2.6J		UG/L	218	228		2X
MW-52	W52DDA	08/30/1999	IM40MB	THALLIUM	3.8J		UG/L	218	228		2X
MW-53	W53M1A	11/05/1999	IM40MB	THALLIUM	3.4J		UG/L	99	109		2X
MW-54	W54SSA	11/08/1999	IM40MB	THALLIUM	7.4J		UG/L	0	10		2X
MW-54	W54SSA	06/06/2000	IM40MB	THALLIUM	4.6J		UG/L	0	10		2X
MW-54	W54SSA	11/15/2000	IM40MB	THALLIUM	3.1J		UG/L	0	10		2X
MW-54	W54M1A	08/30/1999	IM40MB	THALLIUM	2.8J		UG/L	79	89		2X
MW-54	W54M1A	11/05/1999	IM40MB	THALLIUM	3.9J		UG/L	79	89		2X
MW-55	W55M1A	08/31/1999	IM40MB	THALLIUM	2.5J		UG/L	89	99		2X
MW-56	W56SSA	09/05/2000	IM40MB	THALLIUM	4J		UG/L	1	11		2X
MW-56	W56M3A	09/05/2000	IM40MB	THALLIUM	6.1J		UG/L	31	41		2X
MW-56	W56M3D	09/05/2000	IM40MB	THALLIUM	4.4J		UG/L	31	41		2X
MW-57	W57M2A	03/22/2000	IM40MB	THALLIUM	4.1J		UG/L	62	72		2X
MW-58	W58SSA	05/11/2000	IM40MB	THALLIUM	7.3J		UG/L	0	10		2X
MW-58	W58SSA	12/20/2000	IM40MB	THALLIUM	2J		UG/L	0	10		2X
MW-61	W61SSA	08/22/2001	IM40MB	THALLIUM	3.7J		UG/L	0	10		2X
MW-64	W64M1A	02/07/2000	IM40MB	THALLIUM	4.1J		UG/L	38	48		2X
MW-7	W07M2L	02/05/1998	IM40MB	THALLIUM	6.6J		UG/L	65	70		2X
MW-7	W07M2A	02/24/1999	IM40MB	THALLIUM	4.4J		UG/L	65	70		2X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
MW-7	W07MMA	02/23/1999	IM40MB	THALLIUM	4.1	J	UG/L	135	140		2X
MW-7	W07M1A	09/07/1999	IM40MB	THALLIUM	26.2		UG/L	135	140		2X
MW-7	W07M1D	09/07/1999	IM40MB	THALLIUM	12.7		UG/L	135	140		2X
MW-72	W72SSA	05/27/1999	IM40MB	THALLIUM	4		UG/L	0	10		2X
MW-73	W73SSA	12/19/2000	IM40MB	THALLIUM	4.3		UG/L	0	10		2X
MW-73	W73SSD	12/19/2000	IM40MB	THALLIUM	2J		UG/L	0	10		2X
MW-83	W83SSA	01/13/2000	IM40MB	THALLIUM	3.6J		UG/L	0	10		2X
MW-84	W84SSA	10/21/1999	IM40MB	THALLIUM	3.2J		UG/L	17	27		2X
MW-84	W84M3A	08/27/2001	IM40MB	THALLIUM	5J		UG/L	42	52		2X
MW-84	W84DDA	08/23/2001	IM40MB	THALLIUM	4J		UG/L	153	163		2X
MW-94	W94M2A	01/11/2001	IM40MB	THALLIUM	2J		UG/L	16	26		2X
MW-94	W94M2A	10/02/2001	IM40MB	THALLIUM	2.3J		UG/L	16	26		2X
PPAWSMW-1	PPAWSMW-1	06/22/1999	IM40MB	THALLIUM	3.1J		UG/L	0	10		2X
SMR-2	WSMR2A	03/25/1999	IM40MB	THALLIUM	2J		UG/L	19	29		2X
MW-45	W45SSA	11/16/1999	OC21V	TOLUENE	1000		UG/L	0	10	1000	X
MW-45	W45SSA	05/29/2000	OC21V	TOLUENE	1100		UG/L	0	10	1000	X
MW-45	W45SSA	12/27/2000	OC21V	TOLUENE	1300		UG/L	0	10	1000	X
MW-45	W45SSA	12/14/2001	OC21V	TOLUENE	1300		UG/L	0	10	1000	X
27MW0017B	27MW0017B	04/30/1999	OC21V	VINYL CHLORIDE	2		UG/L	21	26		2X
95-15A	W9515A	10/17/1997	IM40	ZINC	7210		UG/L	74.71	84.71	2000	X
95-15A	W9515L	10/17/1997	IM40	ZINC	4620		UG/L	74.71	84.71	2000	X
LRMW0003	WL31XA	10/21/1997	IM40	ZINC	2480		UG/L	69.68	94.68	2000	X
LRMW0003	WL31XL	10/21/1997	IM40	ZINC	2410		UG/L	69.68	94.68	2000	X
LRWS4-1	WL41XA	11/24/1997	IM40	ZINC	3220		UG/L	66	91	2000	X
LRWS4-1	WL41XL	11/24/1997	IM40	ZINC	3060		UG/L	66	91	2000	X
LRWS5-1	WL51DL	11/25/1997	IM40	ZINC	4410		UG/L	66	91	2000	X
LRWS5-1	WL51XA	11/25/1997	IM40	ZINC	4510		UG/L	66	91	2000	X
LRWS5-1	WL51XD	11/25/1997	IM40	ZINC	4390		UG/L	66	91	2000	X
LRWS5-1	WL51XL	11/25/1997	IM40	ZINC	3900		UG/L	66	91	2000	X
LRWS5-1	WL51XA	01/25/1999	IM40MB	ZINC	3980		UG/L	66	91	2000	X
LRWS5-1	WL51XL	01/25/1999	IM40MB	ZINC	3770		UG/L	66	91	2000	X
LRWS6-1	WL61XA	11/17/1997	IM40	ZINC	3480		UG/L	184	199	2000	X
LRWS6-1	WL61XL	11/17/1997	IM40	ZINC	2600		UG/L	184	199	2000	X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 3
VALIDATED DETECTS EXCEEDING MCLs OR HEALTH ADVISORY LIMITS
1997 THROUGH NOVEMBER 2004

WELL/LOCID	SAMPLE ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT
LRWS6-1	WL61XA	01/28/1999	IM40MB	ZINC	2240		UG/L	184	199	2000	X
LRWS6-1	WL61XL	01/28/1999	IM40MB	ZINC	2200		UG/L	184	199	2000	X
LRWS7-1	WL71XA	11/21/1997	IM40	ZINC	4320		UG/L	186	201	2000	X
LRWS7-1	WL71XL	11/21/1997	IM40	ZINC	3750		UG/L	186	201	2000	X
LRWS7-1	WL71XA	01/22/1999	IM40MB	ZINC	4160		UG/L	186	201	2000	X
LRWS7-1	WL71XL	01/22/1999	IM40MB	ZINC	4100		UG/L	186	201	2000	X
XX95-14	W9514A	09/28/1999	IM40MB	ZINC	2430		UG/L	90	100	2000	X

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 4
VALIDATED DETECTS BELOW MCLs OR HEALTH ADVISORY
LIMITS NOT PREVIOUSLY DETECTED
DATA RECEIVED NOVEMBER 2004

WELL/LOCID	SAMPLE_ID	SAMPLED	METHOD	ANALYTE	CONC.	FLAG	UNITS	BWTS	BWTE	DW_LIMIT	>DW_LIMIT

There were no first-time validated detections of explosives below the MCL/HA for drinking water or of perchlorate below a 4 ppb concentration received during the reporting period.

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

DW LIMIT = EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT OR LIFETIME)

>DW LIMIT = EQUALS OR EXCEEDS EITHER THE MCL OR LOWEST HEALTH ADVISORY CONCENTRATION (CHILD, ADULT, OR LIFETIME)

J = ESTIMATED DETECT

TABLE 5
DETECTED COMPOUNDS-UNVALIDATED
SAMPLES RECEIVED 11/01/04 - 11/30/04

SAMPLE ID	LOCID OR WELL	SAMPLED	SAMP TYPE	SBD	SED	BWTS	BWTE	METHOD	ANALYTE	PDA
FPR-INF-12A	FPR-INF	11/02/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
FPR-INF-12A	FPR-INF	11/02/2004	PROCESS WATER	0	0			8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-TRIAZINE	YES
FPR-INF-12A	FPR-INF	11/02/2004	PROCESS WATER	0	0			8330N	OCTAHYDRO-1,3,5,7-TETRANITRO-1,3,5,7-TET	YES
FPR-INF-13A	FPR-INF	11/09/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
FPR-INF-13A	FPR-INF	11/09/2004	PROCESS WATER	0	0			8330N	OCTAHYDRO-1,3,5,7-TETRANITRO-1,3,5,7-TET	YES
FPR-INF-13A	FPR-INF	11/09/2004	PROCESS WATER	0	0			8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-TRIAZINE	YES
FPR-INF-14A	FPR-INF	11/16/2004	PROCESS WATER	0	0			8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-TRIAZINE	YES
FPR-INF-14A	FPR-INF	11/16/2004	PROCESS WATER	0	0			8330N	OCTAHYDRO-1,3,5,7-TETRANITRO-1,3,5,7-TET	YES
FPR-INF-14A	FPR-INF	11/16/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
FPR-INF-15A	FPR-INF	11/23/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
FPR-INF-15A	FPR-INF	11/23/2004	PROCESS WATER	0	0			8330N	OCTAHYDRO-1,3,5,7-TETRANITRO-1,3,5,7-TET	YES
FPR-INF-15A	FPR-INF	11/23/2004	PROCESS WATER	0	0			8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-TRIAZINE	YES
FPR-MID-1A-14A	FPR-MID-1	11/16/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
FPR-MID-1A-15A	FPR-MID-1	11/23/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
FPR-MID-1B-14A	FPR-MID-1	11/16/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
FPR-MID-1B-15A	FPR-MID-1	11/23/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
FPR-MID-1C-14A	FPR-MID-1	11/16/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
FPR-MID-1C-15A	FPR-MID-1	11/23/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
PR-INF-15A	PR-INF	10/28/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
PR-INF-16A	PR-INF	11/10/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
PR-INF-16A	PR-INF	11/10/2004	PROCESS WATER	0	0			8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-TRIAZINE	YES
PR-INF-17A	PR-INF	11/23/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
PR-INF-17A	PR-INF	11/23/2004	PROCESS WATER	0	0			8330N	HEXAHYDRO-1,3,5-TRINITRO-1,3,5-TRIAZINE	YES
PR-MID-1-17A	PR-MID-1	11/23/2004	PROCESS WATER	0	0			E314.0	PERCHLORATE	
MW-357-07	MW-357	11/01/2004	PROFILE	160	160	59	59	8260B	CHLOROFORM	
MW-357-09	MW-357	11/02/2004	PROFILE	170	170	69	69	8260B	CHLOROFORM	
MW-357-09	MW-357	11/02/2004	PROFILE	170	170	69	69	8330N	NITROGLYCERIN	NO
MW-357-10	MW-357	11/02/2004	PROFILE	180	180	79	79	8260B	CHLOROFORM	

DATA REPORTED REFLECT CURRENT DATABASE FOR SAMPLES RECEIVED IN SPECIFIED TIMEFRAME. NOT ALL RESULTS ARE COMPLETE.

SBD = SAMPLE COLLECTION BEGIN DEPTH IN FEET BELOW GROUND SURFACE

SED = SAMPLE COLLECTION END DEPTH IN FEET BELOW GROUND SURFACE

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

PDA/YES = Photo Diode Array, Detect Confirmed

PDA/NO = Photo Diode Array, Detect Not Confirmed

+ = Interference in sample

TABLE 5
DETECTED COMPOUNDS-UNVALIDATED
SAMPLES RECEIVED 11/01/04 - 11/30/04

SAMPLE ID	LOCID OR WELL	SAMPLED	SAMP TYPE	SBD	SED	BWTS	BWTE	METHOD	ANALYTE	PDA
MW-357-11	MW-357	11/03/2004	PROFILE	190	190	89	89	8330N	4-NITROTOLUENE	NO
MW-357-11	MW-357	11/03/2004	PROFILE	190	190	89	89	8260B	CHLOROFORM	
MW-357-11	MW-357	11/03/2004	PROFILE	190	190	89	89	8330N	2,4-DINITROTOLUENE	NO
MW-357-11	MW-357	11/03/2004	PROFILE	190	190	89	89	8330N	2,6-DINITROTOLUENE	NO
MW-357-11	MW-357	11/03/2004	PROFILE	190	190	89	89	8330N	3-NITROTOLUENE	YES+
MW-357-11	MW-357	11/03/2004	PROFILE	190	190	89	89	8330N	NITROGLYCERIN	NO
MW-357-11	MW-357	11/03/2004	PROFILE	190	190	89	89	8330N	PICRIC ACID	NO
MW-357-11	MW-357	11/03/2004	PROFILE	190	190	89	89	8330N	2-AMINO-4,6-DINITROTOLUENE	NO
MW-357-12	MW-357	11/03/2004	PROFILE	200	200	99	99	8260B	CHLOROFORM	
MW-357-13	MW-357	11/03/2004	PROFILE	210	210	109	109	8260B	CHLOROFORM	
MW-357-13FD	MW-357	11/03/2004	PROFILE	210	210	109	109	8260B	CHLOROFORM	
MW-357-14	MW-357	11/03/2004	PROFILE	220	220	119	119	8260B	CHLOROFORM	
MW-357-15	MW-357	11/03/2004	PROFILE	230	230	129	129	8260B	CHLOROFORM	
MW-357-16	MW-357	11/03/2004	PROFILE	240	240	139	139	8260B	CHLOROFORM	
MW-357-17	MW-357	11/03/2004	PROFILE	250	250	149	149	8260B	CHLOROFORM	
MW-357-18	MW-357	11/03/2004	PROFILE	260	260	159	159	8260B	CHLOROFORM	
MW-357-19	MW-357	11/04/2004	PROFILE	270	270	169	169	8260B	CHLOROFORM	
MW-357-20	MW-357	11/04/2004	PROFILE	280	280	179	179	8260B	CHLOROFORM	
MW-357-21	MW-357	11/04/2004	PROFILE	290	290	189	189	8260B	CHLOROFORM	
MW-357-22	MW-357	11/04/2004	PROFILE	300	300	199	199	8260B	CHLOROFORM	
MW-357-24	MW-357	11/04/2004	PROFILE	320	320	219	219	8260B	METHYL T-BUTYL ETHER	
MW-358-02	MW-358	11/04/2004	PROFILE	120	125	19	24	8260B	TETRACHLOROETHENE (PCE)	
MW-358-02	MW-358	11/04/2004	PROFILE	120	125	19	24	8260B	CHLOROFORM	
MW-358-03	MW-358	11/05/2004	PROFILE	130	135	29	34	8260B	TETRACHLOROETHENE (PCE)	
MW-358-03	MW-358	11/05/2004	PROFILE	130	135	29	34	8260B	CHLOROFORM	
MW-358-03FD	MW-358	11/05/2004	PROFILE	130	135	29	34	8260B	TETRACHLOROETHENE (PCE)	
MW-358-03FD	MW-358	11/05/2004	PROFILE	130	135	29	34	8260B	CHLOROFORM	
MW-358-04	MW-358	11/05/2004	PROFILE	140	145	39	44	8260B	TETRACHLOROETHENE (PCE)	

DATA REPORTED REFLECT CURRENT DATABASE FOR SAMPLES RECEIVED IN SPECIFIED TIMEFRAME. NOT ALL RESULTS ARE COMPLETE.

SBD = SAMPLE COLLECTION BEGIN DEPTH IN FEET BELOW GROUND SURFACE

SED = SAMPLE COLLECTION END DEPTH IN FEET BELOW GROUND SURFACE

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

PDA/YES = Photo Diode Array, Detect Confirmed

PDA/NO = Photo Diode Array, Detect Not Confirmed

+ = Interference in sample

TABLE 5
DETECTED COMPOUNDS-UNVALIDATED
SAMPLES RECEIVED 11/01/04 - 11/30/04

SAMPLE ID	LOCID OR WELL	SAMPLED	SAMP TYPE	SBD	SED	BWTS	BWTE	METHOD	ANALYTE	PDA
MW-358-04	MW-358	11/05/2004	PROFILE	140	145	39	44	8260B	CHLOROFORM	
MW-358-05	MW-358	11/05/2004	PROFILE	150	155	49	54	8260B	TETRACHLOROETHENE (PCE)	
MW-358-05	MW-358	11/05/2004	PROFILE	150	155	49	54	8260B	CHLOROFORM	
MW-358-06	MW-358	11/05/2004	PROFILE	160	165	59	64	8260B	CHLOROFORM	
MW-358-06	MW-358	11/05/2004	PROFILE	160	165	59	64	8260B	TETRACHLOROETHENE (PCE)	
MW-358-07	MW-358	11/08/2004	PROFILE	170	175	69	74	8260B	CHLOROFORM	
MW-358-07	MW-358	11/08/2004	PROFILE	170	175	69	74	8260B	TETRACHLOROETHENE (PCE)	
MW-358-08	MW-358	11/08/2004	PROFILE	180	185	79	84	8260B	CHLOROFORM	
MW-358-08	MW-358	11/08/2004	PROFILE	180	185	79	84	8260B	CHLOROMETHANE	
MW-358-08	MW-358	11/08/2004	PROFILE	180	185	79	84	8260B	TETRACHLOROETHENE (PCE)	
MW-358-09	MW-358	11/08/2004	PROFILE	190	195	89	94	8260B	TETRACHLOROETHENE (PCE)	
MW-358-09	MW-358	11/08/2004	PROFILE	190	195	89	94	8260B	CHLOROFORM	
MW-358-09	MW-358	11/08/2004	PROFILE	190	195	89	94	8260B	CHLOROMETHANE	
MW-358-10	MW-358	11/08/2004	PROFILE	200	205	99	104	8260B	TETRACHLOROETHENE (PCE)	
MW-358-10	MW-358	11/08/2004	PROFILE	200	205	99	104	8260B	CHLOROFORM	
MW-358-10	MW-358	11/08/2004	PROFILE	200	205	99	104	8260B	CHLOROMETHANE	
MW-358-11	MW-358	11/08/2004	PROFILE	210	215	109	114	8260B	CHLOROFORM	
MW-358-11	MW-358	11/08/2004	PROFILE	210	215	109	114	8260B	TETRACHLOROETHENE (PCE)	
MW-358-12	MW-358	11/08/2004	PROFILE	220	225	119	124	8260B	CHLOROFORM	
MW-358-12	MW-358	11/08/2004	PROFILE	220	225	119	124	8260B	TETRACHLOROETHENE (PCE)	
MW-358-13	MW-358	11/09/2004	PROFILE	230	235	129	134	8260B	CHLOROFORM	
MW-358-14	MW-358	11/09/2004	PROFILE	240	245	139	144	8260B	CHLOROFORM	
MW-358-14FD	MW-358	11/09/2004	PROFILE	240	245	139	144	8260B	CHLOROFORM	
MW-358-15	MW-358	11/09/2004	PROFILE	250	255	149	154	8260B	CHLOROFORM	
MW-358-16	MW-358	11/09/2004	PROFILE	260	265	159	164	8260B	CHLOROFORM	
MW-358-17	MW-358	11/10/2004	PROFILE	270	275	169	174	8260B	CHLOROFORM	
MW-358-18	MW-358	11/10/2004	PROFILE	280	285	179	184	8260B	CHLOROFORM	
MW-358-19	MW-358	11/10/2004	PROFILE	290	295	189	194	8260B	CHLOROFORM	

DATA REPORTED REFLECT CURRENT DATABASE FOR SAMPLES RECEIVED IN SPECIFIED TIMEFRAME. NOT ALL RESULTS ARE COMPLETE.

SBD = SAMPLE COLLECTION BEGIN DEPTH IN FEET BELOW GROUND SURFACE

SED = SAMPLE COLLECTION END DEPTH IN FEET BELOW GROUND SURFACE

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

PDA/YES = Photo Diode Array, Detect Confirmed

PDA/NO = Photo Diode Array, Detect Not Confirmed

+ = Interference in sample

TABLE 5
DETECTED COMPOUNDS-UNVALIDATED
SAMPLES RECEIVED 11/01/04 - 11/30/04

SAMPLE ID	LOCID OR WELL	SAMPLED	SAMP TYPE	SBD	SED	BWTS	BWTE	METHOD	ANALYTE	PDA
MW-358-20	MW-358	11/10/2004	PROFILE	300	305	199	204	8260B	CHLOROFORM	

DATA REPORTED REFLECT CURRENT DATABASE FOR SAMPLES RECEIVED IN SPECIFIED TIMEFRAME. NOT ALL RESULTS ARE COMPLETE.

SBD = SAMPLE COLLECTION BEGIN DEPTH IN FEET BELOW GROUND SURFACE

SED = SAMPLE COLLECTION END DEPTH IN FEET BELOW GROUND SURFACE

BWTS = DEPTH BELOW WATER TABLE, START DEPTH, MEASURED IN FEET

BWTE = DEPTH BELOW WATER TABLE, END DEPTH, MEASURED IN FEET

PDA/YES = Photo Diode Array, Detect Confirmed

PDA/NO = Photo Diode Array, Detect Not Confirmed

+ = Interference in sample

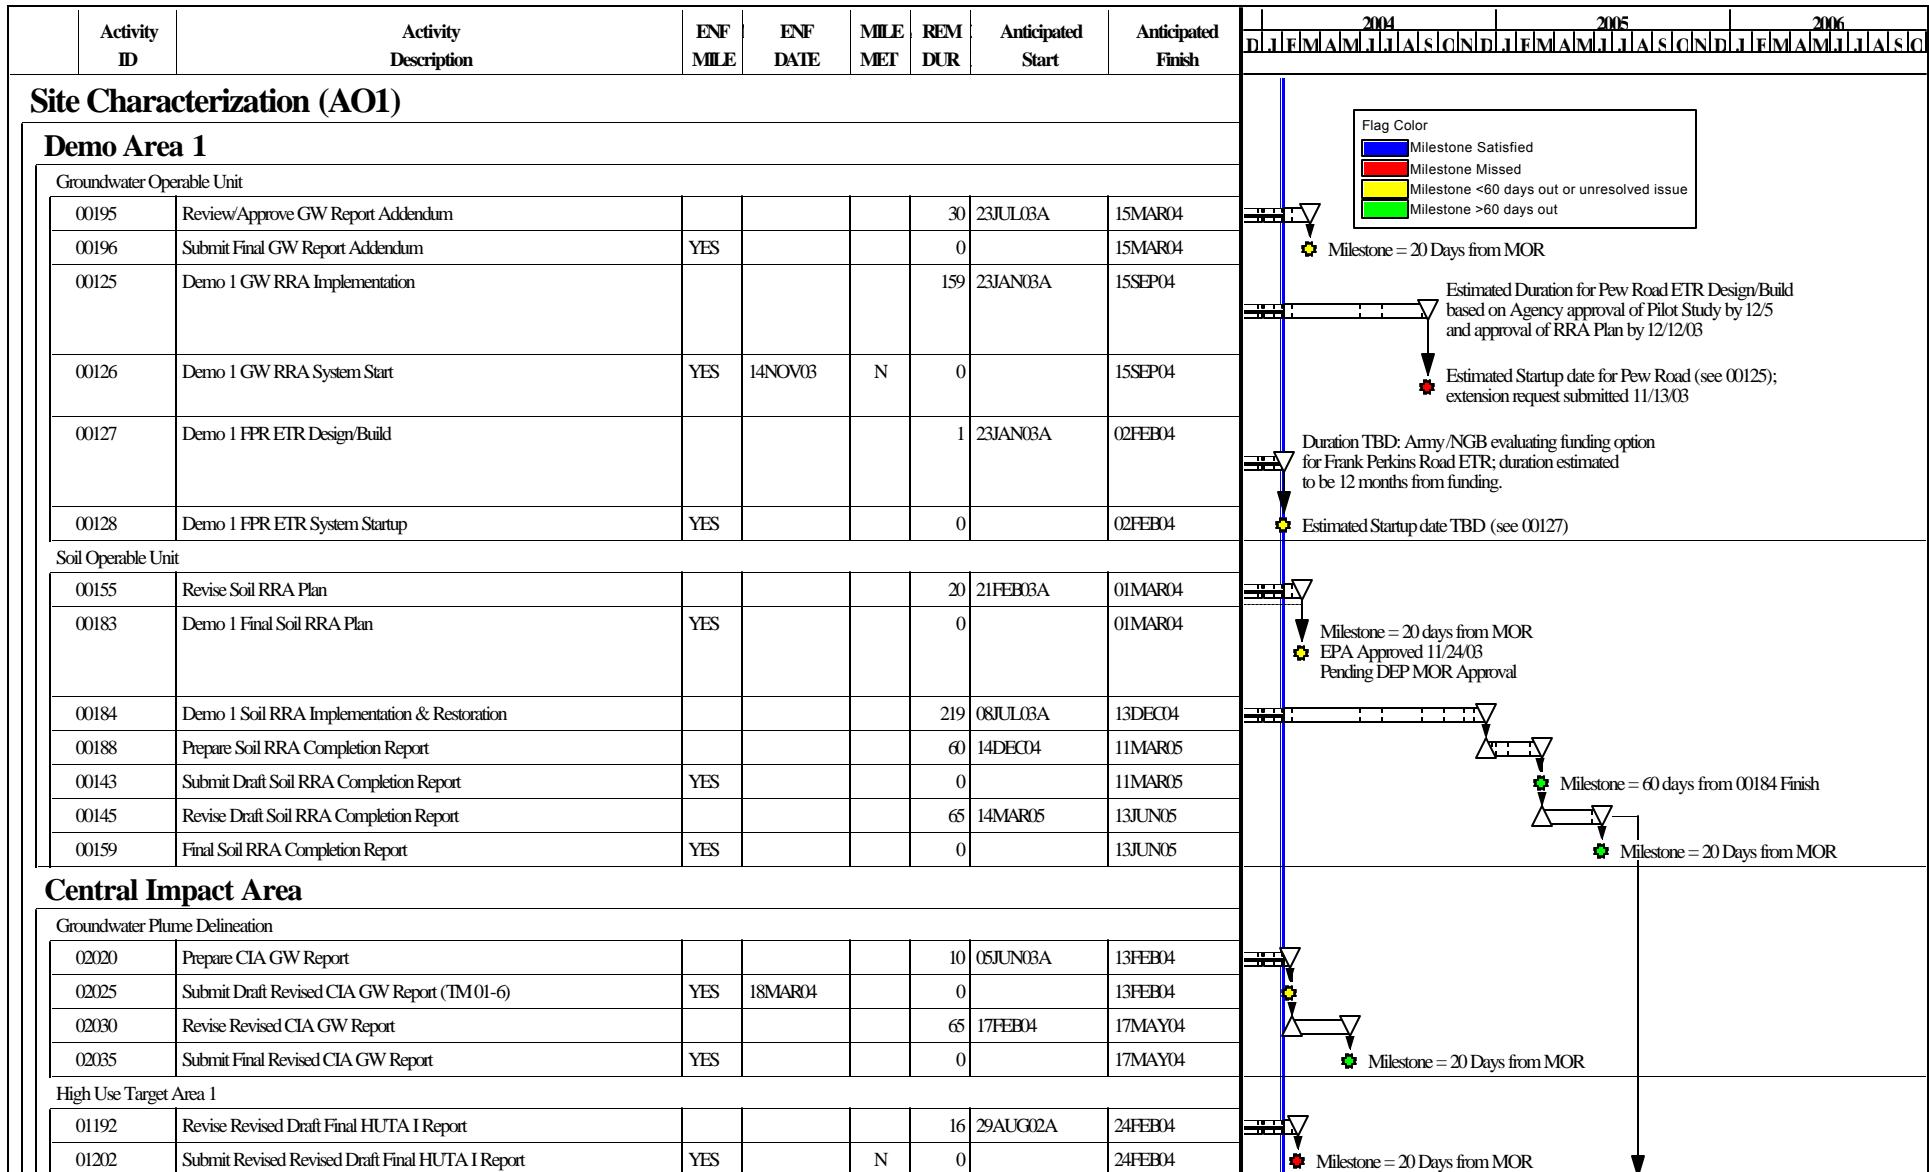


Figure 9

Start Date	29FEB00	Early Bar	UB09	Sheet 1 of 13	Date	Revision	Checked	Approved
Finish Date	31JUL09	Progress Bar						
Data Date	01FEB04							
Run Date	09FEB04 14:21							
© Primavera Systems, Inc.		DRAFT		Combined Schedule for the Impact Area GW Study Program as of 01FEB04				

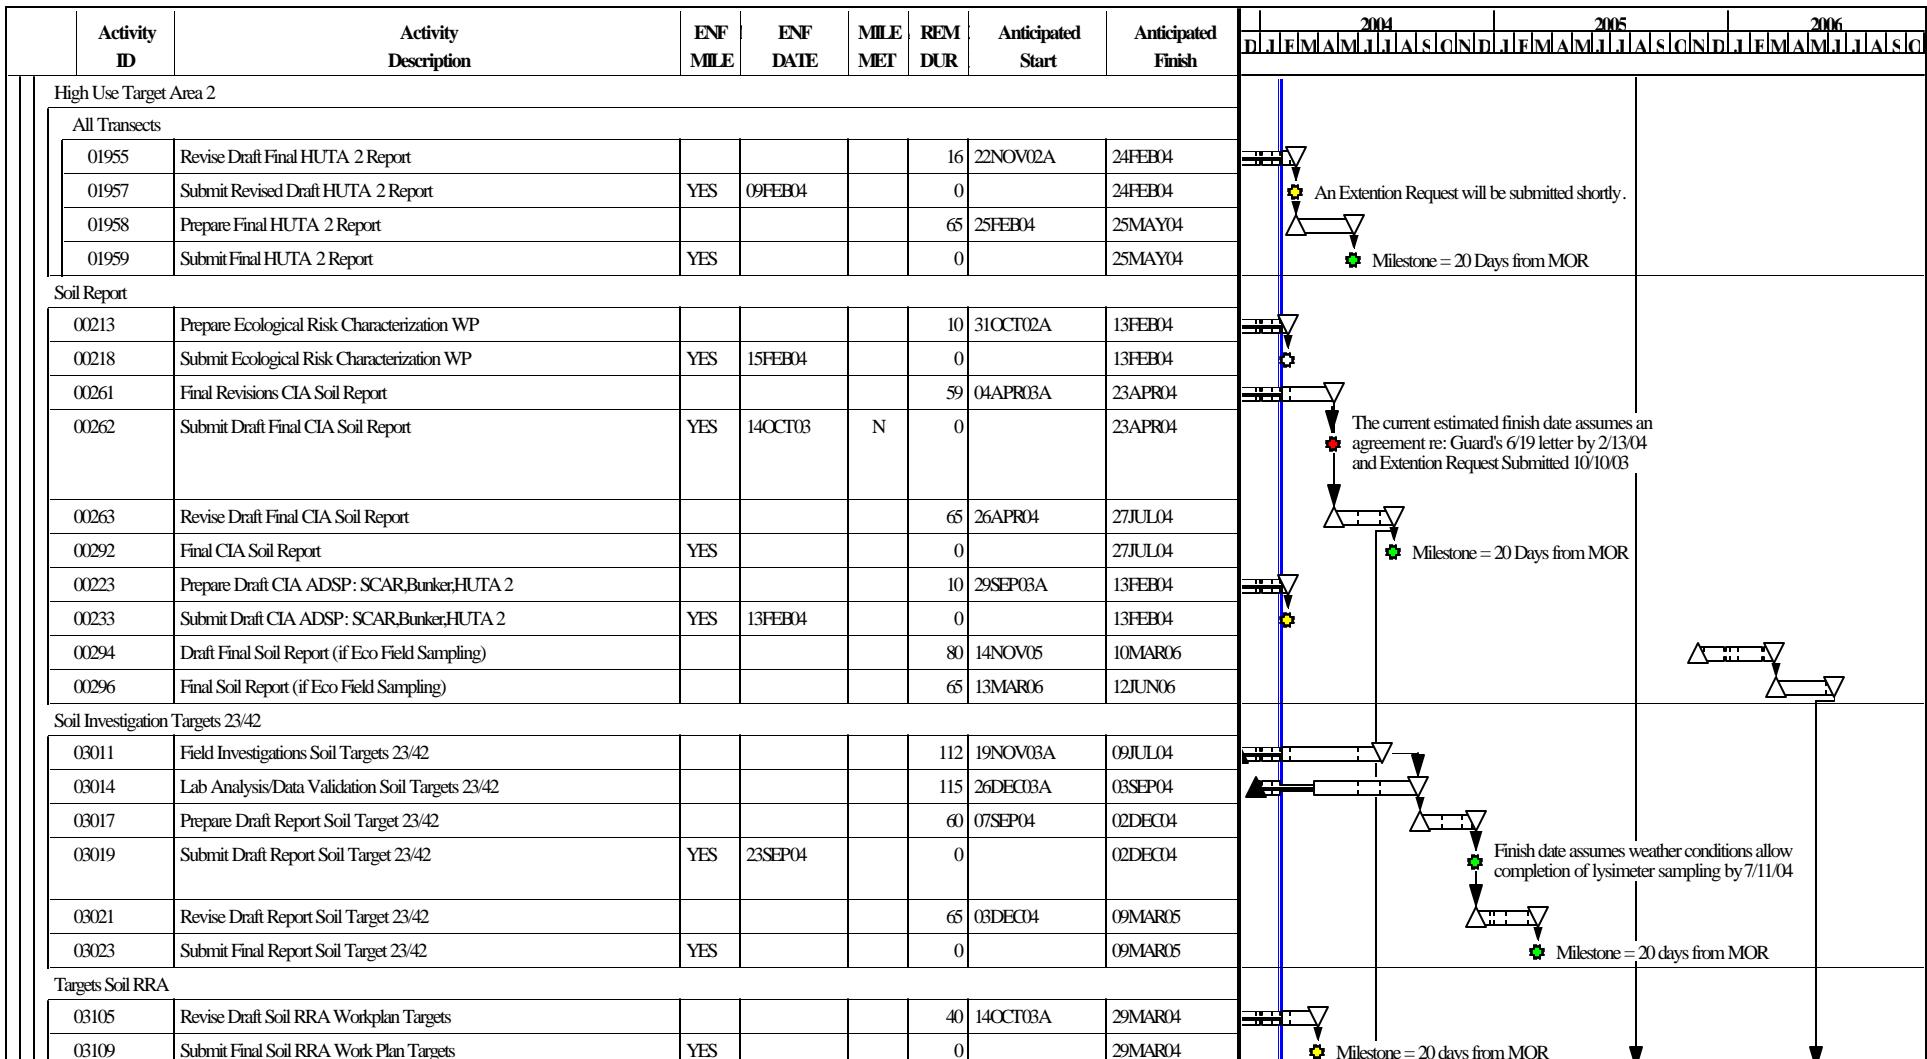


Figure 9

Start Date	29FEB00	Early Bar	UB09 Sheet 2 of 13 Combined Schedule for the Impact Area GW Study Program as of 01FEB04	Date	Revision	Checked	Approved
Finish Date	31JUL09	Progress Bar					
Data Date	01FEB04						
Run Date	09FEB04 14:21						
© Primavera Systems, Inc.		DRAFT					

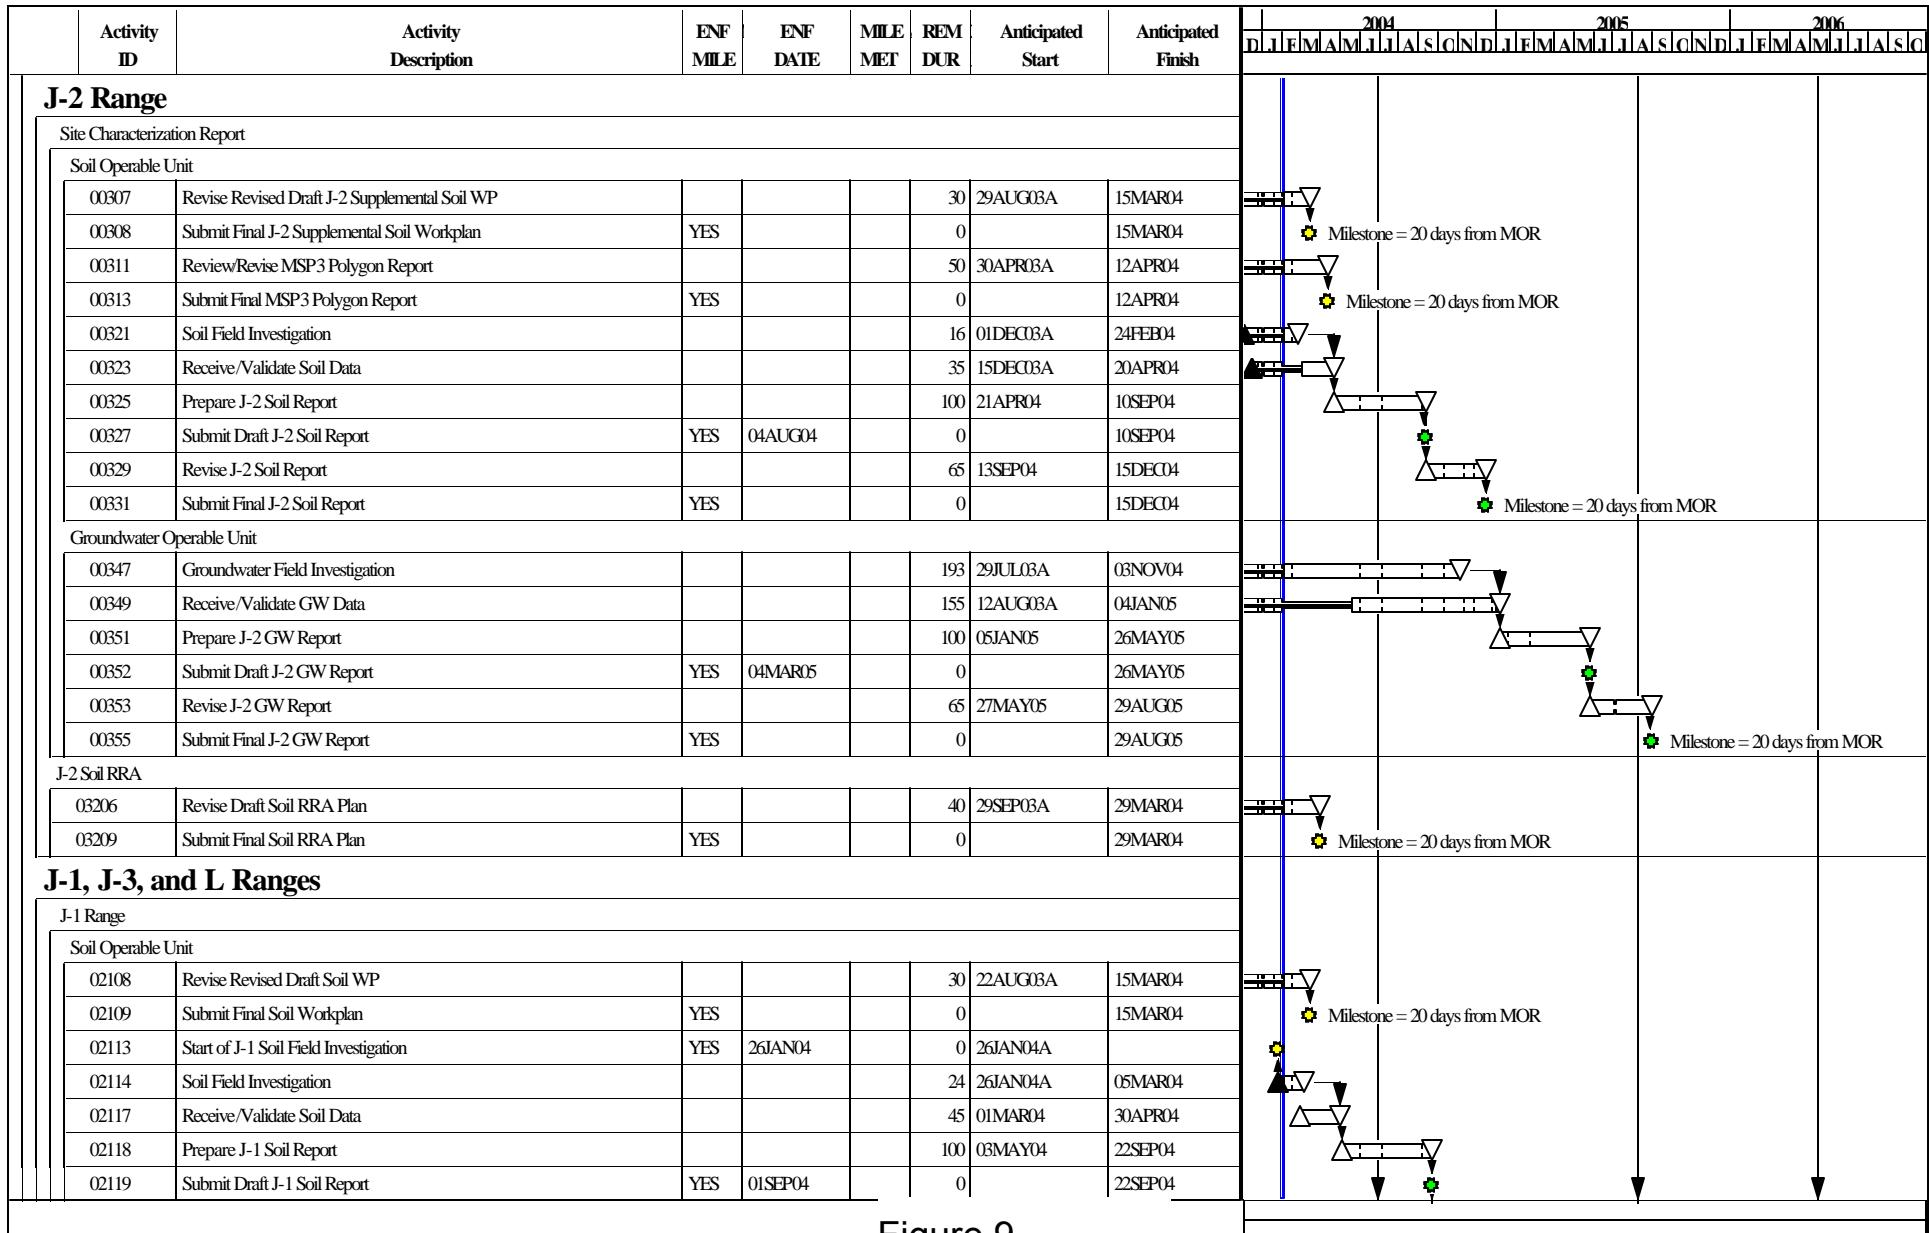


Figure 9

Start Date	29FEB00	Early Bar	UB09 Sheet 3 of 13 Combined Schedule for the Impact Area GW Study Program as of 01FEB04	Date	Revision	Checked	Approved
Finish Date	31JUL09	Progress Bar					
Data Date	01FEB04						
Run Date	09FEB04 14:21						
© Primavera Systems, Inc.	DRAFT						

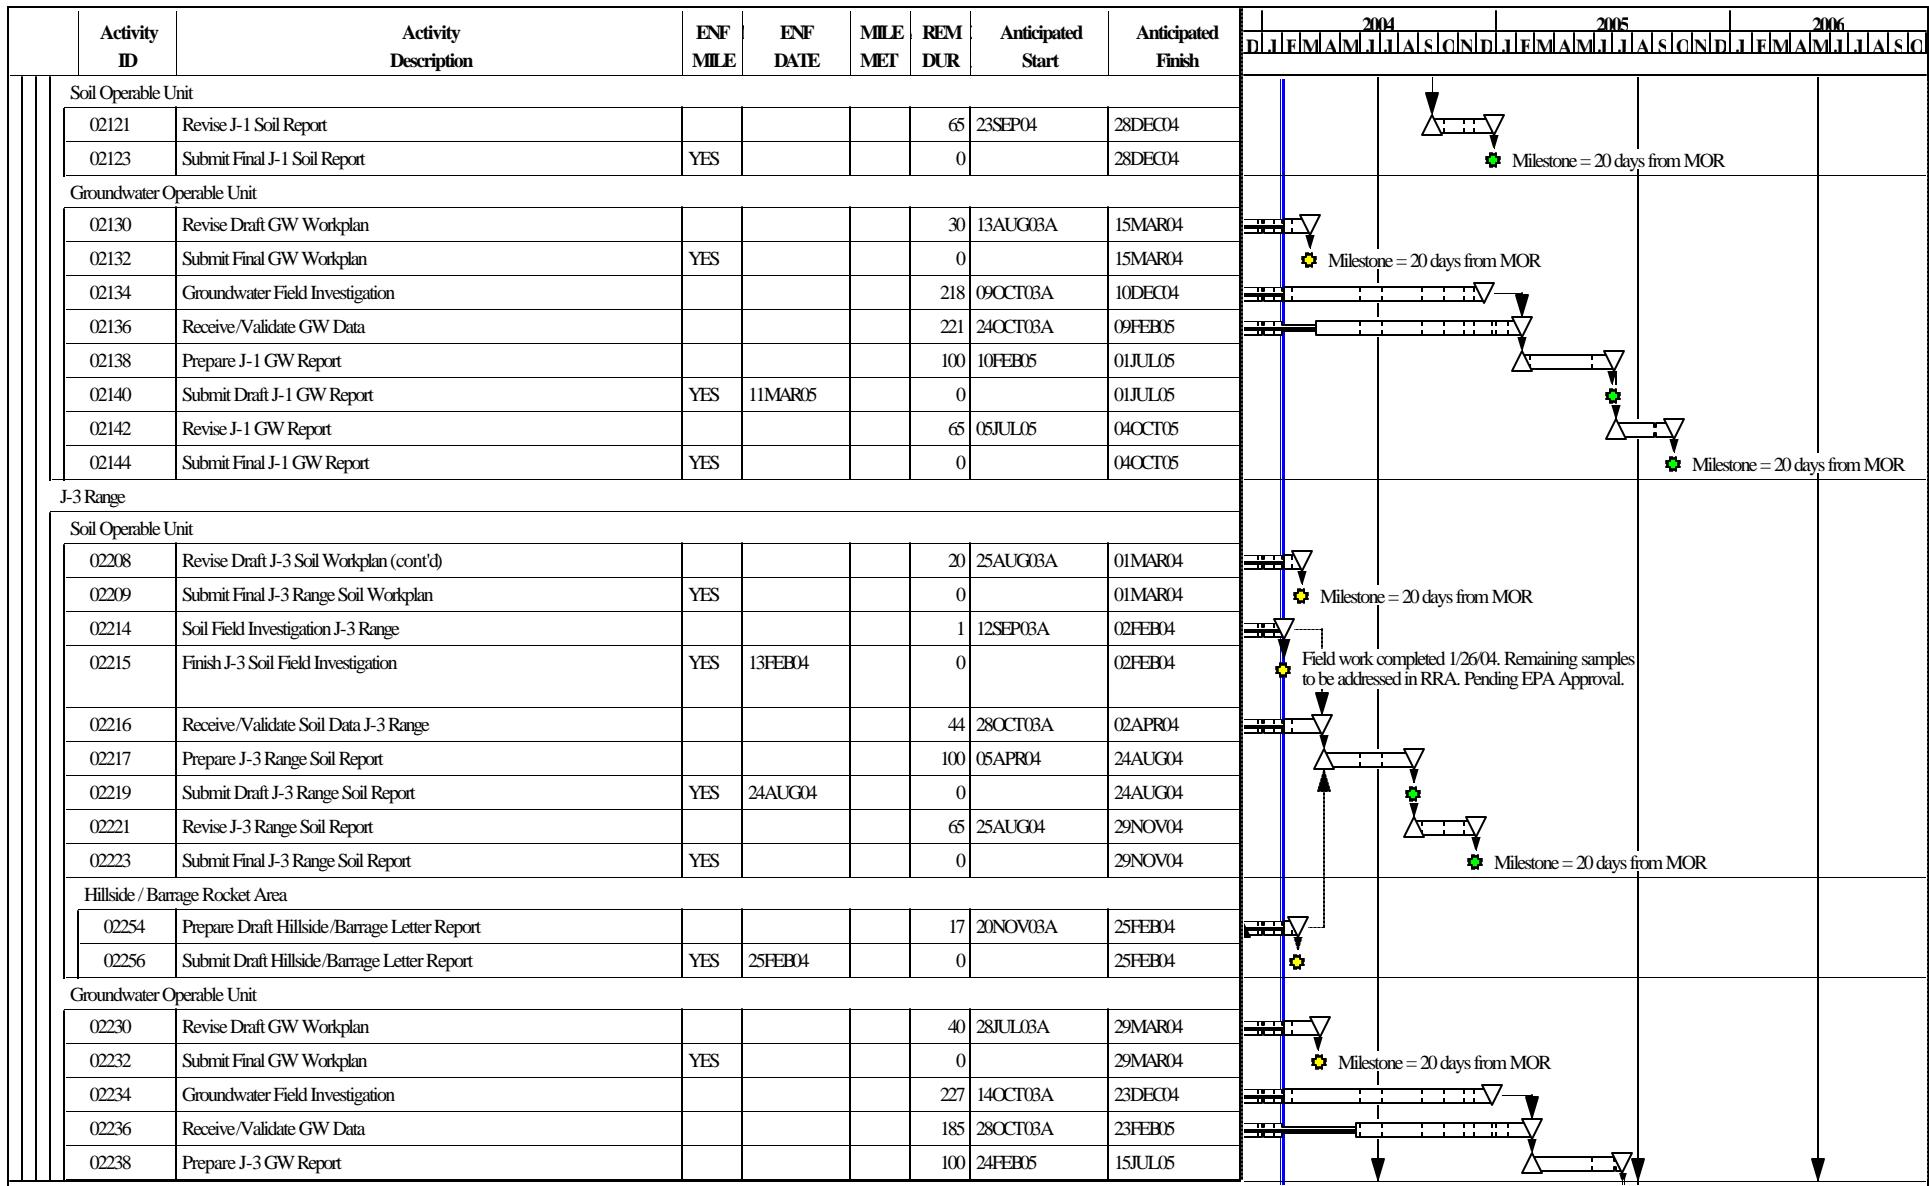


Figure 9

Start Date	29FEB00	DRAFT	UB09 Sheet 4 of 13 Combined Schedule for the Impact Area GW Study Program as of 01FEB04	Early Bar	Date Revision Checked Approved
Finish Date	31JUL09			Progress Bar	
Data Date	01FEB04				
Run Date	09FEB04 14:21				
© Primavera Systems, Inc.					

Figure 9

Start Date	29FEB00	 Early Bar	UB09	Sheet 5 of 13	Date	Revision	Checked	Approved
Finish Date	31JUL09	 Progress Bar						
Data Date	01FEB04							
Run Date	09FEB04 14:21							
© Primavera Systems, Inc.		DRAFT	Combined Schedule for the Impact Area GW Study Program as of 01FEB04					

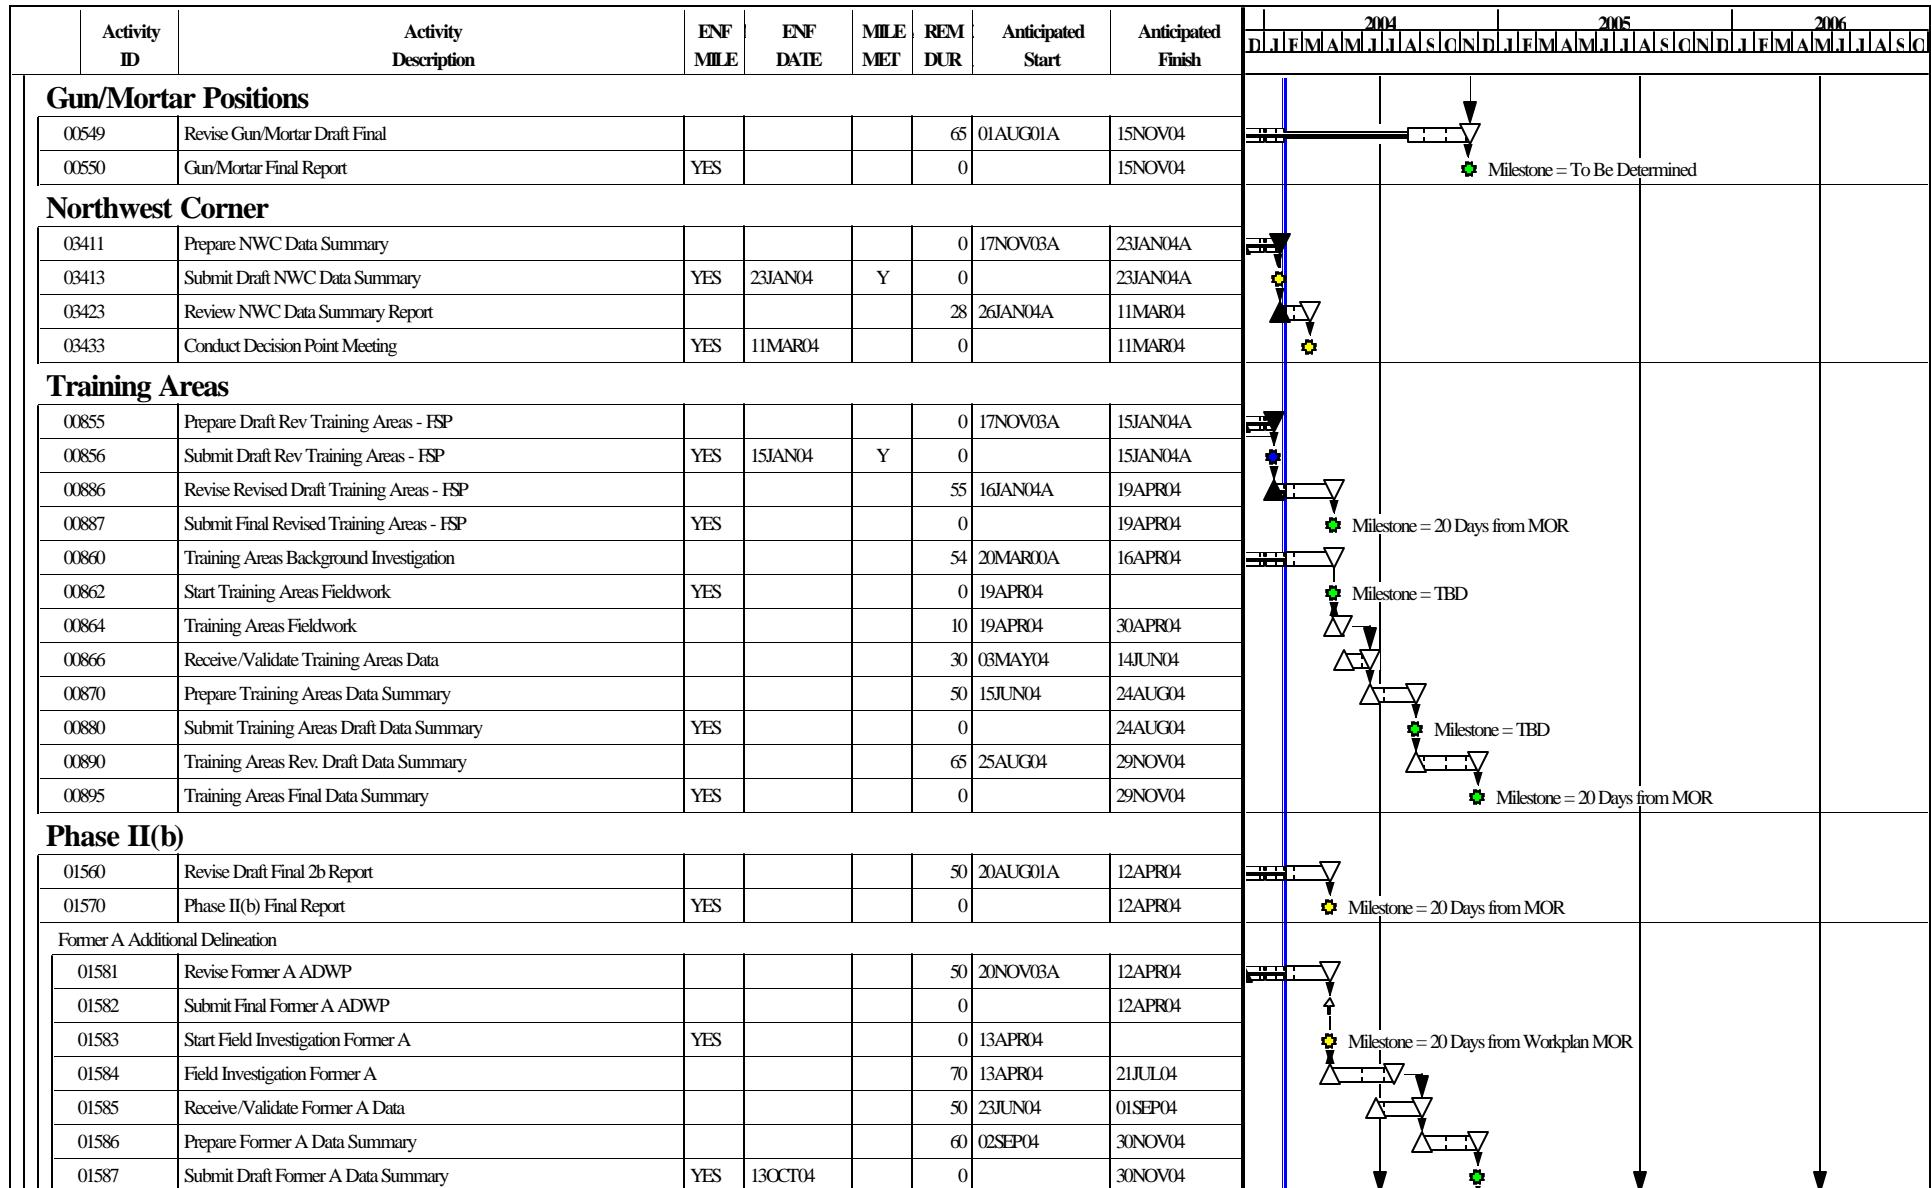



Figure 9

Start Date	29FEB00	Early Bar	UB09	Sheet 6 of 13	Date	Revision	Checked	Approved
Finish Date	31JUL09	Progress Bar						
Data Date	01FEB04							
Run Date	09FEB04 14:21							
© Primavera Systems, Inc.	DRAFT							

Figure 9

Start Date	29FEB00	 Early Bar	UB09	Sheet 7 of 13	 Progress Bar	Date	Revision	Checked	Approved
Finish Date	31JUL09								
Data Date	01FEB04								
Run Date	09FEB04 14:21								
© Primavera Systems, Inc.		DRAFT	Combined Schedule for the Impact Area GW Study Program as of 01FEB04						

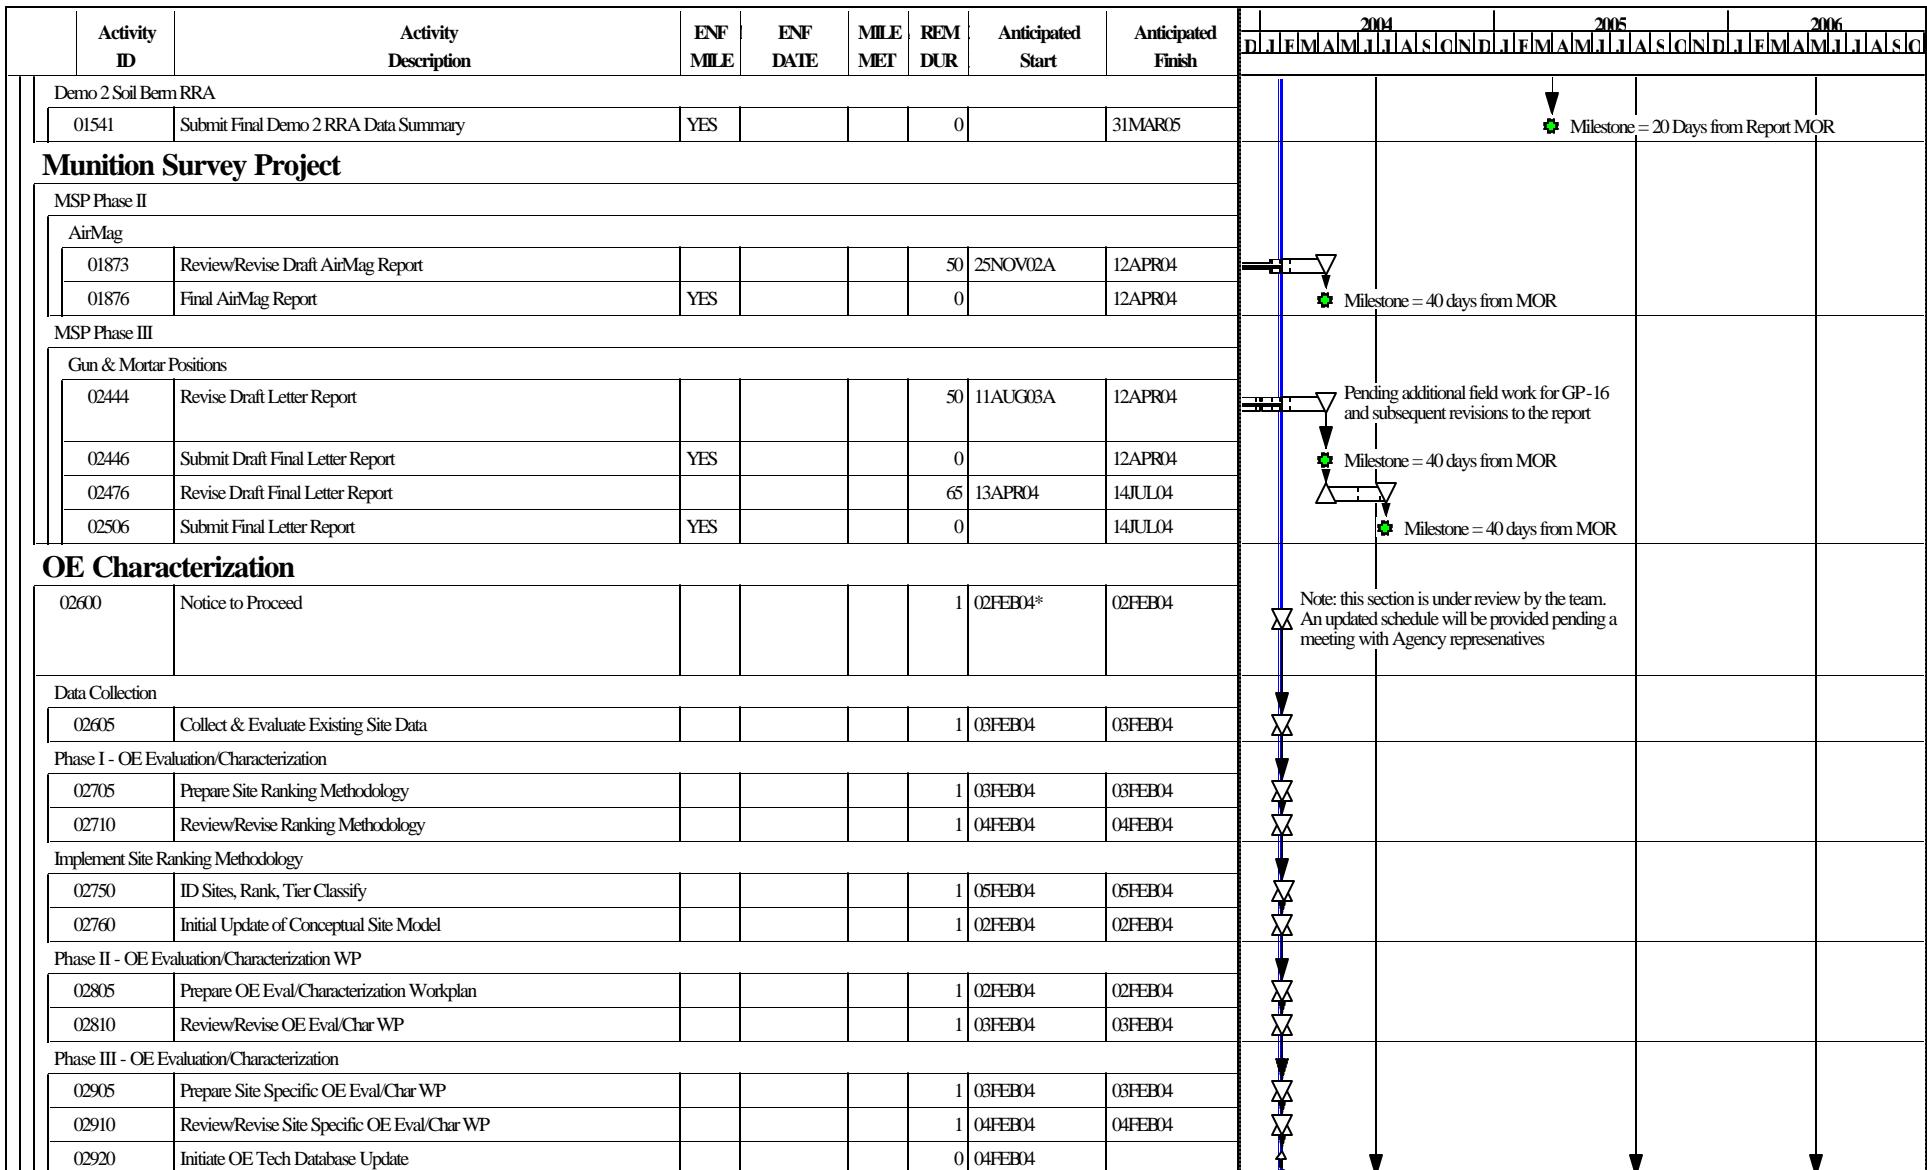


Figure 9

Start Date	29FEB00	DRAFT	UB09 Sheet 8 of 13 Combined Schedule for the Impact Area GW Study Program as of 01FEB04	Early Bar	
Finish Date	31JUL09			Progress Bar	
Data Date	01FEB04				
Run Date	09FEB04 14:21				
© Primavera Systems, Inc.				Date	Revision
				Checked	Approved

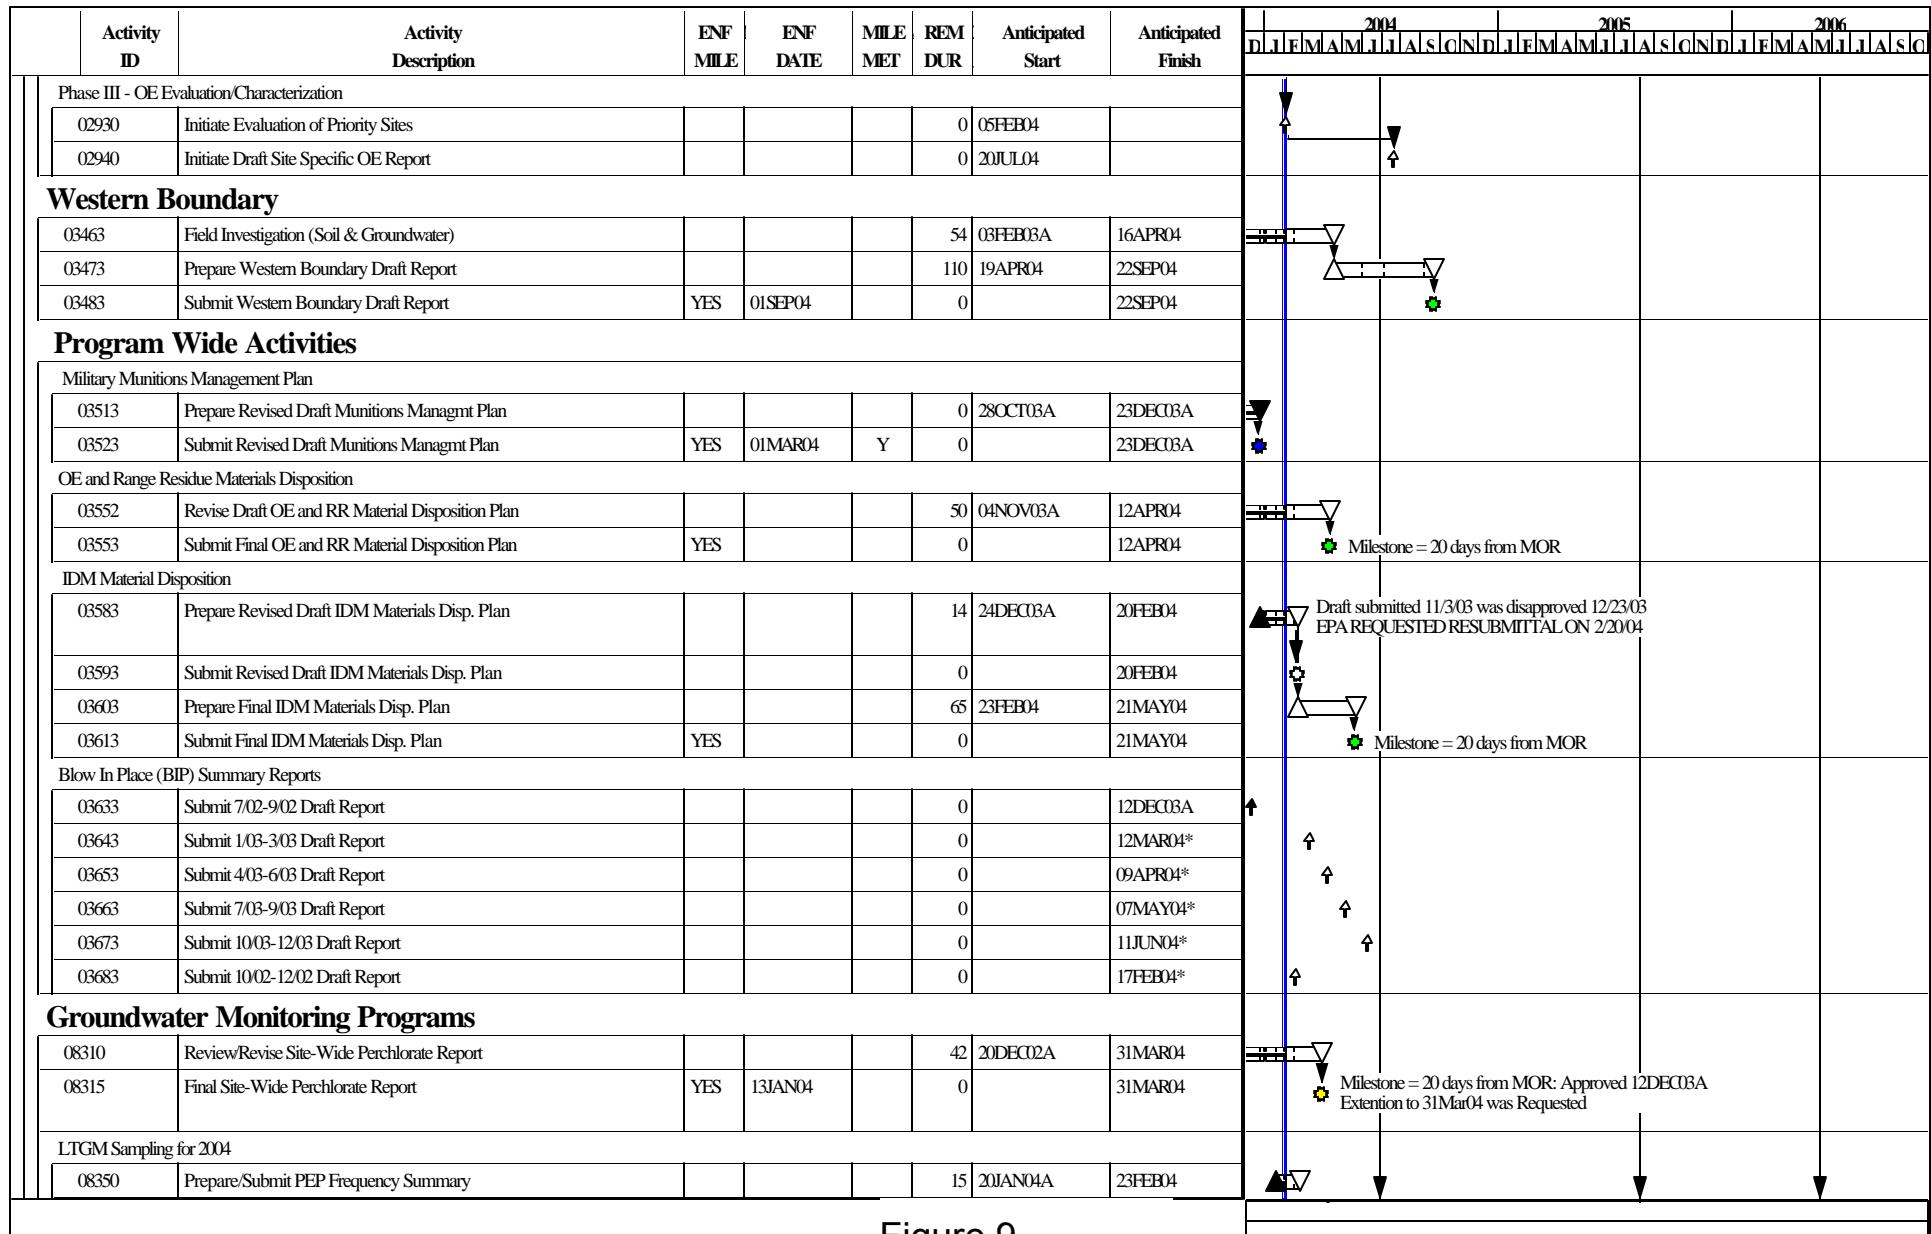


Figure 9

Start Date	29FEB00	DRAFT	UB09	Sheet 9 of 13	Date	Revision	Checked	Approved
Finish Date	31JUL09		Early Bar					
Data Date	01FEB04		Progress Bar					
Run Date	09FEB04 14:21			Combined Schedule for the Impact Area GW Study Program as of 01FEB04				
© Primavera Systems, Inc.								

Rapid Response Actions (AO3)

Group 2 (Mortar Target 9)

03623 Submit 7/02-9/02 Draft Report 0 12DEC08A ↑

Feasibility Studies (AO3)

Demo Area 1

Soil Operable Unit

21190	Revise Demo 1 Soil Draft FS Screening Report			63	22JUN01A	08AUG05	
21193	Submit Demo 1 Soil Draft Final Demo 1 FSSR	YES		0		08AUG05	
21194	Revise Demo 1 Soil Draft Final Demo 1 FSSR			65	09AUG05	09NOV05	
21200	Final Demo 1 Soil FS Screening Report	YES		0		09NOV05	
21310	Prepare Demo 1 Soil FS			88	13OCT05	21FEB06	
21320	Submit Demo 1 Soil FS	YES		0		21FEB06	
21330	Revise Demo 1 Soil FS			65	22FEB06	23MAY06	
21340	Submit Final Demo 1 Soil FS	YES		0		23MAY06	

Groundwater Operable Unit

21674	Prepare Demo 1 GW Revised Draft FS			76	08APR03A	18MAY04	
21675	Submit Demo 1 GW Revised Draft FS	YES	25MAR04	0		18MAY04	
21678	Revise Demo 1 GW Revised Draft FS			65	19MAY04	19AUG04	
21680	Submit Demo 1 GW Final FS	YES		0		19AUG04	


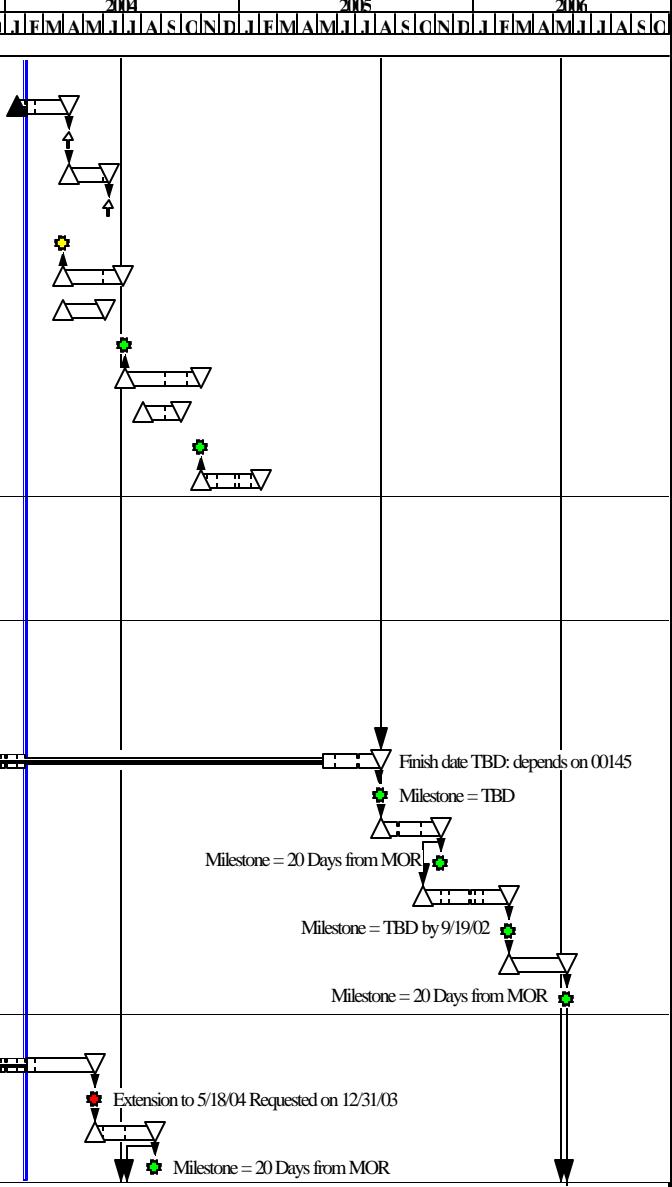


Figure 9

	Activity ID	Activity Description	ENF MILE	ENF DATE	MILE MET	REM DUR	Anticipated Start	Anticipated Finish	2004	2005	2006
Central Impact Area									JUL	JUL	JUL
Soil Operable Unit											
22110	CIA FS Screening Report Preparation				60	29JUN04	22SEP04				
22112	Scoping Meeting for CIA FSSR				1	28JUN04	28JUN04				
22120	Draft CIA FS Screening Report	YES	07JAN04		0		22SEP04				
22130	Revise CIA Draft FS Screening Report				65	23SEP04	28DEC04				
22140	Final CIA FS Screening Report	YES			0		28DEC04				
22142	Draft CIA FSSR (if Eco Field Sampling)				60	15MAY06	08AUG06				
22144	Final CIA FSSR (if Eco Field Sampling)				65	09AUG06	09NOV06				
22202	CIA FS Scoping Meeting				1	30NOV04	30NOV04				
22210	Prepare Draft CIA FS				60	01DEC04	28FEB05				
22220	Submit Draft CIA FS	YES	08JUN04		0		28FEB05				
22230	Revise CIA FS				65	01MAR05	31MAY05				
22240	Submit Final CIA FS	YES			0		31MAY05				
22250	(Draft FS if Eco Field Sampling)				60	13OCT06	10JAN07				
22260	(Final FS if Eco Field Sampling)				65	11JAN07	11APR07				
Groundwater Operable Unit											
22398	GW Flow/Transport Modeling				134	16JUN03A	10AUG04				
22400	FS Preparation				103	02AUG04	29DEC04				
22410	Draft FS	YES			0		29DEC04				
22420	Revise Draft FS				65	30DEC04	04APR05				
22430	Final FS	YES			0		04APR05				

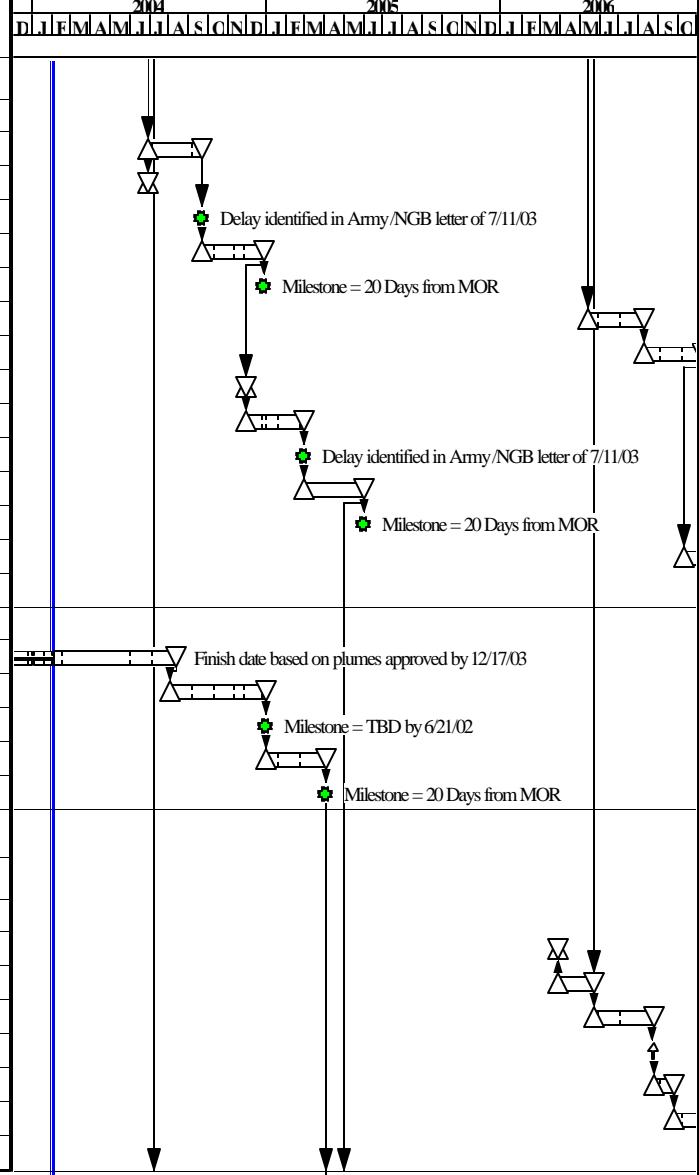

Remedy Selection (AO3)

Demo Area 1

Soil Operable Unit						
31105	Soil RS Plan Scoping Meeting				1	29MAR06
31110	Prepare Draft Remedy Selection Plan				40	29MAR06
31120	Revise Draft Remedy Selection Plan				65	24MAY06
31130	Remedy Selection Plan				0	24AUG06
31140	Public Comment Period				21	25AUG06
31150	Draft Decision Doc/Response Summary				44	26SEP06
31160	Revise Draft DD/RS				65	30NOV06
						02MAR07

Figure 9

Start Date	29FEB00	Early Bar	UB09	Sheet 11 of 13	Date	Revision	Checked	Approved
Finish Date	31JUL09	Progress Bar						
Data Date	01FEB04							
Run Date	09FEB04 14:21							
© Primavera Systems, Inc.	DRAFT							



	Activity ID	Activity Description	ENF MILE	ENF DATE	MILE MET	REM DUR	Anticipated Start	Anticipated Finish	2004	2005	2006
									J	J	J
									F	M	A
		Soil Operable Unit									
	31170	Final Decision Doc/ Response Summary				0		02MAR07			
		Groundwater Operable Unit									
	31505	GW RS Plan Scoping Meeting				1	09JUL04	09JUL04			
	31510	Prepare Draft Remedy Selection Plan			50	09JUL04	17SEP04				
	31515	Submit Demo 1 GW Draft RS Plan	YES	26JUL04		0		17SEP04			
	31520	Revise Demo 1 GW Draft Remedy Selection Plan			65	20SEP04	22DEC04				
	31530	Demo 1 GW Remedy Selection Plan			0		22	23DEC04	22DEC04		
	31540	Demo 1 GW Public Comment Period				22	23DEC04	26JAN05			
	31550	Demo 1 GW Draft Decision Doc/ Response Summary			60	27JAN05	21APR05				
	31560	Revise Demo 1 GW Draft DD/RS			65	22APR05	25JUL05				
	31570	Final Demo 1 GW Decision Doc/ Response Summary			0		25JUL05				
		Central Impact Area									
		Soil Operable Unit									
	32105	Soil RS Plan Scoping Meeting				1	03MAY05	03MAY05			
	32110	Prepare Draft Remedy Selection Plan			60	03MAY05	27JUL05				
	32120	Revise Draft Remedy Selection Plan			65	28JUL05	28OCT05				
	32130	Remedy Selection Plan			0		28OCT05				
	32140	Public Comment Period			21	31OCT05	30NOV05				
	32150	Draft Decision Doc/ Response Summary			64	01DEC05	06MAR06				
	32160	Revise Draft DD/RS			65	07MAR06	06JUN06				
	32170	Final Decision Doc/ Response Summary			0		06JUN06				
	32172	Draft DD/RS (if Eco Field Sampling)			210	12DEC06	04OCT07				
	32174	Final DD/RS (if Eco Field Sampling)			65	05OCT07	08JAN08				
		Groundwater Operable Unit									
	32505	GW RS Plan Scoping Meeting				1	07JAN05	07JAN05			
	32510	Prepare Draft Remedy Selection Plan			60	07JAN05	04APR05				
	32520	Revise Draft Remedy Selection Plan			65	05APR05	06JUL05				
	32530	Remedy Selection Plan			0		06JUL05				
	32540	Public Comment Period			21	07JUL05	04AUG05				
	32550	Draft Decision Doc/ Response Summary			64	05AUG05	04NOV05				
	32560	Revise Draft DD/RS			65	07NOV05	10FEB06				

Figure 9

Start Date	29FEB00	Early Bar	UB09	Sheet 12 of 13	Date	Revision	Checked	Approved
Finish Date	31JUL09	Progress Bar						
Data Date	01FEB04							
Run Date	09FEB04 14:21							
© Primavera Systems, Inc.		DRAFT		Combined Schedule for the Impact Area GW Study Program as of 01FEB04				

	Activity ID	Activity Description	ENF MILE	ENF DATE	MILE MET	REM DUR	Anticipated Start	Anticipated Finish	2004	2005	2006
									J	J	J
	Groundwater Operable Unit										
	32570	Final Decision Doc / Response Summary				0		10FEB06			

Figure 9

Start Date	29FEB00	 Early Bar	UB09 Sheet 13 of 13 Combined Schedule for the Impact Area GW Study Program as of 01FEB04	 Progress Bar	
Finish Date	31JUL09				
Data Date	01FEB04				
Run Date	09FEB04 14:21				
© Primavera Systems, Inc.	DRAFT				